

NPDES compliance summary report, fiscal year 2005

Massachusetts Water Resources Authority

Environmental Quality Department
Report ENQUAD 2006-06



NPDES COMPLIANCE SUMMARY REPORT

Fiscal Year 2005

Frederick A. Laskey
Executive Director

Michael J. Hornbrook
Chief Operating Officer

Dr. Andrea C. Rex
Director, Environmental Quality Department

By
David Wu

Technical Report No. 2006-06
Environmental Quality Department
Operations Division
Massachusetts Water Resources Authority
Charlestown Navy Yard
100 First Avenue
Boston, MA 02129
(617) 242-6000

Contributors

Grace Bigornia-Vitale
Mark Sullivan
Kelly Coughlin
Maury Hall

Citation:

Wu D. 2006. NPDES compliance summary report, fiscal year 2005. Boston:
Massachusetts Water Resources Authority. Report ENQUAD 2006-06. 154 pp.

Table of Contents

EXECUTIVE SUMMARY	1
Deer Island Treatment Plant	1
Combined Sewer Overflow Facilities	4
Collection and Transport System	5
Future Outlook	6
I: INTRODUCTION	7
II: DEER ISLAND TREATMENT PLANT	8
II.A.1 Influent Flow	8
II.A.2 Influent Conventional Parameters and Nutrients	9
II.A.3 Influent Priority Pollutants	10
II.A.4 Effluent Conventional Parameters and Nutrients	12
II.A.5 Effluent Priority Pollutants	15
II.A.6 Whole Effluent Toxicity	16
II.B.1 Compliance with Regulatory Limits	17
II.B.2 Effluent Quality Compared to Water Quality Standards	23
II.C.1 Ambient Monitoring Plan	23
II.C.2 The Contingency Plan	25
III: COMBINED SEWER OVERFLOW FACILITIES	29
III.A.1 Cottage Farm Activations	30
III.A.2 Cottage Farm Conventional Parameters	31
III.A.3 Cottage Farm Metals	31
III.B.1 Prison Point Activations	32
III.B.2 Prison Point Conventional Parameters	33
III.B.3 Prison Point Metals	33
III.C.1 Somerville Marginal Activations	34
III.C.2 Somerville Marginal Conventional Parameters	35
III.C.3 Somerville Marginal Metals	35
III.D.1 Fox Point Activations	36
III.D.2 Fox Point Conventional Parameters	37
III.D.3 Fox Point Metals	37
III.E.1 Commercial Point Activations	38
III.E.2 Commercial Point Conventional Parameters	39
III.E.3 Commercial Point Metals	39
IV: SLUDGE PROCESSING	40
IV.A Pelletizing Process	40
IV.B Sludge Pellet Regulations	40
V: TRANSPORT SYSTEMS	43
V.A.1 North System Headworks Choking	43
V.A.2 North System Sanitary Sewer Overflows	44
V.B South System Sanitary Sewer Overflows	45
V.C Infiltration/Inflow	45
VI: MISCELLANEOUS NPDES PERMIT REQUIREMENTS	46
VI.A Facility Best Management Practices Plans	46
VI.B Water Conservation / Dry Day Flow Limit	46
VI.C Pollution Prevention Program	46
VI.D Groundwater Remediation	47
VI.E Local Limits and Industrial Pretreatment Programs	47
VI.F Reporting	47

APPENDICES

- A: Deer Island Treatment Plant Data
- B: Cottage Farm CSO Facility Data
- C: Prison Point CSO Facility Data
- D: Somerville Marginal CSO Facility Data
- E: Fox Point CSO Facility Data
- F: Commercial Point CSO Facility Data
- G: NPDES Monitoring Requirements
- H: An Overview of the MWRA Sewerage System and Facilities
- I: Instrument Detection Limits, Method Detection Limits, and Quantitation Limits
- J: Priority Pollutants List and Other Parameters
- K: Glossary, Abbreviations, and Units

List of Tables

Table 1	Sanitary Sewer Overflows, FY05	6
Table II.A.1	Classification of DITP Influent, FY05	9
Table II.A.2	Deer Island Influent Characterization, FY94-FY05	10
Table II.A.3	Deer Island Removal Efficiency, FY05	12
Table II.A.4	Removal Efficiency vs. Degree of Secondary Treatment, FY05	13
Table II.A.5	Deer Island Effluent Characterization, FY94-FY05	14
Table II.A.6	Deer Island Effluent, Results of Toxicity Testing, FY05	17
Table II.B.1	Deer Island Effluent Quality Compared to Permit Limits, FY05	17
Table II.B.2	NPDES Violations at Deer Island, FY94-FY05	18
Table II.B.3	Comparison of DITP Effluent with Water Quality Criteria, FY05	23
Table II.C.1	Post-Discharge Ambient Monitoring Summary	24
Table II.C.2	Contingency Plan Threshold Summaries	25
Table II.C.3	Contingency Plan Exceedances, FY05	27
Table III.A.1	Cottage Farm CSO Activations Summary	30
Table III.A.2	Cottage Farm CSO Effluent Characteristics, FY05	31
Table III.A.3	Cottage Farm Metals, FY05	32
Table III.B.1	Prison Point CSO Activations Summary	32
Table III.B.2	Prison Point CSO Effluent Characteristics, FY05	33
Table III.B.3	Prison Point Metals, FY05	33
Table III.C.1	Somerville Marginal CSO Activations Summary	34
Table III.C.2	Somerville Marginal CSO Effluent Characteristics, FY05	35
Table III.C.3	Somerville Marginal Metals, FY05	35
Table III.D.1	Fox Point CSO Activations Summary	36
Table III.D.2	Fox Point CSO Effluent Characteristics, FY05	37
Table III.D.3	Fox Point Metals, FY05	37
Table III.E.1	Commercial Point CSO Activations Summary	38
Table III.E.2	Commercial Point CSO Effluent Characteristics, FY05	39
Table III.E.3	Commercial Point Metals, FY05	39
Table IV.B.1	Federal and State Limits for Sludge Pellet Metals	41
Table IV.B.2	Summary of Sludge Pellet Analysis, Calendar Year 2003	42
Table V.A.1	Sanitary Sewer Overflows, North System, FY02-05	45
Table V.B.1	Sanitary Sewer Overflows, South System, FY02-05	45

List of Figures

Figure 1	MWRA Flows, FY92-05	2
Figure 2	DITP Dry Day Flows, FY05	2
Figure 3	DITP Effluent TSS Removal Rates	3
Figure 4	DITP Effluent BOD/cBOD Removal Rates	3
Figure 5	NPDES Violations at DITP, FY94-05	4
Figure 6	CSO Activations, FY92-05	5
Figure 7	CSO Volume Treated, FY92-05	5
Figure 8	Headworks Choking, FY92-05	6
Figure II.A.1	DITP Influent Flow Compared to Precipitation, FY05	8
Figure II.A.2	DITP Influent Flow Compared to Precipitation, FY92-05	9
Figure II.A.3	DITP Mean Influent Metals Loadings, FY92-05	11
Figure II.A.4	DITP Mean Influent Organics Loadings, FY94-05	12
Figure II.A.5	DITP Mean Effluent Nutrient Concentrations, FY94-05	15
Figure II.A.6	DITP Mean Effluent Metals Loadings, FY89-05	15
Figure II.A.7	DITP Mean Effluent Organics Loadings, FY94-05	16
Figure II.B.1	DITP Effluent cBOD (Monthly Average), FY05	18
Figure II.B.2	DITP Effluent cBOD (Weekly Average), FY05	19
Figure II.B.3	DITP Effluent TSS (Monthly Average), FY05	19
Figure II.B.4	DITP Effluent TSS (Weekly Average), FY05	20
Figure II.B.5	DITP Effluent Fecal Coliform (Daily Geometric Mean), FY05	20
Figure II.B.6	DITP Effluent Fecal Coliform (High Sample Counts), FY05	21
Figure II.B.7	DITP Effluent pH (Monthly Min and Max), FY05	21
Figure II.B.8	DITP Effluent Total Chlorine Residual (Monthly Average), FY05	22
Figure II.B.9	DITP Effluent Total Chlorine Residual (Daily Average), FY05	22
Figure II.C.3	Contingency Plan Flowchart	28
Figure III.A.1	Cottage Farm CSO Activations Compared to Precipitation, FY94-05	30
Figure III.A.2	Cottage Farm Total Volume Treated Compared to Precipitation, FY94-05	31
Figure III.B.1	Prison Point CSO Activations Compared to Precipitation, FY94-05	32
Figure III.B.2	Prison Point Total Volume Treated Compared to Precipitation, FY94-05	33
Figure III.C.1	Somerville Marginal CSO Activations Compared to Precipitation, FY94-05	34
Figure III.C.2	Somerville Marginal Total Volume Treated Compared to Precipitation, FY94-05	35
Figure III.D.1	Fox Point CSO Activations Compared to Precipitation, FY94-05	36
Figure III.D.2	Fox Point Total Volume Treated Compared to Precipitation, FY94-05	36
Figure III.E.1	Commercial Point CSO Activations Compared to Precipitation, FY94-05	38
Figure III.E.2	Commercial Point Total Volume Treated Compared to Precipitation, FY94-05	39
Figure V.A.1	Choking, FY94-05	43
Figure V.A.2	Rain-Related Choking, FY94-05	43
Figure V.A.3	Testing/Maintenance Choking, FY94-05	44

Executive Summary

Overview

This report presents and summarizes monitoring and compliance data collected and analyzed by the Massachusetts Water Resources Authority's (MWRA) Environmental Quality Department (ENQUAD) from July 1, 2004 to June 30, 2005. This report, while not a regulatory requirement, provides a useful documentation of influent and effluent quality trends over the course of a fiscal year for the MWRA's Deer Island Treatment Plant (DITP) and Combined Sewer Overflow (CSO) facilities.


Deer Island Treatment Plant

The MWRA's NPDES permit requires the Authority to monitor its wastewater treatment plant at Deer Island for specific parameters. The MWRA currently operates under a permit issued in July 10, 2000 and effective August 9, 2000. The permit calls for secondary treatment of wastewater and monitoring of the effects of the new outfall in the Massachusetts Bay. Secondary treatment began at DITP in August 1997 with the start-up of the first battery of secondary treatment (Battery A). In March 1998, Battery B was brought on-line. The final battery, Battery C, became operational in March 2001. DITP was designed for an average design flow of 480 million gallons a day and a peak hydraulic capacity of 1.2 billion gallons a day.

In addition to the completion of secondary treatment facilities, the MWRA opened on September 6, 2000 a new 9.5-mile outfall tunnel that carries treated wastewater from DITP to Massachusetts Bay. The permit requires extensive monitoring of Massachusetts Bay to determine the effects of the outfall, if any exist.


Figure 1, on the following page, shows the Deer Island flow during each month of FY05, comparing the flow with the monthly averages of the previous twelve years – FY92 to FY04. From FY99 to FY02 all flows were treated at Deer Island, while from FY92 to FY98 flows were treated at DITP and the former Nut Island Treatment Plant, now the headworks for South System influent to DITP.

Figure 1. MWRA Flows, FY92-05


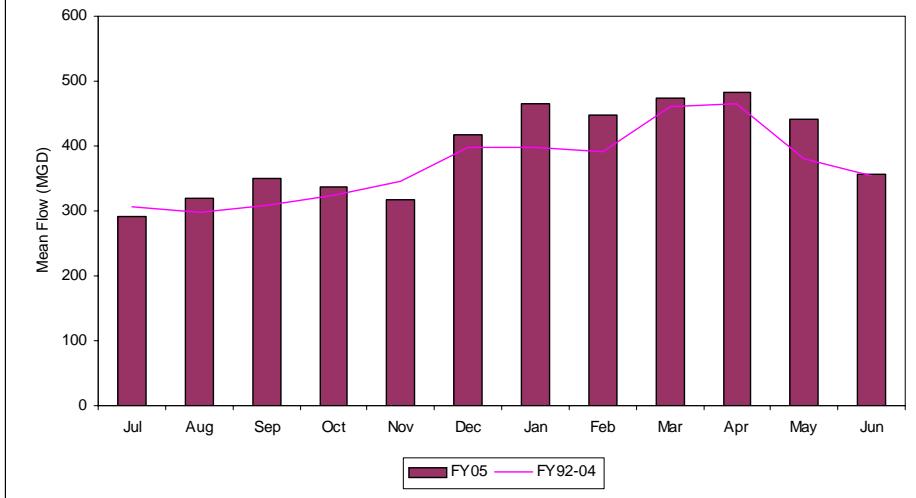


Restrictions on dry day flow are also part of the permit. These restrictions act to control new connections, ensuring that the collection system and the new treatment plant retain adequate capacity. Monthly dry day flows are calculated by averaging the flows on dry days over the previous year. A dry day is defined as a day with 0.09 inches of precipitation or less and no snow melt with the following restrictions: the precipitation on the previous day is less than 0.3 inches, the precipitation two days prior is less than 1.0 inch, and the precipitation three days prior is less than 2.0 inches. A day with snowmelt is defined as a day when there is snow on the ground and the air temperature is above 32°F. Figure 2 shows the dry day flow for Deer Island during each month of FY05. The solid line represents the dry day flow limit of 436 mgd for the permit. In FY05, no violations of the dry day flow limit occurred.

Figure 2. DITP Dry Day Flows, FY05

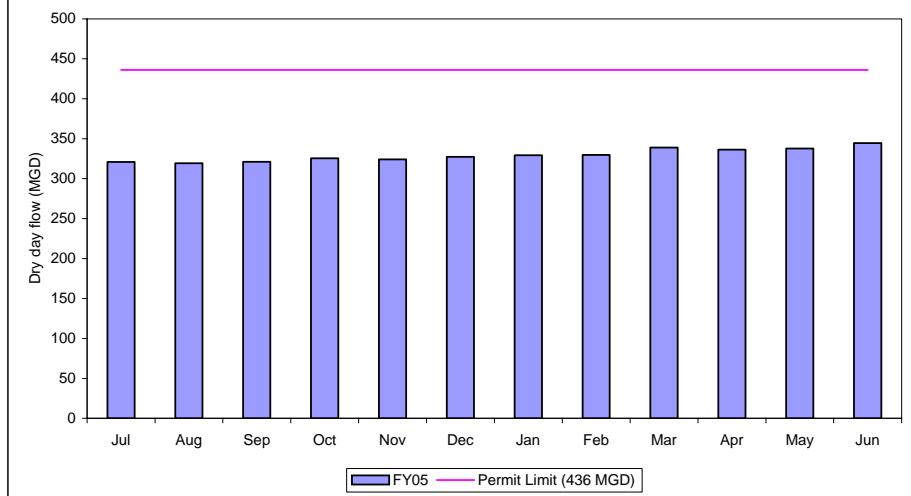


Since the new primary treatment plant came on-line on January 21, 1995, appreciable improvements have been seen in effluent quality. The removal rates for both TSS and BOD or cBOD (cBOD has replaced BOD in the current permit as the measure of oxygen demand) have improved significantly (see Figures 3 and 4, respectively on the following page). In FY96 and FY97, removal efficiencies compared favorably to theoretical removal efficiencies for primary treatment. In FY98, efficiencies continued to improve, especially for BOD, with a removal rate well above the theoretical range.¹ This coincided with the start-up of Batteries A and B of secondary treatment. Since FY00, removal rates for both TSS and cBOD have essentially leveled off as DITP has reached its optimal efficiency level.

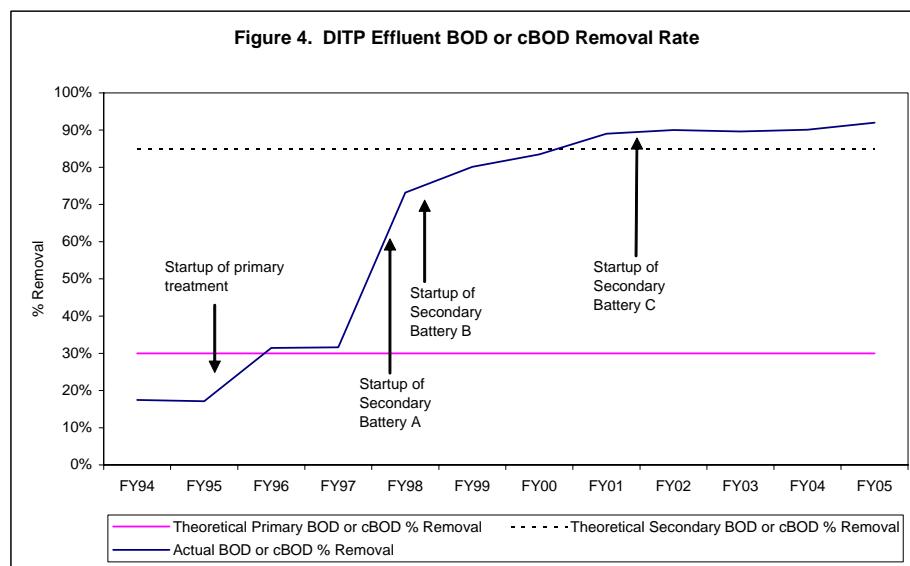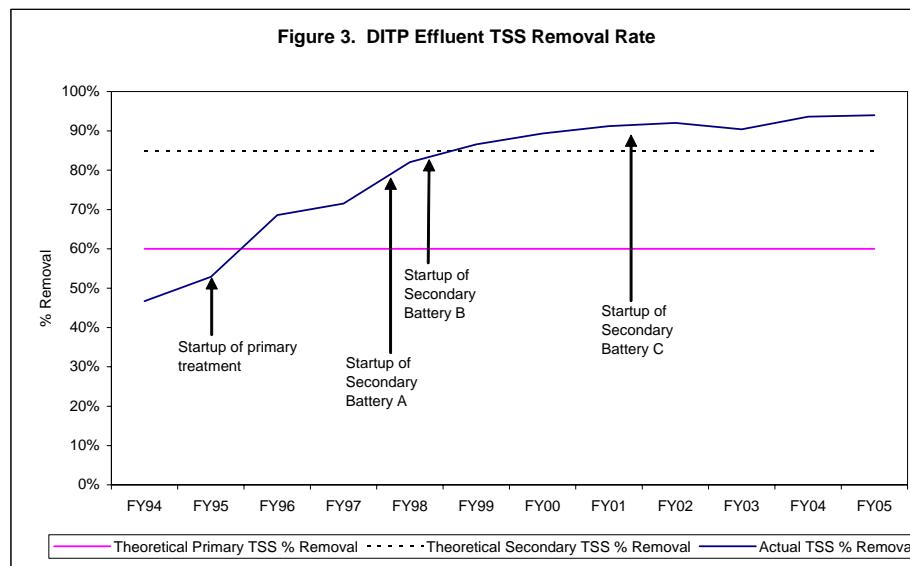

¹ Metcalf & Eddy, Inc. 1972. *Wastewater Engineering: Collection, Treatment, Disposal*. New York: McGraw-Hill Book Company. p. 446.

Annual numbers of NPDES violations have decreased dramatically due to improved treatment at DITP. Figure 5 compares the number of NPDES permit violations at Deer Island in FY05 to previous years. No non-toxicity NPDES violations occurred in FY05, FY00, FY99, or FY97. One non-toxicity violation occurred in FY02 and FY98, three in FY03, and four in FY01, compared to 12 in FY96 and 19 in both FY95 and FY94. In FY05, no violations of any of the limits occurred at DITP.


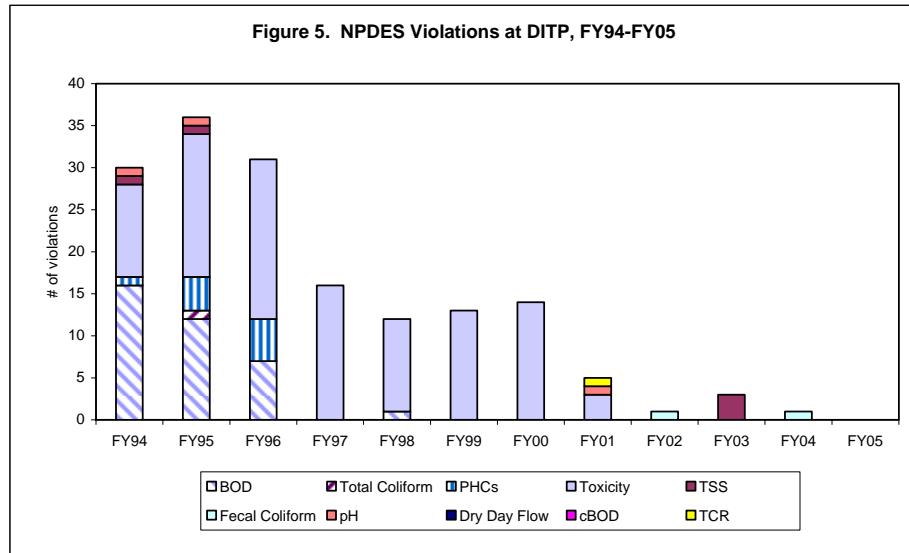


Since the opening of the new plant, Deer Island has seen significant reductions in loadings of metals and organic compounds in the effluent – see Chapter 2 for more details. These improvements are probably due to two factors: first, corrosion control activities and source reduction programs have helped to lower these pollutants in the incoming influent. Second, the new plant is able to better capture both metals and organics in the treatment process.

Combined Sewer Overflow Facilities

MWRA monitors five CSO facilities – Cottage Farm, Prison Point, Somerville Marginal, Fox Point, and Commercial Point – under the permit. The Constitution Beach facility is also included under the permit. However, MWRA decommissioned the Constitution Beach facility in September 2000 following the completion of a sewer separation project in East Boston.


Figures 6 and 7 on the next page show the number of activations and the total volume treated, respectively, at the six CSO facilities since FY92. The correlation between rainfall and CSO activation can be seen in both figures. Note that although total rainfall is correlated to CSO activations, the intensity of the rainfall and frequency of storms will have an important effect. These characteristics influence the degree of ground saturation, affecting the volume treated at the CSO facilities during a storm.

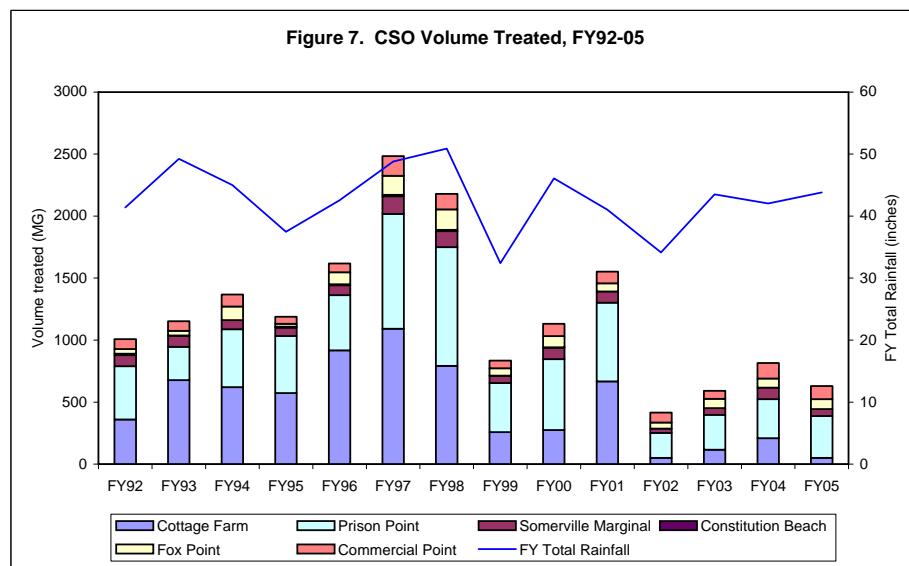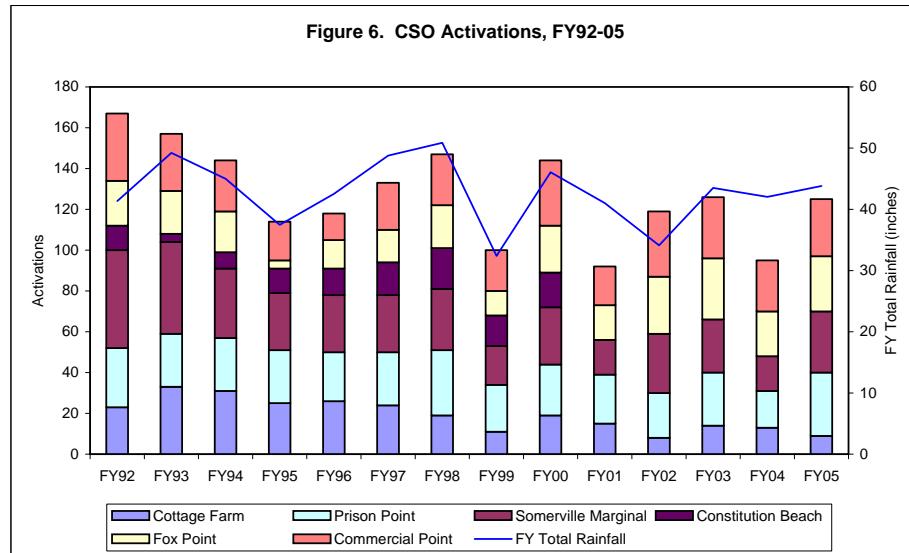

Collection and Transport System

The MWRA monitors the capacity of the wastewater collection and transport system. One of the system capacity parameters in the North System is choking, which occurs at the remote headworks. Choking is a reduction or stopping of flow to Deer Island at the remote headworks, either when heavy flow exceeds the capacity of the treatment plant or when maintenance or system upgrades are performed at the plant.

As Figure 8 on the following page shows, the number of hours of choking has fallen to very low levels since FY01, mainly due to the completion of the Deer Island plant. To minimize choking related to testing and maintenance, MWRA performs maintenance and testing at off-peak times so not to cause any backups in the system upstream of the headworks.

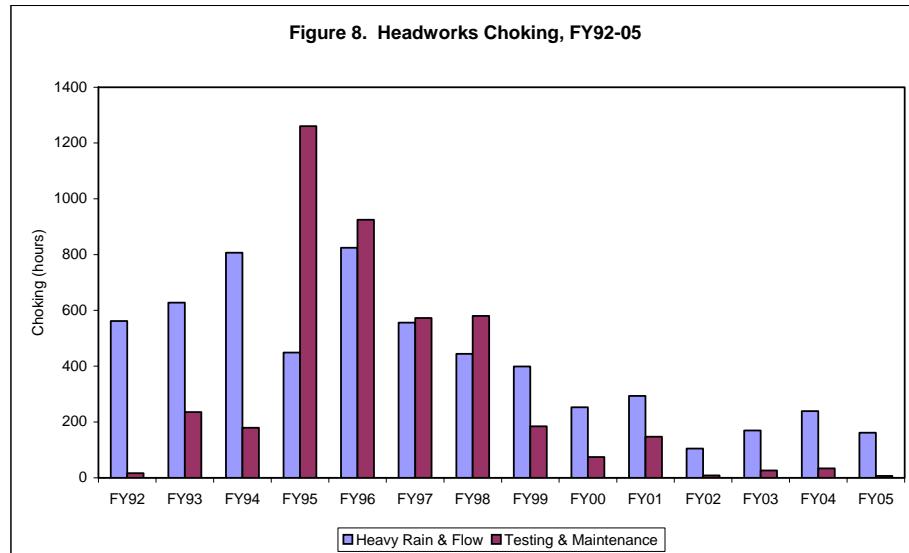

The MWRA also monitors the occurrence of Sanitary Sewer Overflows, or SSOs, associated with MWRA-owned sewer lines. These overflows occur in areas where the collection system becomes overloaded by heavy flows. In FY95, the MWRA's Transport Department started to locate and visually monitor these SSOs in the North and South Systems. Table 1 lists the SSOs observed by MWRA personnel in FY05.

Table 1. Sanitary Sewer Overflows, FY05	
Location	Number of Overflows
North System	
Pleasant Street, Watertown	1

Future Outlook

The startup of the new primary treatment plant at Deer Island in FY95 was just the first of several changes and improvements in the MWRA's facilities, including full secondary treatment, the Inter-Island Tunnel linking the South System to DITP, and the new outfall tunnel to Massachusetts Bay. The MWRA no longer discharges effluent into Boston Harbor and the Authority is currently monitoring the effects of these changes on water quality in the Harbor and Massachusetts Bay, as required by the NPDES permit issued in July 2000. In addition, a contingency plan ensures that the discharge does not adversely impact Massachusetts Bay.

Major upgrades are finished at the five CSO facilities, and construction of a sixth facility, Union Park, will be completed in early 2006. Several upgrades were also finished at the Quincy, Braintree-Weymouth, and Squantum pump stations in 2002, 2002, and 2003, respectively. Finally, the Intermediate Pump Station was brought on-line in 2004, increasing pumping capacity to DITP. This increased capacity should reduce sanitary sewer overflows to Smelt Brook. Taken as a whole, these upgrades have modernized MWRA facilities and reduced pollutants discharged to receiving waters.

I: Introduction

Overview

This report presents and summarizes the NPDES monitoring and compliance data compiled and analyzed by the MWRA Environmental Quality Department during the period of July 2004 to June 2005. MWRA's DITP and CSO facilities serve large communities' needs for sewer systems while maintaining healthy water environments for recreation and wildlife.

Chapter II presents and discusses the monitoring results for DITP, along with Contingency Plan and Ambient Monitoring Plan requirements. Chapter III describes the results for the five CSO facilities. Chapter IV discusses sludge processing operations at DITP and the MWRA's Fore River pelletizing facility. Chapter V discusses transport and sewer system capacity issues. Finally, Chapter VI covers an array of miscellaneous topics introduced by the new permit. Appendices A-F provide detailed monthly data for the Deer Island plants and for the five CSO facilities. Appendix G provides background information about MWRA's regulatory requirements, and Appendix H describes the MWRA sewer system and facilities. Appendix I defines the types of detection limits encountered in chemical analyses. Appendix J lists pollutants of concern. Finally, Appendix K is a glossary of the terms and phrases used throughout this report.


II: Deer Island Treatment Plant

Overview


This chapter presents and discusses monitoring information for DITP. The characteristics examined include flow, conventional parameters, nutrients, priority pollutants (metals, cyanide, pesticides/PCBs, and organic compounds), fecal coliform bacteria, and whole effluent toxicity. Since a number of limits in the Contingency Plan set forth by the new NPDES permit deal with effluent quality, this section finishes up with a description of the Contingency Plan and the closely related Ambient Monitoring Plan.

II.A.1 Influent Flow

The average flow to DITP in FY05 was 392 million gallons per day (mgd). Figure II.A.1 shows that flow generally rises and falls with the amount of precipitation. This occurs because several of the larger communities in the North System (Boston, Cambridge, Somerville, and Chelsea) have combined sewers.

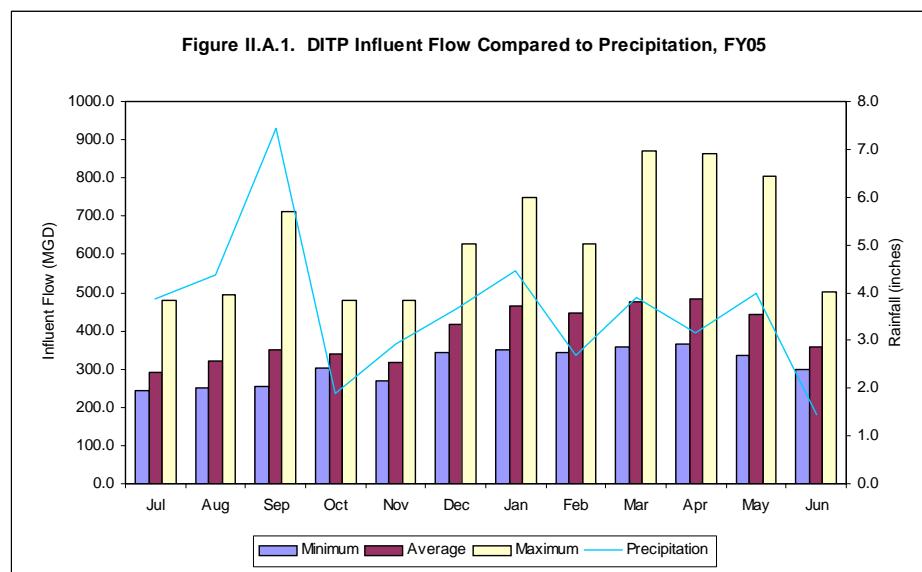

The impact of rainfall on flows can also be seen in Figure II.A.2 on the following page, which tracks average flow and precipitation over the past twelve fiscal years. The completion of the Inter-Island Tunnel from Nut Island to Deer Island in early FY99 resulted in increased flow to DITP, as DITP treated South System sewage previously treated at the Nut Island Treatment Plant. A slight increase in rain in FY05 (43.81 inches versus 42.04 inches in FY04) may have lead to the slightly higher average flows to DITP in the past fiscal year. Higher average flows may also be a result of continuing sewer separation projects and greater capture of combined sewer overflows. Both of these factors result in greater pumping to DITP.

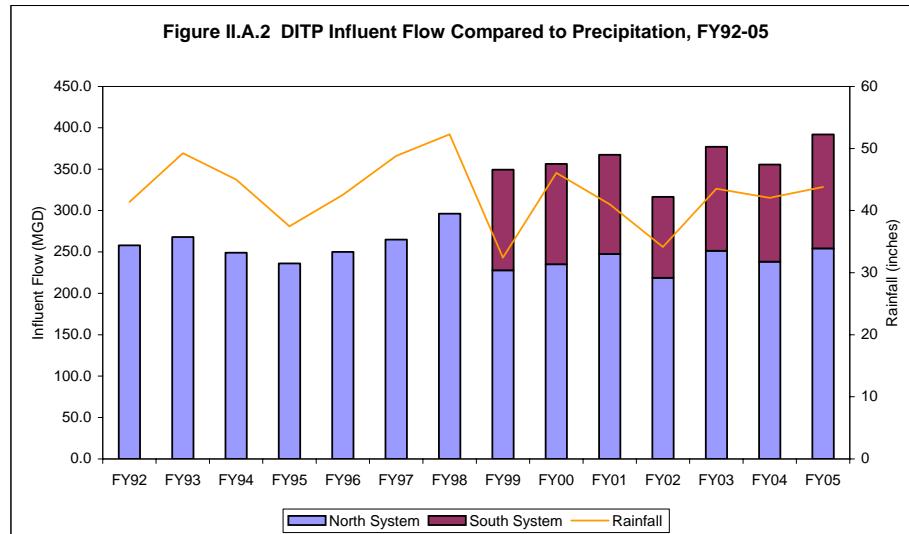

II.A.2 Influent Conventional Parameters and Nutrients

As Table II.A.1 indicates, Deer Island influent in FY05 can be classified as weak/medium.¹

Table II.A.1. Classification of DITP Influent, FY05				
Parameter	Value	Weak	Medium	Strong
TSS (mg/L)	237	100	200	350
TKN (mg/L)	31.6	20	40	85
Ammonia (mg/L)	19.6	12	25	50

A summary of Deer Island influent characteristics from FY94-FY05 is provided in Table II.A.2 on page 10. Note that cBOD only became a measured parameter with the debut of the new NPDES permit in August 2000, so no historical data is available previous to FY01.

¹Metcalf & Eddy, Inc. 1972. *Wastewater Engineering: Collection, Treatment, Disposal*. New York: McGraw-Hill Book Company, p. 231.

Table II.A.2. Deer Island Influent Characterization, FY94-FY05												
Parameter	FY94*	FY95*	FY96*	FY97*	FY98*	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Flow (mgd)												
Minimum	171	167	147	167	159	233	219	260	222.7	237.6	247	243
Average	249	236	250	265	296	350	356	367	316.6	378	356	392
Maximum	528	565	526	649	917	824	901	1136	773	897.4	1132	871
Total Suspended Solids (TSS)												
Min Conc (mg/L)	93	102	56	50	32	43	86	63	157	140	129	145
Avg Conc (mg/L)	137	138	140	144	141	160	167	176	200	188	234	237
Max Conc (mg/L)	175	160	432	284	382	564	379	336	255	230	281	329
Average Loading (tons/d)	98	96	86	100	94	234	248	269	264	296	347	387
Carbonaceous Biochemical Oxygen Demand (cBOD)												
Min Conc (mg/L)	**	**	**	**	**	**	**	29	93	80	75	86
Avg Conc (mg/L)	**	**	**	**	**	**	**	111	124	106	126	118
Max Conc (mg/L)	**	**	**	**	**	**	**	242	162	131	146	141
Average Loading (tons/d)	**	**	**	**	**	**	**	170	164	167	187	193
Settleable Solids												
Min Conc (mL/L)	1.9	3.5	0.1	1.5	0.1	0.1	0.7	0.3	4.5	4.7	3.6	5.3
Avg Conc (mL/L)	3.9	5.6	7.0	6.9	6.3	5.9	5.3	5.8	6.5	7.4	9.2	10.2
Max Conc (mL/L)	5.6	7.3	18.0	17.0	20.0	34.2	24.6	15.5	9.5	11.1	14.0	16.7
Average Loading (tons/d)	2.8	3.9	4.3	4.8	4.2	8.6	7.9	8.9	8.6	11.7	13.7	16.7
Total Kjeldahl Nitrogen												
Min Conc (mg/L)	11.2	14.0	11.6	8.7	13.6	14.6	13.2	16.3	26.0	23.3	18.7	21.7
Avg Conc (mg/L)	21.9	21.9	26.3	24.2	26.4	29.2	27.7	30.1	35.2	29.3	31.0	31.6
Max Conc (mg/L)	29.3	29.1	56.3	48.1	37.7	45.6	46.5	46.5	44.5	38.1	37.0	39.4
Average Loading (tons/d)	15.6	15.2	16.1	16.9	17.4	42.7	41.1	46.1	46.5	46.2	46.0	51.7
Ammonia-Nitrogen												
Min Conc (mg/L)	5.6	7.3	6.8	2.5	4.8	6.0	6.1	6.8	14.2	12.4	10.8	13.8
Avg Conc (mg/L)	12.3	13.7	15.0	13.3	14.5	16.6	16.3	17.8	20.5	17.0	19.0	19.6
Max Conc (mg/L)	17.9	18.0	24.0	18.6	23.1	30.8	25.0	24.2	28.6	23.7	22.7	25.7
Average Loading (tons/d)	8.8	9.6	9.2	9.2	9.6	24.2	24.2	27.2	27.1	26.8	28.2	32.0
Nitrates												
Min Conc (mg/L)	0.10	0.02	0.01	0.01	0.01	0.01	0.00	0.00	0.01	0.01	0.01	0.01
Avg Conc (mg/L)	0.80	0.15	0.14	0.22	0.36	0.06	0.13	0.17	0.05	0.10	0.13	0.16
Max Conc (mg/L)	2.70	0.59	1.42	2.31	1.95	1.21	1.56	1.53	0.26	0.37	0.81	0.7
Average Loading (tons/d)	0.57	0.10	0.09	0.15	0.24	0.09	0.19	0.26	0.07	0.16	0.19	0.26
Nitrates												
Min Conc (mg/L)	0.00	0.02	0.01	0.01	0.01	0.01	0.01	0.00	0.01	0.07	0.01	0.01
Avg Conc (mg/L)	0.10	0.06	0.07	0.09	0.08	0.05	0.14	0.15	0.11	0.22	0.13	0.23
Max Conc (mg/L)	0.20	0.19	1.66	0.35	0.46	0.45	0.72	0.47	0.35	0.55	0.41	0.62
Average Loading (tons/d)	0.07	0.04	0.04	0.07	0.05	0.07	0.21	0.23	0.15	0.35	0.19	0.38

* North System only. FY99 and later include South System data. ** Samples not collected.

II.A.3 Influent Priority Pollutants

The results of a complete priority pollutant scan of Deer Island influent can be found in Tables A-2 and A-3 of Appendix A. For levels below detection limits, one half of the method detection limit for inorganic compounds or one tenth of the quantitation limit for organic compounds was substituted to calculate concentrations and loadings. Appendix I provides a detailed discussion of detection and quantitation limits.

A pollutant is included whether it was detected just once or 37 times over the course of a year. Figures II.A.3 and II.A.4 below show annual averages of the daily loads; however, they do not truly reflect how often the pollutant was detected during the year. Therefore, if a below detection limit concentration is converted to a loading, it is recorded as a non-zero value, even though the constituent may not have been present in the sample. Note that these caveats apply to both metals and organics loadings. However, since metals are commonly detected in almost every sample, the notes raised above are less of an issue.

Figure II.A.3 compares FY05 average influent loadings for several key metals to historical values. The MWRA samples for these pollutants a few times a month. Using the measured concentration and the flow on the day on which

the sample was taken, daily loads can be calculated. Data from FY98 and earlier is from the North System only.

Before 1999, metals loadings in the North System decreased steadily, as MWRA made strides in toxic and corrosion control efforts involving both water supply and wastewater transport.

Since the South System flow was transferred from Nut Island to Deer Island at the start of FY99, the data after FY99 includes the South System flow. This larger, combined flow explains the increase in metals loadings from FY92-98 to FY99-05. Since loadings are calculated using flow, which in turn is affected by rainfall, loadings can rise and fall with rainfall amounts.

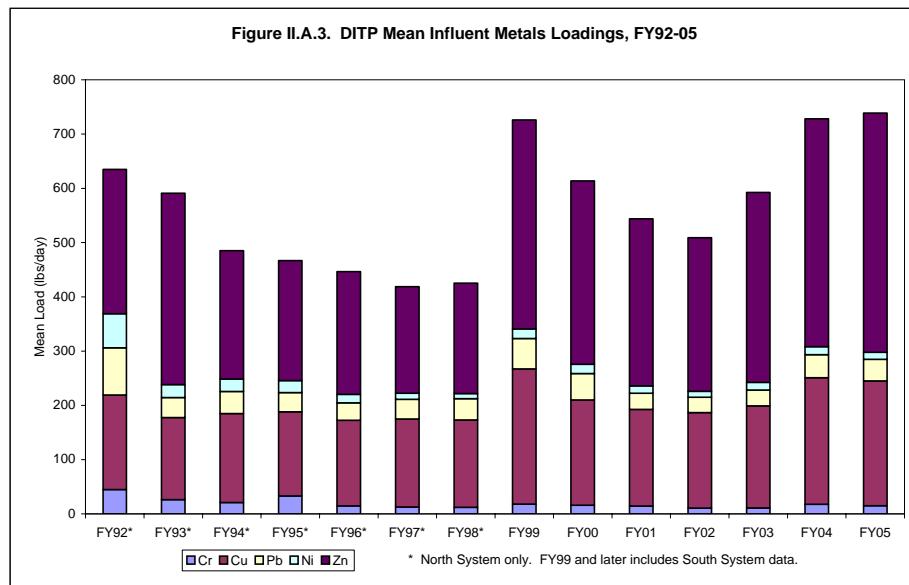


Figure II.A.4 on the following page compares influent loadings of certain representative organic priority pollutants to the loadings in previous years (see Appendix A, Table A-3). The opening of the Inter-Island Tunnel in FY99 had an identical effect on organics loadings at Deer Island as it did on metals loadings; they increased due to the added flow from the South System.

II.A.4 Effluent Conventional Parameters and Nutrients

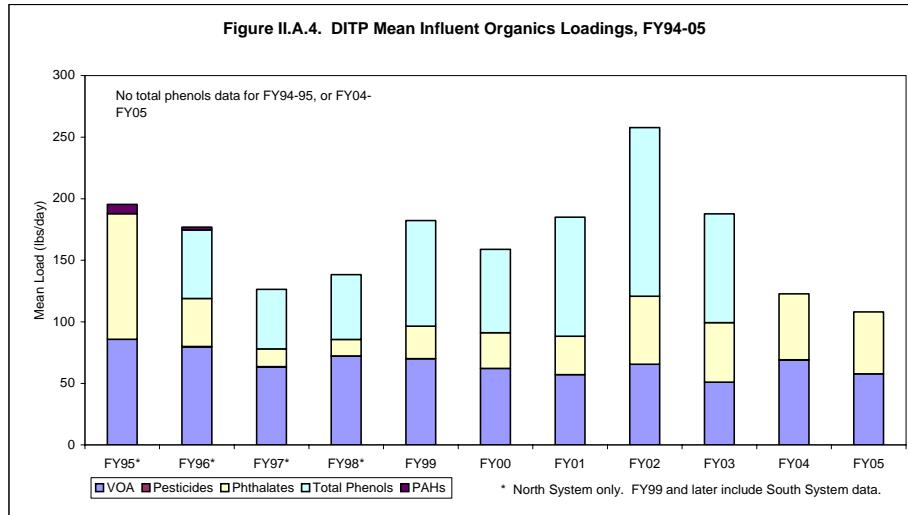


Table II.A.3 compares DITP's removal efficiencies for TSS and cBOD with theoretical removal efficiencies.² The removal efficiencies are determined from the average effluent and influent concentrations for TSS and cBOD as reported in Table A-1 of Appendix A.

Parameter	DITP % Removal*	Theoretical % Removal for Secondary Treatment	
		TSS	cBOD
TSS	94%	85%	
cBOD	92%	85%	

* Removal efficiencies were determined using the average influent and effluent concentration values as reported in Table A-1, Appendix A. Note that only a portion of the total flow each month went through secondary treatment. See Table II.A.4 for more information.

Table II.A.4, on the next page, shows how degree of secondary treatment can affect TSS and cBOD removal efficiencies. The table lists TSS and cBOD removal efficiencies and the percentage of flow that received secondary treatment on a monthly basis. The degree of secondary treatment is the average flow through secondary treatment (mgd) during the month divided by the average plant flow (mgd) for that month.

For the fiscal year, 89% of DITP flow went through secondary treatment and removal efficiency for TSS was 94%. For cBOD, the plant achieved 92% removal efficiency.

²Metcalf & Eddy, Inc. 1972. *Wastewater Engineering Collection, Treatment, Disposal*. New York. McGraw-Hill Book Company, p. 446.

Table II.A.4. Removal Efficiency vs. Degree of Secondary Treatment, FY04

	TSS Removal Efficiency	cBOD Removal Efficiency	% of Flow Treated at Secondary Levels
July	94%	92%	88.7%
August	94%	93%	90.6%
September	93%	92%	84.2%
October	94%	94%	91.2%
November	92%	92%	93.9%
December	94%	92%	87.5%
January	93%	89%	80.3%
February	92%	88%	83.2%
March	91%	88%	85.4%
April	96%	91%	89.0%
May	95%	93%	94.4%
June	96%	95%	99.4%
Average	94%	92%	89.0%

Table II.A.5 (next page) summarizes the conventional parameters and nutrients in Deer Island effluent over the past nine years. The significant drop in several parameters that occurred between FY95 and FY96 is due to the improved removal efficiency of the primary treatment plant. The implementation of secondary treatment in FY98 can explain the drop in TSS and BOD concentrations since FY97. Secondary treatment is also responsible for the increase in ammonia concentrations over the same period.


Parameter	FY94*	FY95*	FY96*	FY97*	FY98*	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Flow (mgd)												
Minimum	171	167	147	167	159	237	219	260	222	238	246	243
Average	249	236	250	265	296	350	356	367	317	377	356	392
Maximum	528	565	526	649	917	757	900	1136	773	898	1132	871
Total Suspended Solids (TSS)												
Min Conc (mg/L)	65	52	17	16	4	3	5	4	3	5	5	5
Avg Conc (mg/L)	73	65	44	41	25	22	18	15	16	18	17	15
Max Conc (mg/L)	86	90	136	100	140	69	62	47	43	132	78	62
Average Loading (tons/d)	52	45	27	29	17	14	26	24	21	28	25	25
Carbonaceous Biochemical Oxygen Demand (cBOD)												
Min Conc (mg/L)	**	**	**	**	**	**	**	4	3	3	3	2
Avg Conc (mg/L)	**	**	**	**	**	**	**	12	13	11	12	10
Max Conc (mg/L)	**	**	**	**	**	**	**	36	40	40	50	38
Average Loading (tons/d)	**	**	**	**	**	**	**	19	17	17	18	16
Settleable Solids												
Min Conc (mL/L)	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1
Avg Conc (mL/L)	0.5	0.4	0.2	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1
Max Conc (mL/L)	0.9	0.7	2.0	1.6	7.0	3.0	3.1	1.9	3.0	3.0	6.0	1.2
Average Loading (tons/d)	0.4	0.3	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.1	0.2
Total Kjeldahl Nitrogen												
Min Conc (mg/L)	12.8	13.7	10.6	10.9	9.1	11.2	8.2	12.2	15.1	9.7	11.0	6.6
Avg Conc (mg/L)	21.7	23.0	22.5	21.9	20.4	23.4	21.8	23.6	25.9	21.2	21.4	18.2
Max Conc (mg/L)	32.8	28.6	32.5	27.6	32.4	34.3	32.4	33.3	35.0	32.3	33.3	30.9
Average Loading (tons/d)	22.5	22.6	23.4	24.3	25.2	34.2	32.4	36.1	34.2	33.3	31.8	29.8
Ammonia-Nitrogen												
Min Conc (mg/L)	6.1	7.3	5.6	4.4	3.5	5.4	5.0	5.1	9.4	7.0	7.5	4.5
Avg Conc (mg/L)	12.6	14.4	14.5	13.1	15.1	18.0	17.6	17.6	21.2	17.5	18.6	16.6
Max Conc (mg/L)	18.5	19.6	21.9	18.0	22.7	26.4	25.2	24.9	32.0	28.0	28.0	28.7
Average Loading (tons/d)	9.0	10.0	8.9	9.1	10.0	11.9	26.2	27.0	28.0	27.5	27.6	27.1
Nitrates												
Min Conc (mg/L)	0.13	0.03	0.01	0.01	0.01	0.01	0.00	0.0	0.01	0.01	0.01	0.01
Avg Conc (mg/L)	1.04	0.08	0.30	0.34	0.42	0.22	0.69	0.7	0.89	1.50	1.93	2.24
Max Conc (mg/L)	5.98	0.28	1.95	2.58	1.49	1.93	2.96	4.2	2.86	5.07	3.88	5.77
Average Loading (tons/d)	0.74	0.06	0.18	0.23	0.28	0.15	1.03	1.1	1.2	2.4	2.9	3.7
Nitrites												
Min Conc (mg/L)	0.01	0.02	0.01	0.01	0.01	0.01	0.04	0.0	0.01	0.01	0.01	0.03
Avg Conc (mg/L)	0.10	0.08	0.63	0.11	0.20	0.30	0.95	0.2	0.34	0.28	0.21	0.54
Max Conc (mg/L)	0.26	0.22	1.90	0.62	1.15	1.99	3.06	1.1	1.26	0.91	0.69	0.71
Average Loading (tons/d)	0.07	0.06	0.39	0.08	0.13	0.20	1.41	0.3	0.4	0.4	0.3	0.9

* North System only. FY99 and later include South System data. ** Samples not collected.


A summary of nutrient concentrations in Deer Island effluent from FY94-FY05 is provided in Figure II.A.5 on the following page. The introduction of the new primary treatment plant in FY95 did not affect nutrient concentrations, as primary treatment has no effect on nutrients.


However, the activated sludge process used in DITP's secondary treatment does change nutrient concentrations. The activated sludge process uses bacteria to promote efficient and rapid breakdown of wastes. This bacterial breakdown results in changes in the proportions of nitrogen species. For example, total Kjeldahl nitrogen (TKN) consists of NH₃-N plus organic nitrogen. Effluent NH₃-N concentrations have risen while total Kjeldahl nitrogen (TKN) concentrations have remained relatively stable. Therefore, the proportion of NH₃-N as a TKN component has increased. Elevated levels of NH₃-N are characteristic of the activated sludge process.

II.A.5 Effluent Priority Pollutants

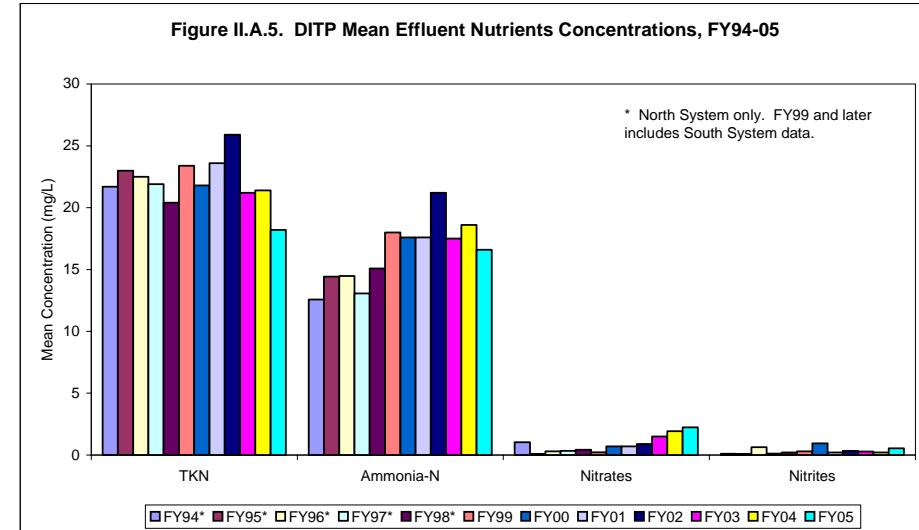

Appendix A, Tables A-8 and A-9 provide a summary of priority pollutant concentrations and loadings in DITP effluent for FY05. For a discussion of the importance of detection limits in loading calculations, see Section II.A.3 and Appendix I. Metals loadings over the past fifteen years are summarized in Figure II.A.6, while Figure II.A.7 on page 16 graphs organic pollutants from FY94-FY05. Two factors may explain the long-term decrease in loadings. First, the MWRA has instituted a more aggressive industrial pre-treatment program coupled with stricter enforcement of local limits. Second, the decrease may also be attributed to better capture of metals and organics at the plant.

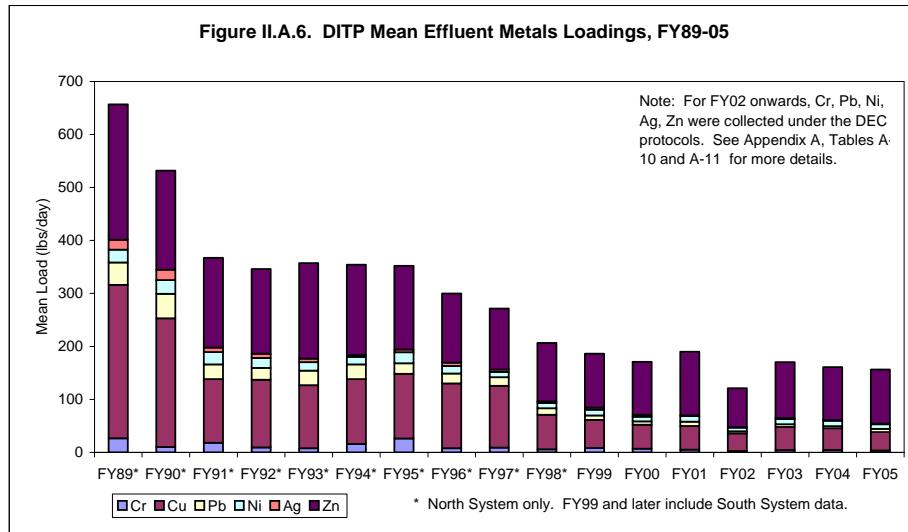

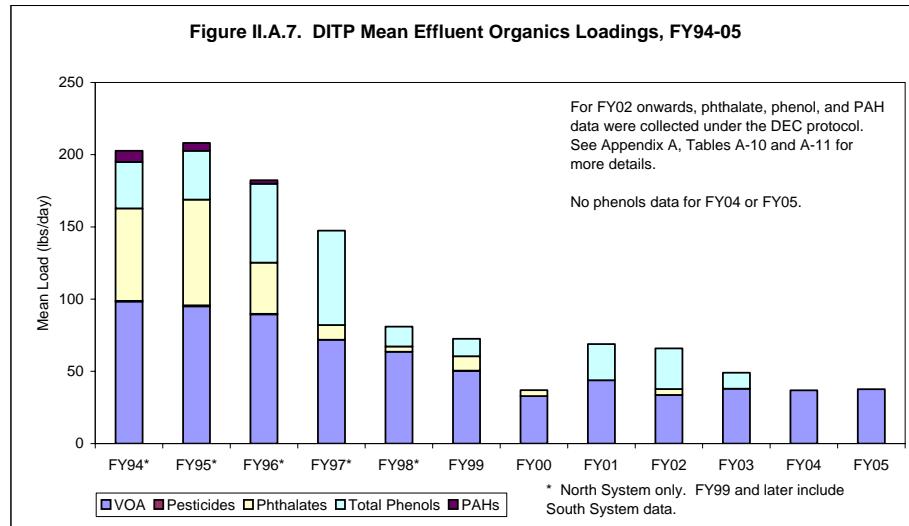

II.A.6 Whole Effluent Toxicity

The MWRA tests effluent toxicity every month at DITP. Effluent toxicity provides an overall view of effluent quality, ensuring that the effluent does not adversely affect the environment. In 1989, the EPA found that surfactants were the probable cause of most acute toxicity in DITP's effluent. Surfactants are most commonly used in household detergents to improve cleansing power. No acute toxicity could be attributed to metals or pesticides.

The MWRA permit requires four tests for effluent toxicity testing. 48-hr acute static toxicity tests using the mysid shrimp (*Americanamysis bahia*) and the silversides fish (*Menidia beryllina*) measure the short-term lethal effects caused by the effluent. A chronic survival and growth test using *Menidia* and a chronic fertilization test using the sea urchin (*Arbacia punctulata*) both measure subtle toxic impacts over a longer period of time. The results of these tests for FY05 can be found in Table II.A.6 on the following page.

The LC₅₀ (Lethal Concentration 50%) is the concentration of effluent in a sample that causes mortality to 50% of the test population during the duration of the test. The two acute tests use LC₅₀.

The NOEC (No Observed Effect Concentration) used in the chronic tests is the concentration of effluent in a sample to which organisms are exposed in a life cycle or partial life cycle test that has no adverse effects. An NOEC limit of 1.5% means that 1.5% of the sample is effluent, and the remainder dilution water. Any acute LC₅₀ below 50% or chronic NOEC below 1.5% would violate the NPDES limit.

	Mysid acute LC50	Menidia acute LC50	Arbacia chronic NOEC	Menidia chronic NOEC
Limits (%)	50	50	1.5	1.5
July	> 100	59.2	50	25
August	93	77.6	100	50
September	> 100	> 100	50	50
October	> 100	> 100	100	50
November	> 100	76	25	25
December	> 100	> 100	*	50
January	> 100	> 100	*	6.25
February	> 100	> 100	100	100
March	> 100	95.6	50	25
April	> 100	> 100	100	100
May	> 100	> 100	100	50
June	> 100	66	100	50
# of Violations	0	0	0	0

Results in **bold** indicate a violation of the regulatory limits. * indicates an invalid test.

II.B.1 Compliance with Regulatory Limits

Plant performance at Deer Island is compared to permit limits in Table II.B.1 and Figures II.B.1 through II.B.9 on the following pages. There were no permit violations in FY05.

Parameter	Permit Limits	Range of Values Exceeding Limits	Number of Violations
Carbonaceous Biochemical Oxygen Demand (mg/L)			
Monthly Avg	25	n/a	0
Weekly Avg	40	n/a	0
Total Suspended Solids (mg/L)			
Monthly Avg	30	n/a	0
Weekly Avg	45	n/a	0
Total Chlorine Residual (ug/L)			
Monthly Avg	456	n/a	0
Daily Maximum	631	n/a	0
Fecal Coliform			
Daily Geometric Mean (col/100mL)	14,000	n/a	0
% of Samples > 14000	10	n/a	0
Consecutive Samples > 14000	3	n/a	0
pH (SU)	6.0-9.0	n/a	0
PCB, Aroclors (ug/L)	0.000045	n/a	0
Acute Toxicity			
Mysid Shrimp (%)	>=50	n/a	0
Inland Silverside (%)	>=50	n/a	0
Chronic Toxicity			
Inland Silverside (%)	>=1.5	n/a	0
Sea Urchin (%)	>=1.5	n/a	0
Dry Day Flow (MGD)	436	n/a	0
Total Number of Violations			0

Table II.B.2 compares the number of NPDES violations in FY05 to previous years.

Table II.B.2. NPDES Violations at Deer Island, FY94-FY05												
	FY94	FY95	FY96	FY97	FY98	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Dry Day Flow	*	*	*	*	*	*	*	0	0	0	0	0
BOD	16	12	7	0	1	0	0	*	*	*	*	*
cBOD	*	*	*	*	*	*	*	0	0	0	0	0
TSS	1	1	0	0	0	0	0	0	0	3	0	0
TCR	*	*	*	*	*	*	*	1	0	0	0	0
Settleable Solids	0	0	0	0	0	0	0	*	*	*	*	*
Fecal Coliform	0	0	0	0	0	0	0	0	1	0	1	0
Total Coliform	0	1	0	0	0	0	0	*	*	*	*	*
pH	1	1	0	0	0	0	0	1	0	0	0	0
PHCs	1	4	5	0	0	0	0	*	*	*	*	*
Toxicity	11	17	19	16	11	13	14	3	0	0	0	0
Non-Toxicity Violations	19	19	12	0	1	0	0	2	1	3	1	0
Total Violations	30	36	31	16	12	13	14	5	1	3	1	0

* Not a permit limit at that particular time

The following pages track trends in effluent over FY05. All of the effluent parameters were well under permit limits.

For carbonaceous biochemical oxygen demand (cBOD) and total suspended solids (TSS), the permit limits monthly and weekly average concentrations. Figures II.B.1 shows that the monthly averages for cBOD never exceeded the regulatory discharge limit of 25 mg/L, and are well below the 5-year historical average.


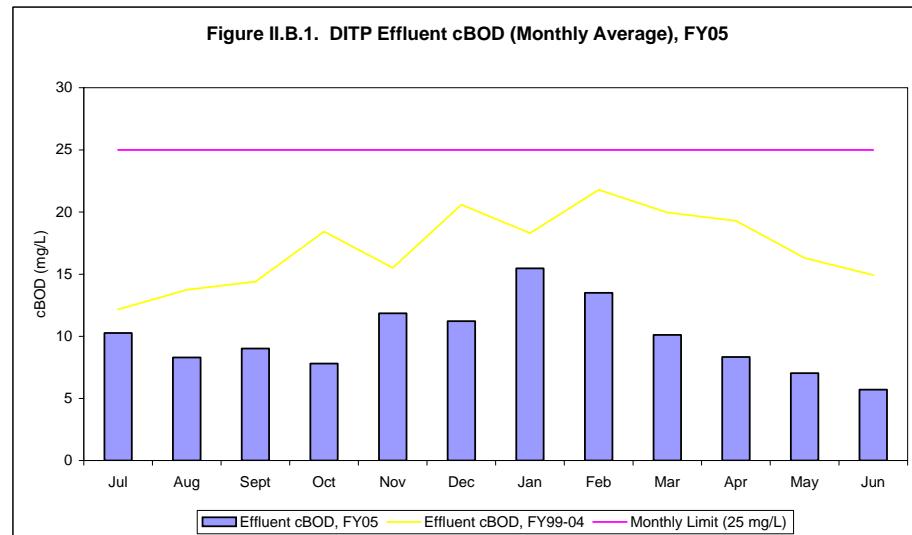


Figure II.B.2 shows there were no violations of the cBOD weekly limit (40 mg/L).

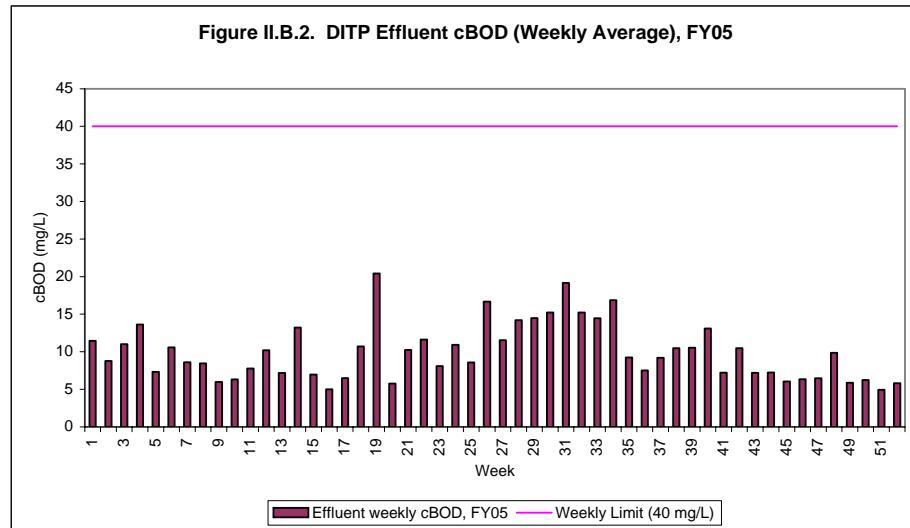

Figures II.B.3 shows FY05 monthly averages for TSS never exceeded the regulatory discharge limit of 30 mg/L. For the majority of the year, effluent TSS was also below the 5-year historical average.



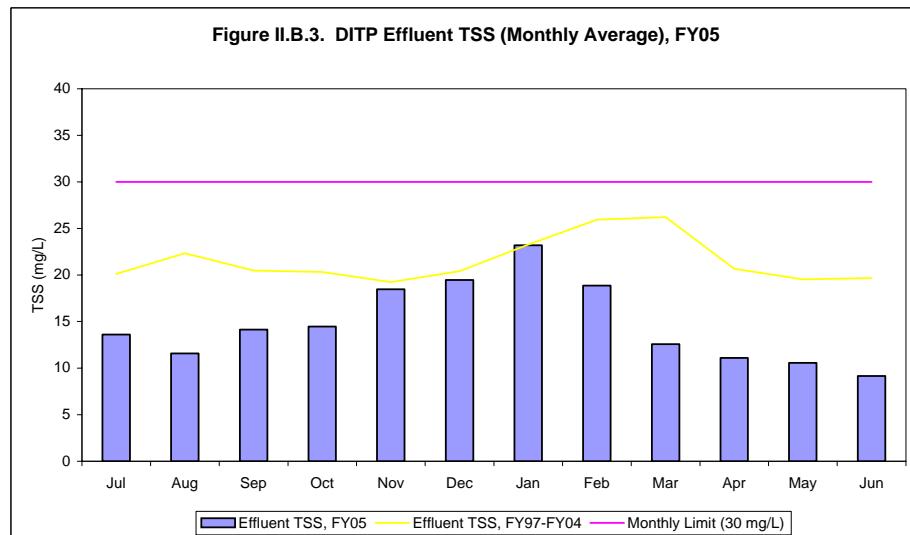


Figure II.B.4 graphs the weekly averages for effluent TSS in FY05. The regulatory limit for weekly TSS averages is 45 mg/L. In FY05 this limit was not approached.

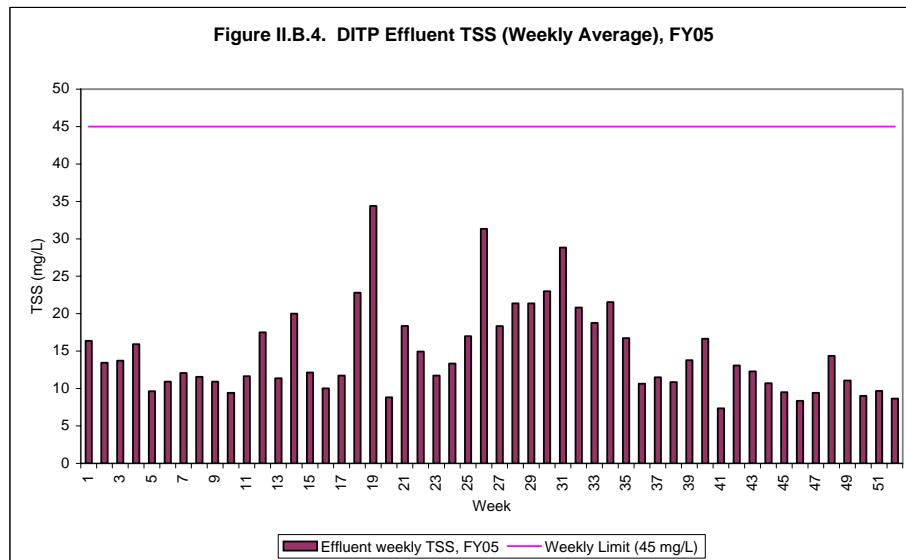


Fecal coliform has a daily discharge limit of 14,000 colonies/100mL, as calculated by the daily geometric mean of three samples per day. Figure II.B.5 shows the daily effluent trends of fecal coliform in FY05. Note that 5 colonies/100mL is the detection limit for the fecal coliform test so there will not be results below that number.

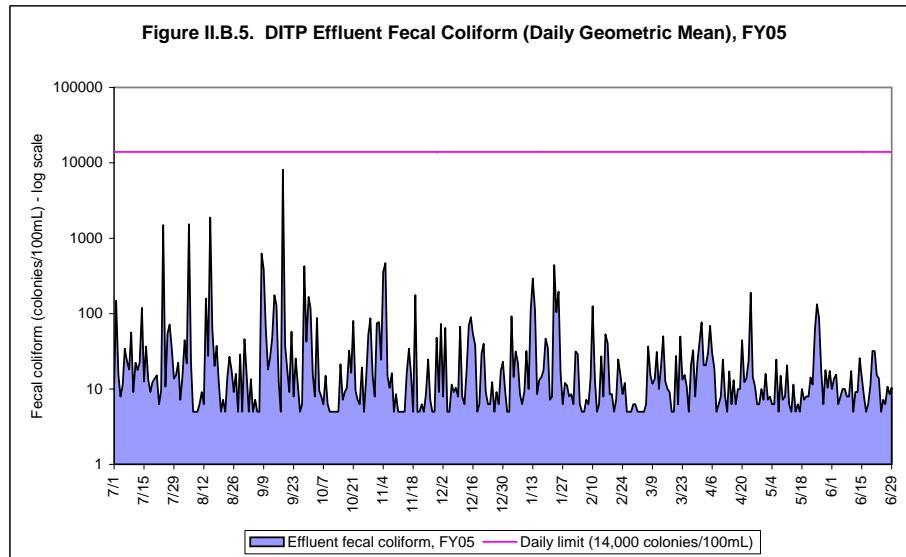


Additional limits for fecal coliform include: not more than three consecutive samples measuring over 14,000 colonies/100mL, and no more than 10% of the samples in a month measuring over 14,000 colonies/100 mL. These latter two



limits were not approached. Figure II.B.6 shows the percentage of high sample counts ($>14,000$ colonies/100mL) by month – there were no violations of this limit either.

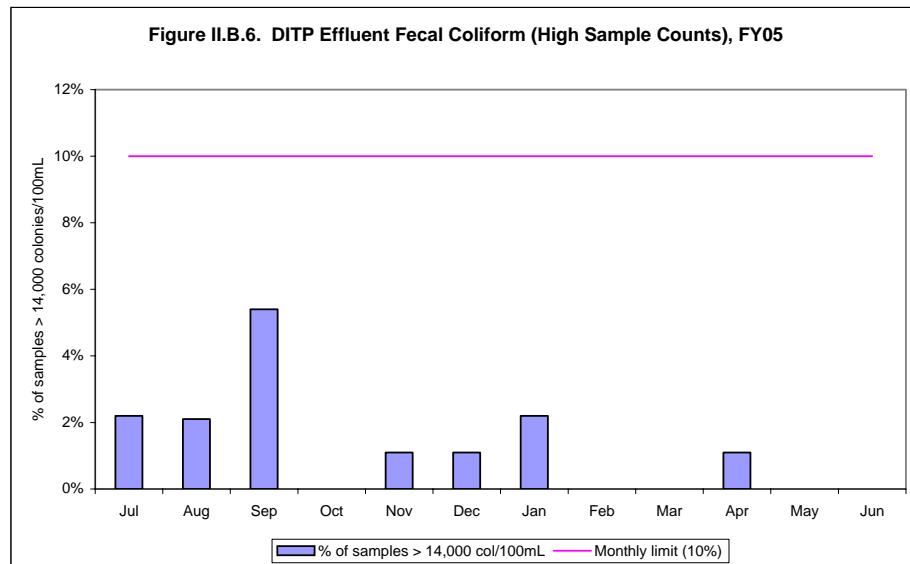

The limits for pH are based on the maximum and minimum values for each month, with pH required to fall between 6.0 and 9.0. In FY05, the pH of the effluent was always below the maximum of 9.0 and above the minimum of 6.0. Figure II.B.7 shows the monthly minimums and maximums throughout FY05.

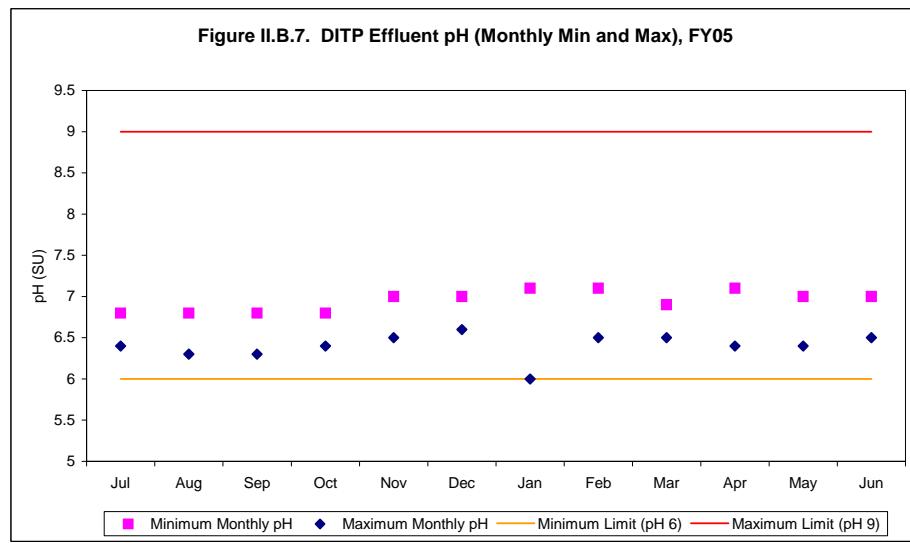

The permit regulates total chlorine residual through two limits: a monthly average of 456 µg/L and a daily maximum of 631 µg/L. Figure II.B.8 shows monthly average chlorine residual results versus the regulatory limit. The following figure, II.B.9, shows the daily results against the permit limit. Neither limit was violated, or even approached, in FY05.

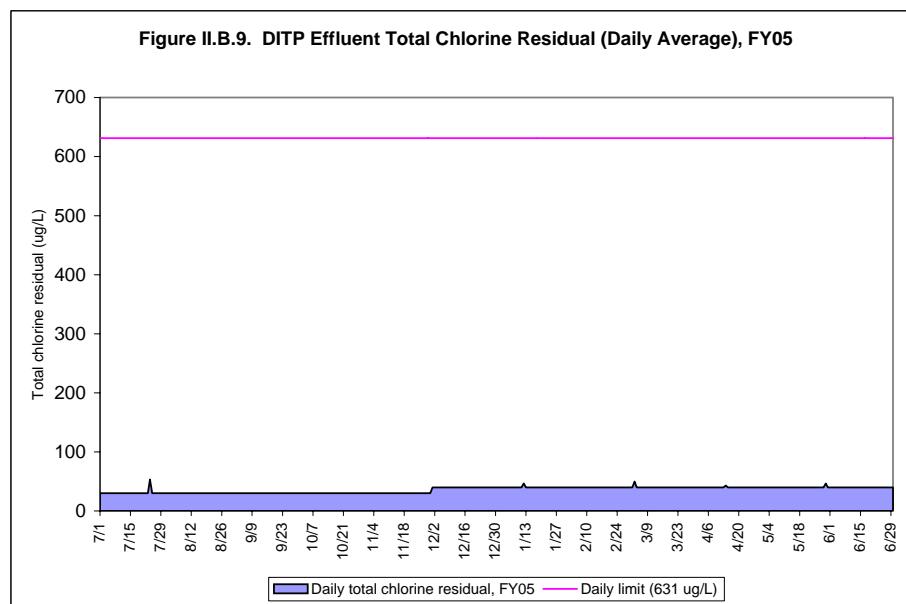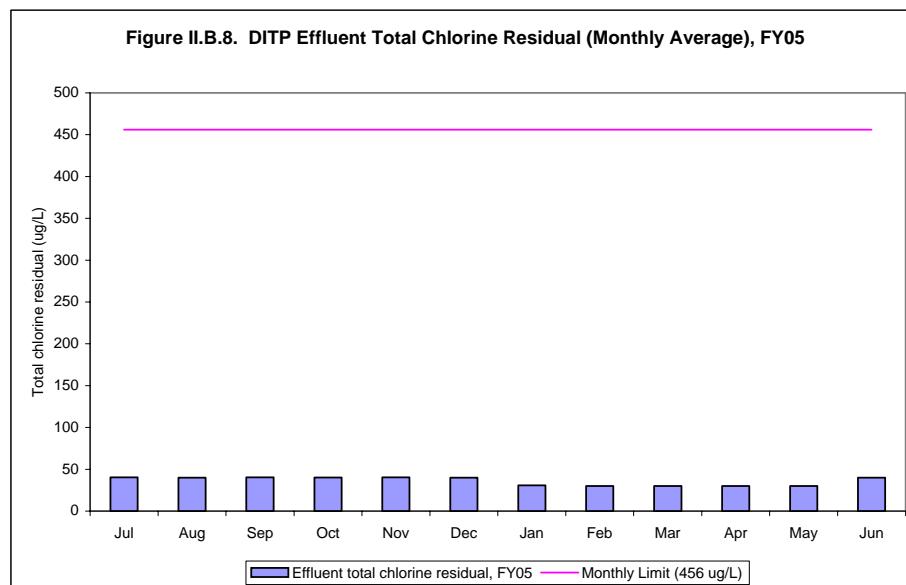

In addition to the limits mentioned above, the permit sets forth two more effluent limits. Arochlors 1016, 1221, 1232, 1242, 1248, 1254, and 1260 have a 0.000045 µg/L limit. However, none of these compounds were detected in FY05. The limit on dry day flow was covered in the Executive Summary (Fig. 2).

MWRA must also report a number of other effluent components, such as metals and nutrients, although they have no discharge limit. These are listed in Appendix G, Table G-1.

II.B.2 Effluent Quality Compared to Water Quality Standards

Table II.B.3 compares concentrations of priority pollutants in DITP effluent to water quality criteria, both acute and chronic. Even before the dilution provided by the outfall, all the pollutants except for copper were below both the acute and chronic criteria.

Table II.B.3. Comparison of DITP Effluent with Water Quality Criteria, FY05						
Acute	FY05 Effluent Maximum (ug/L)	Dilution†	Concentration at ZID (ug/L)‡	Acute Dissolved Criteria (ug/L)*	Acute Recoverable Criteria (ug/L)**	Times Detected
Arsenic	1.00	50	0.020	69.0	69.0	1 of 24
Copper	37.60	50	0.752	4.8	5.8	113 of 166
Lead	1.75	50	0.035	210.0	220.8	12 of 12
Mercury	0.06	50	0.001	1.8	2.1	89 of 109
Nickel	6.29	50	0.126	74.0	74.7	97 of 98
Silver	1.95	50	0.039	1.9	2.2	96 of 97
Zinc	69.30	50	1.386	90.0	95.1	69 of 69
Chronic	FY05 Effluent Average (ug/L)	Dilution†	Concentration at ZID (ug/L)‡	Chronic Dissolved Criteria (ug/L)*	Chronic Recoverable Criteria (ug/L)**	Times Detected
	0.43	70	0.006	36.0	36.0	1 of 24
Arsenic	10.50	70	0.150	3.1	3.7	113 of 166
Copper	4.20	70	0.060	8.1	8.5	12 of 12
Lead	0.02	70	0.0003	0.9	1.1	89 of 109
Mercury	2.70	70	0.039	8.2	8.3	97 of 98
Zinc	30.70	70	0.439	81.0	85.6	69 of 69

No conversion factor or chronic criteria exist for silver.

† Permit estimate from Attachment S.

‡ ZID is Zone of Initial Dilution, the area directly around the outfall.

* National Recommended Water Quality Criteria for Priority Toxic Pollutants, Federal Register, 12/10/98.

** Calculated using the conversion factors in Appendix A of the Federal Register, 12/10/98.

II.C.1 Ambient Monitoring Plan

The new permit requires ambient monitoring of the Harbor and Massachusetts Bay. The ambient monitoring plan has three main components: the Harbor and Bay monitoring plan; the maintenance of the Bays Eutrophication Model; and the implementation of plume tracking. Table II.C.1 summarizes the first and third components of the monitoring plan. Note that the plume tracking component of the plan is now completed and results are available from ENQUAD.

The Bays Eutrophication Model is a three-dimensional hydrographic model that is run annually to provide information on whether new limits are needed on the effluent discharge. The Model is designed primarily to examine nutrient inputs.

In March 2004, the MWRA issued Revision 1 of the ambient monitoring plan, which made minor changes to the original plan. Highlights included reducing the number of nearfield and benthic monitoring stations, reducing the number of nearfield surveys, as well as exploring the possibility of real-time monitoring using permanent moorings.

Table II.C.1. Post-Discharge Ambient Monitoring Plan Summary			
Task	Objective	Sampling Protocol	Analyses
Effluent sampling	Characterize wastewater discharge from Deer Island Treatment Plant	3x/daily Daily Weekly Several times monthly	Nutrients Solids and organic material Toxic contaminants Bacterial indicators Chlorine
Water Column			
Nearfield surveys	Collect water quality data near outfall location	12 surveys/year 7 stations	Temperature Salinity
Farfield surveys	Collect water quality data throughout Massachusetts and Cape Cod bays (Not all analyses are performed at every near- or farfield station)	6 surveys/year 25 stations	Dissolved oxygen Nutrients Solids Chlorophyll Water clarity Photosynthesis Respiration Plankton Marine mammal observations
Plume-track surveys	Track discharge plume, measure discharge dilution	Completed	Completed
Mooring (USGS and GoMOOS)	Provides continuous oceanographic data near outfall location and Cape Ann	Continuous monitoring USGS near outfall GoMOOS near Cape Ann	Temperature Salinity Water clarity Chlorophyll
Remote sensing	Provides oceanographic data on a regional scale through satellite imagery	Available daily (cloud-cover permitting)	Surface temperature Chlorophyll
Sea Floor			
Soft-bottom studies	Evaluate sediment quality and benthos in Boston Harbor and Massachusetts Bay	1 survey/year 23 nearfield stations 8 farfield stations	Sediment chemistry Sediment profile imagery Community composition
Hard-bottom studies	Characterize marine benthic communities in rock and cobble areas	1 survey/year 23 stations	Topography Substrate Community composition
Fish and Shellfish			
Winter flounder	Determine contaminant body burden and population health	1 survey/year 4 stations	Tissue contaminant concentrations Physical abnormalities Liver histopathology
American lobster	Determine contaminant body burden	1 survey/year 3 stations	Tissue contaminant concentrations Physical abnormalities
Blue mussel	Evaluate biological condition and potential contaminant bioaccumulation	1 survey/year 3 stations	Tissue contaminant concentrations

Adapted from Werme, C. 2003. 2002 Outfall Monitoring Overview. ENQUAD report 2003-12.

Updated from MWRA. 2004. MWRA Effluent Outfall Ambient Monitoring Plan, rev. 1, 3/04. ENQUAD report ms-092.

The Outfall Monitoring Science Advisory panel (OMSAP), a panel of scientific experts convened by the EPA and MA DEP, oversees the monitoring plan and examines scientific data produced by the MWRA and MWRA consultants. OMSAP also serves as a peer review board for technical reports, and advises EPA and MA DEP on the implications of monitoring observations. Finally, OMSAP evaluates any exceedances under the Contingency Plan, described in the next section.

Much more information on the ambient monitoring plan is available on the Internet. Documents directly associated with the permit, including Revision 1 of the ambient monitoring plan, can be found at:

<http://www.mwra.state.ma.us/harbor/html/ambient.htm>

Associated information and synthesis reports generated by ambient monitoring results can be found at:

Boston Harbor: <http://www.mwra.state.ma.us/harbor/html/wklyintr.htm>

Massachusetts Bay: <http://www.mwra.state.ma.us/harbor/html/mbmon.htm>

The OMSAP web page, including announcements for public meetings, is at:
<http://www.epa.gov/region1/omsap/index.html>

II.C.2 The Contingency Plan

The permit requires a contingency plan that defines a response plan when a parameter threshold is exceeded. Responses may include changes in laboratory procedures, changes in treatment plant process, or, in a worse case scenario, examining the feasibility of re-opening the Deer Island harbor outfalls. Tables II.C.2.a-c show the thresholds for the parameters. The effluent and toxicity thresholds are set to be equal to the NPDES permit limits. However, the Contingency Plan includes a number of new thresholds related to parameters monitored under the Ambient Monitoring Plan in Massachusetts Bay.

Table II.C.2.a. Contingency Plan Thresholds: Toxic Contaminants		
Parameter	Caution Level	Warning Level
Effluent chlorine	-	456 ug/L average monthly 631 ug/L maximum daily
Effluent PCBs	0.000045 ug/L monthly limit (as Arochlors)	-
Effluent toxicity	-	Acute: effluent LC50 < 50% for shrimp and fish Chronic: effluent NOEC for fish growth and sea urchin fertilization < 1.5%
Water column initial dilution of effluent	-	Effluent dilution predicted by EPA as basis for NPDES permit
Nearfield sediment toxics	-	NOAA Effects Range Median sediment guideline
Nearfield sediment toxics	90% EPA sediment criteria	EPA sediment criteria
Fish tissue mercury, near outfall	0.5 ug/g wet	0.8 ug/g wet
Fish tissue PCB, near outfall	1 ug/g wet	1.6 ug/g wet
Mussel tissue lead, near outfall	2 ug/g wet	3 ug/g wet
Fish tissue lipid-normalized toxics, near outfall	2 x baseline	-
Flounder liver disease incidence	Greater than harbor prevalence over time	-

Table II.C.2.b. Contingency Plan Thresholds: Nutrients		
Parameter	Caution Level	Warning Level
Effluent total nitrogen	12,500 mtons/year	14,000 mtons/year
Dissolved oxygen concentration, nearfield water column bottom, Stellwagen bottom	6.5 mg/L for any survey during stratification (June-Oct.) unless background conditions are lower	6 mg/L for any survey during stratification (June-Oct.) unless background conditions are lower
Dissolved oxygen percent saturation, nearfield water column bottom, Stellwagen bottom	80% saturation for any survey during stratification (June-Oct.) unless background conditions are lower	75% saturation for any survey during stratification (June-Oct.) unless background conditions are lower
Oxygen depletion rate, nearfield water column bottom	1.5 x baseline	2 x baseline
Nearfield water column chlorophyll	1.5 x baseline annual mean	2 x baseline annual mean
Nearfield water column chlorophyll	95th percentile of the baseline seasonal distribution	-
Nearfield water column nuisance algae (except <i>Alexandrium</i>)	95th percentile of the baseline seasonal mean	-
Nearfield water column zooplankton (1)	-	-
Nearfield water column <i>Alexandrium tamarensis</i>	100 cells/L	-
Farfield water column PSP extent (2)	New incidence	-
Redox potential discontinuity, nearfield sediments	0.5 x baseline	-

(1) The MWRA will report annually on appreciable changes to the zooplankton community in its Annual Water Column Report and in the Outfall Monitoring Overview. The MWRA also makes every effort to participate in workshops to investigate food web pathways in Massachusetts and Cape Cod bays sponsored by NOAA Fisheries.

(2) The MWRA is continuing to work on improvements to the calculation of this threshold as proposed in its October 13, 2000 letter to the EPA and MADEP.

Table II.C.2.c. Contingency Plan Thresholds: Other Parameters		
Parameter	Caution Level	Warning Level
Effluent cBOD	-	40 mg/L weekly 25 mg/L monthly
Effluent fecal coliform	-	14,000 fecal coliforms/100 ml
Effluent TSS	-	45 mg/L weekly 30 mg/L monthly
Nearfield benthic diversity	Appreciable change	-
Nearfield benthic opportunists	10%	25%
Effluent floatables (4)	-	-
Effluent oil and grease (petroleum)	-	15 mg/L weekly
Plant performance	5 violations/year	Noncompliance 5% of the time pH <6 or >9 at any time Flow >436 MGD for an annual average dry day

(3) Threshold currently under development by MWRA.

Adapted from MWRA. 2001. *Contingency Plan*, Revision 1, May 2001. MWRA Report ENQUAD ms-071.

Under the Contingency Plan, two types of thresholds exist: a caution level and a warning level. Figure II.C.1 on the following page details the processes required by the Contingency Plan in case of a threshold exceedance. Table II.C.3 below details the Contingency Plan exceedances in FY05. For more information on these exceedances, please refer to the web site listed below.

Table II.C.3. Contingency Plan Exceedances, FY05		
Date*	Threshold Level Exceeded	Threshold Exceeded
July 23, 2004	Caution (Ambient)	Abundance of <i>Phaeocystis</i> was over the threshold for both the winter/spring and summer seasons.
May 20, 2005	Caution (Ambient)	Levels of <i>Alexandrium</i> were over the threshold in the outfall nearfield.


* Notification date; typically within 5 days of knowing of the violation.

In addition to the thresholds, the Contingency Plan also requires several other unrelated items. First, the MWRA must update annually a technical survey regarding tertiary treatment systems designed to remove nutrients. Second, the Authority must maintain a nitrogen monitoring program at DITP to examine the need for tertiary treatment. Both of these efforts are ongoing. Third, there must be a “dry run” of a Contingency Plan violation to assess the validity of the Contingency Plan structure. Fourth, \$81 million must be held in reserve for emergency use. Finally, the old Boston Harbor outfalls must be maintained in case diversion of the effluent back to the Harbor is deemed necessary. These last three options have been successfully completed.

More information on Contingency Plan topics is on the Internet at:
<http://www.mwra.state.ma.us/harbor/html/contingency.htm>

Exceedance reports are posted at:
<http://www.mwra.state.ma.us/harbor/html/exceed.htm>

Figure II.C.1 Contingency Plan Flowchart

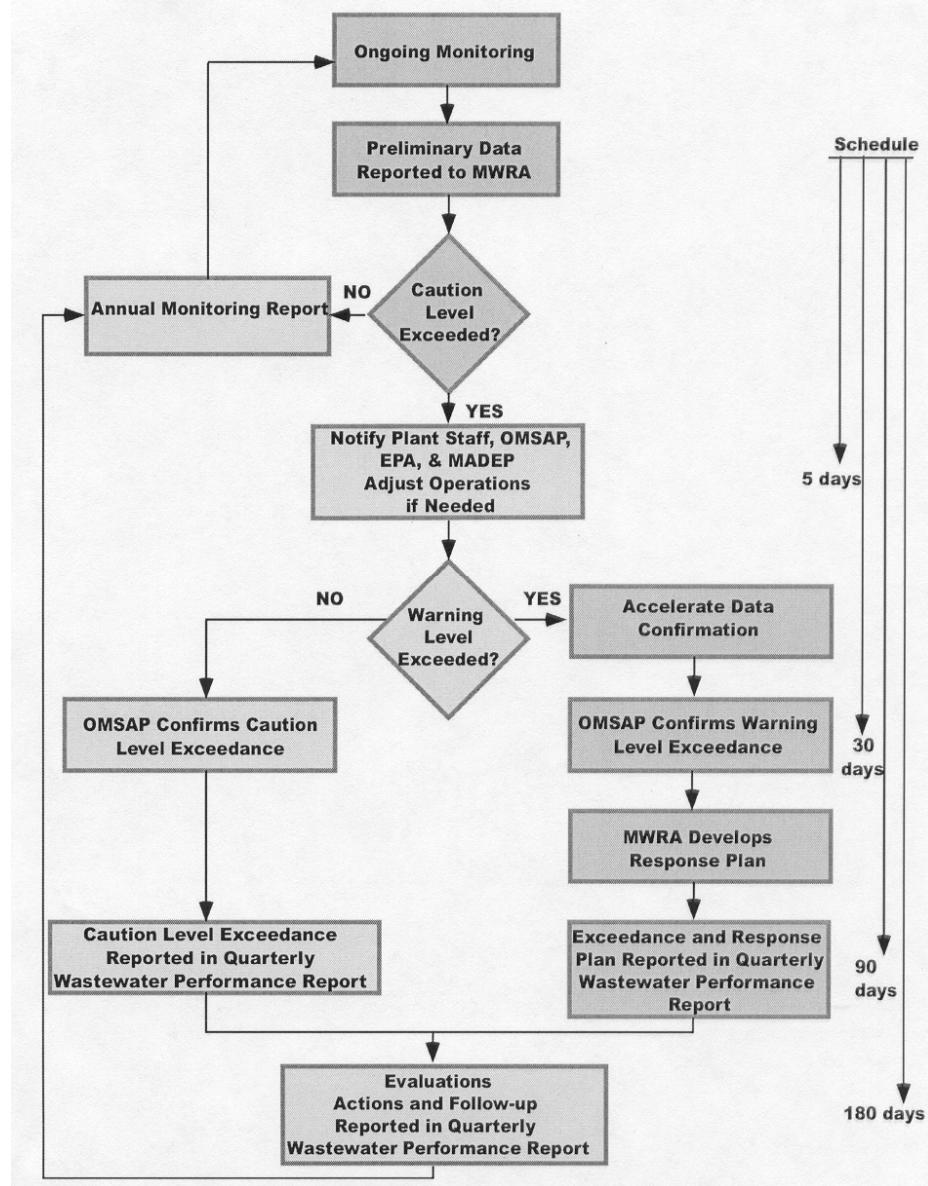

III: Combined Sewer Overflows

Overview

MWRA monitors five CSO facilities in the North System. There are no CSO facilities in the South System. The monitoring results vary significantly between facilities because of differences in type and location. Location is especially important since storms can be highly localized, affecting the level and intensity of rainfall at the CSO facility and the area that the facility serves. Improvements to the transport system (such as sewer separation projects) and the CSO facilities themselves have improved the capture of combined sewage. This has resulted in having fewer activations but a greater discharge volume.

Each CSO facility screens, chlorinates, and dechlorinates combined wastewater (sewage and storm water) prior to discharge. The Cottage Farm and Prison Point facilities also have pumping and tank storage capacity. Pumping and tank storage allows screened and chlorinated wastewater to be held at these facilities up to their storage capacities prior to discharge. Stored wastewater can eventually be pumped back into the system and processed at Deer Island. Any wastewater exceeding the storage capacity will overflow and discharged through the CSO outfalls.

The other three CSO facilities – Somerville Marginal, Fox Point, and Commercial Point – are gravity CSO facilities, meaning that combined wastewater arrives and leaves the CSO facility by gravity instead of pumping. The disinfected wastewater overflows to the receiving water as quickly as it arrives at the facility. A detailed description of the five CSO facilities can be found in Appendix H.


III.A.1 Cottage Farm Activations


Table III.A.1 and Figures III.A.1 and III.A.2 summarize activation data for the Cottage Farm CSO facility. Cottage Farm is hydraulically connected to Deer Island, so the increased pumping capacity at Deer Island is partially responsible for the general trend of decreasing activations since FY94.

Releases decreased from FY04 to FY05 from 209.2 to 50.71 million gallons. Number of activations also decreased, despite similar rainfall. This combination suggests that improvements to the collection system resulted in greater capture of combined sewage flows.

	Table III.A.1. Cottage Farm CSO Activations Summary											
	FY94	FY95	FY96	FY97	FY98	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Number of activations	31	25	26	24	19	11	19	15	8	14	13	8
Number of days activated	31	25	33	29	22	13	24	18	10	16	15	9
Total volume treated (MG)	621	574	918.49	1092.1	792.31	259	440.27	667.42	50.9	116.71	209.19	50.71
Maximum flow (MGD)	123	100	94.02	199.23	113.62	47	86.04	223.37	13.4	20.62	62.47	11.8
Minimum flow (MGD)	0.08	0.09	1.88	0.63	0.76	1.35	0.56	0.22	0.63	0.91	0.61	1.36
Average flow (MGD)	20.032	22.96	27.833	37.659	36.014	19.923	18.345	37.08	5.09	7.29	13.95	5.63
Total rainfall (inches)	45	37.4	42.55	48.79	50.87	32.41	46.08	41.02	34.14	43.51	42.02	43.81

Average flow = Total volume treated divided by the number of days activated.

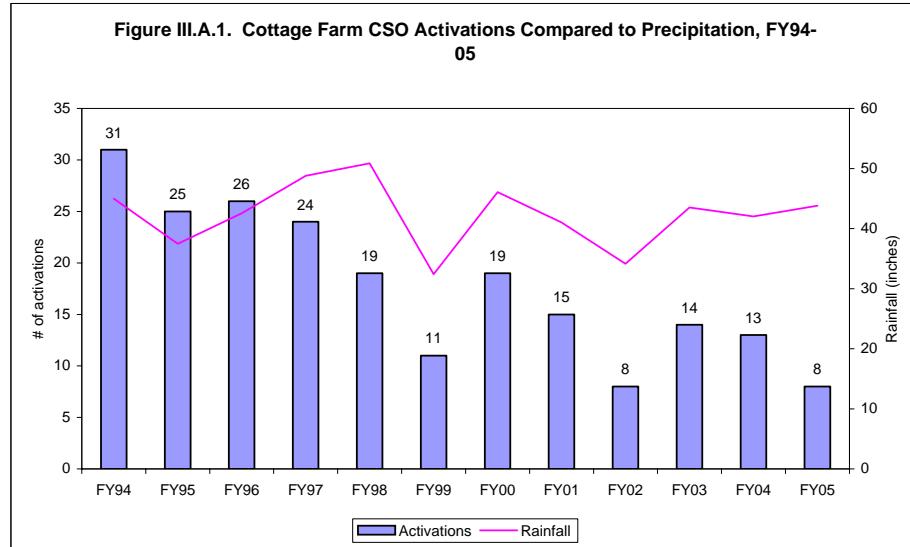

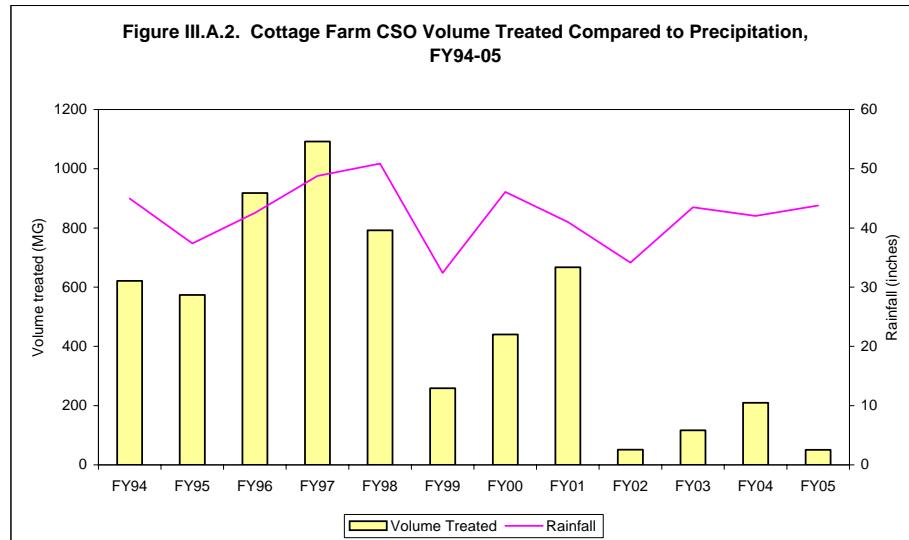

III.A.2 Cottage Farm Conventional Parameters

Table B-1 of Appendix B contains detailed data on conventional parameters in Cottage Farm effluent. Table III.A.2 below summarizes this data. As is the case with all five facilities covered in this chapter, Cottage Farm is a CSO facility that provides floatables control, chlorination, and dechlorination. Such a facility cannot provide the same level of effluent treatment as a full-fledged treatment plant such as Deer Island. CSO effluent pH is often rather low in comparison to effluent from Deer Island or other treatment plants as CSO facilities cannot correct for sewage that enters the facility with an already low pH.

Table III.A.2. Cottage Farm CSO Effluent Characteristics, FY05			
Parameter	Minimum	Average	Maximum
TSS (mg/L)	82.5	119.8	157
BOD (mg/L)	108	108	108
Fecal Coliform (col/100 mL)	3900	19550	98000
pH (SU)	6.2		6.7

III.A.3 Cottage Farm Effluent Metals

For permit compliance, MWRA tests CSO effluent for metals and surfactants whenever the CSO facility is sampled. The results of these tests are presented in Appendix B, Tables B-2 and B-3. The target metals were detected in nearly every sample. Table III.A.3 summarizes average metal concentrations in Cottage Farm effluent in FY05.

Parameter	Average Concentration	Times Detected
Cadmium (ug/L)	0.42	2 of 4
Calcium (ug/L)	12165.00	2 of 2
Chromium (ug/L)	7.13	2 of 2
Copper (ug/L)	62.95	2 of 2
Lead (ug/L)	36.15	2 of 2
Magnesium (ug/L)	2450.00	2 of 2
Mercury (ug/L)	0.12	2 of 2
Nickel (ug/L)	9.59	2 of 2
Zinc (ug/L)	122.85	2 of 2

III.B.1 Prison Point Activations


Activation data for the Prison Point CSO facility are summarized in Table III.B.1 and Figures III.B.1 and III.B.2.


Unlike the Cottage Farm facility, Prison Point is not hydraulically connected to the Deer Island Treatment Plant, so increased pumping at Deer Island will not affect Prison Point activations; hence they have remained relatively constant since FY94, primarily dependent on rainfall.

The number of activations rose in FY05 despite the fact that rainfall only increased marginally over FY04. Average flow per activation dropped, however. A possible explanation is that FY05 featured more numerous, yet less intense storms than FY04. The numbers for FY05 are very similar to FY03, so those two fiscal years probably had similar storm patterns.

	Table III.B.1. Prison Point CSO Activations Summary											
	FY94	FY95	FY96	FY97	FY98	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Number of activations	26	26	24	26	32	23	25	24	22	26	18	24
Number of days activated	26	26	29	30	34	23	30	26	27	27	21	31
Total volume treated (MG)	449	460	445	925.82	958	396	739.5	634.05	201.23	280.71	314.79	337.81
Maximum flow (MGD)	80.32	127	62.6	228	143	51	149	188	24.5	31.34	97.55	38.2
Minimum flow (MGD)	3.01	1.63	1.24	1.5	2	1.4	2.5	1	0.41	0.47	0.79	1
Average flow (MGD)	17.27	17.69	15.34	30.86	28.18	17.22	24.65	24.39	7.45	10.4	14.99	10.9
Total rainfall (inches)	45	37.4	42.55	48.79	50.87	32.41	46.08	41.02	34.14	43.51	42.02	43.81

Average flow = Total volume treated divided by the number of days activated.

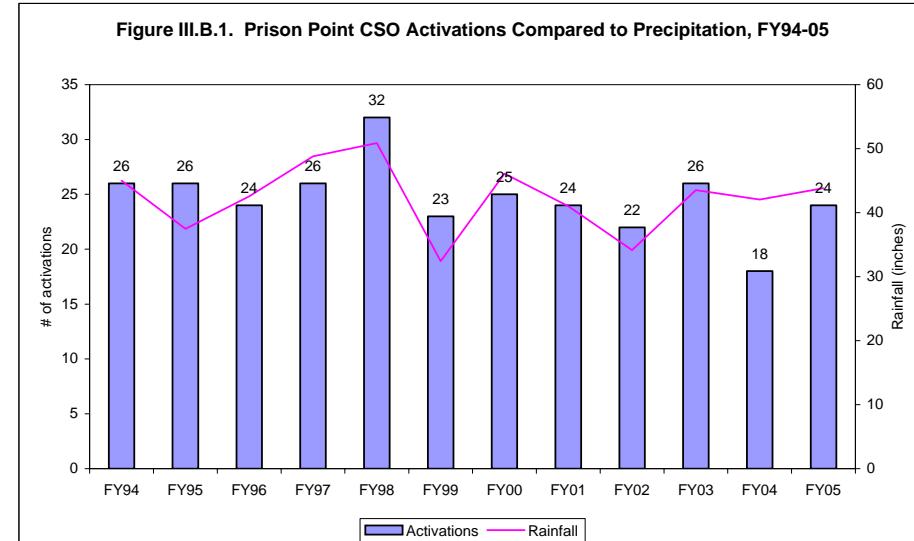

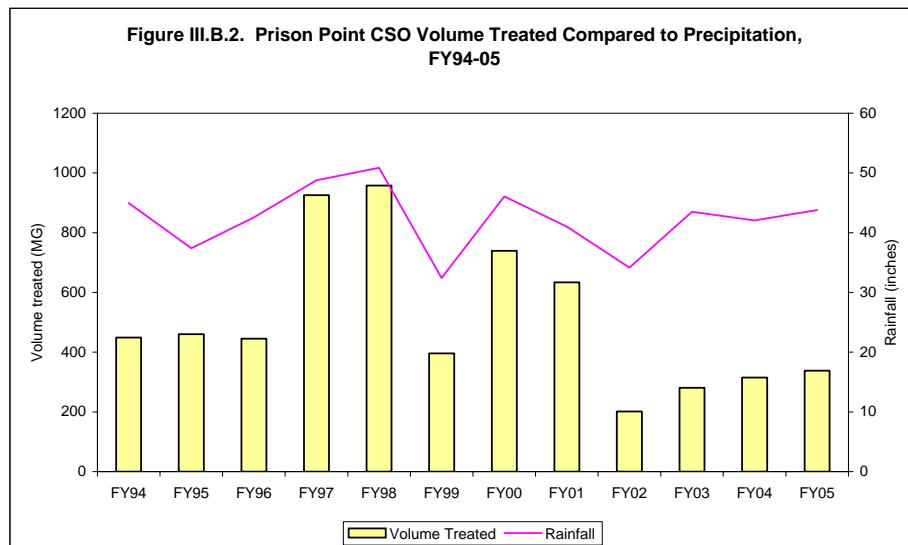

III.B.2 Prison Point Conventional Parameters

Conventional parameter data for Prison Point effluent are provided in Appendix C, Tables C-1 and C-2. Table III.B.2 summarizes that data. See Section III.A.2 for an explanation of the low effluent pH.

Table III.B.2. Prison Point CSO Effluent Characteristics, FY05			
Parameter	Minimum	Average	Maximum
TSS (mg/L)	45.6	120.6	244.0
BOD (mg/L)	11.3	29.5	69.2
Fecal Coliform (col/100 mL)	30	172	1095
pH (SU)	6.2		7.5

III.B.3 Prison Point Effluent Metals

The results of priority pollutant testing for Prison Point can be found in Tables C-2 and C-3 of Appendix C. As with Cottage Farm, the target metals were detected in nearly all of the samples. Table III.B.3 summarizes average metals concentrations in FY05 Prison Point effluent.

Parameter	Average Concentration	Times Detected
Cadmium (ug/L)	0.65	3 of 4
Chromium (ug/L)	14.74	2 of 2
Copper (ug/L)	70.30	2 of 2
Lead (ug/L)	94.95	2 of 2
Mercury (ug/L)	0.29	2 of 2
Nickel (ug/L)	6.79	2 of 3
Zinc (ug/L)	178.00	2 of 2


III.C.1 Somerville Marginal Activations


Table III.C.1 and Figures III.C.1 and III.C.2 summarize activation information for the Somerville Marginal facility. Recently, there has been increased attention to SSOs (Sanitary Sewer Overflows); see Chapter V for more information. MWRA has intensified its monitoring efforts at areas known to overflow where there is a measurable rainfall event. In coordination with this increased SSO monitoring, MWRA has monitored its unmanned gravity CSO facilities of Somerville Marginal, Fox Point, and Commercial Point more frequently. As a result, the statistics for FY98 and after may not be strictly comparable to the earlier years.

When comparing FY04 to FY05 at Somerville Marginal, activations increased yet the average amount discharged per activation fell. This situation is analogous to FY05 data collected at Prison Point, so this pattern can perhaps be attributed to weather patterns during the fiscal year.

	Table III.C.1. Somerville Marginal CSO Activations Summary											
	FY94	FY95	FY96	FY97	FY98	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Number of activations	34	28	28	28	30	19	28	17	29	26	17	25
Number of days activated	34	28	30	29	31	19	34	21	30	28	17	30
Total volume treated (MG)	72	49	80.04	142.24	127.81	57.32	113.8	90.9	33.87	54.05	93.13	55.66
Maximum flow (MGD)	11	14	8.5	64.18	21.72	10.29	25.06	33	5.1	6.76	26.68	5.85
Minimum flow (MGD)	0.006	0.158	0.25	0.13	0.09	0.04	0.01	0.09	0.02	0.05	0.51	0.18
Average flow (MGD)	2.12	1.75	2.67	4.90	4.12	3.02	3.35	4.33	1.17	1.93	5.48	1.86
Total rainfall (inches)	45	37.4	42.55	48.79	50.87	32.41	46.08	41.02	34.14	43.51	42.02	43.81

Average flow = Total volume treated divided by the number of days activated.

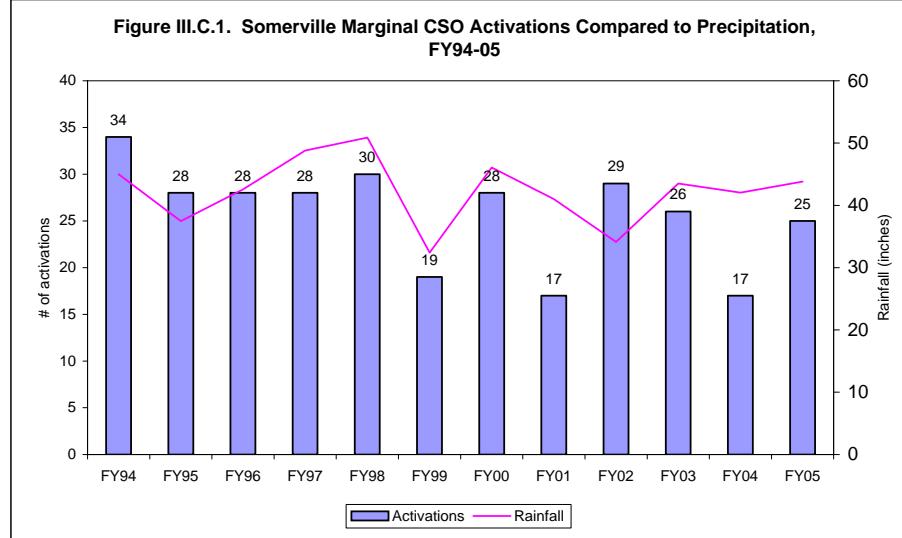

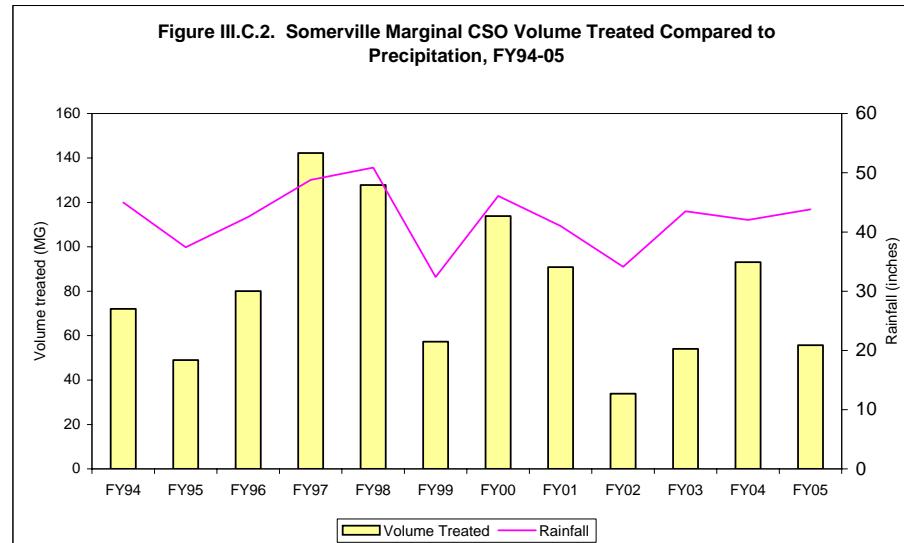

III.C.2 Somerville Marginal Conventional Parameters

Somerville Marginal conventional parameter data is provided in Appendix D, and summarized below in Table III.C.2.

Table III.C.2. Somerville Marginal CSO Effluent Characteristics, FY05

Parameter	Minimum	Average	Maximum
TSS (mg/L)	41.5	100.1	221.0
BOD (mg/L)	2.1	14.3	42.4
Fecal Coliform (col/100 mL)	10	18	40
pH (SU)	6.7		8.3

III.C.3 Somerville Marginal Effluent Metals

The results of Somerville Marginal priority pollutant testing can be found in Appendix D, Tables D-2 and D-3. As with the other CSO facilities, the target metals were detected in most of the samples. Table III.C.3 summarizes the average metals concentration in FY05

Table III.C.3. Somerville Marginal CSO Effluent Metals, FY05

Parameter	Average Concentration	Times Detected
Cadmium (ug/L)	0.29	3 of 7
Calcium (ug/L)	4495.00	4 of 4
Chromium (ug/L)	6.16	4 of 5
Copper (ug/L)	21.10	4 of 4
Lead (ug/L)	37.40	4 of 4
Magnesium (ug/L)	1111.00	4 of 4
Mercury (ug/L)	0.12	4 of 4
Nickel (ug/L)	2.21	4 of 7
Zinc (ug/L)	80.05	4 of 4

III.D.1 Fox Point Activations

Table III.D.1 and Figures III.D.1 and III.D.2 summarize activation data for the Fox Point CSO facility.

Data from Fox Point in FY05 are generally comparable to FY04 data.

Table III.D.1. Fox Point CSO Activations Summary

	FY94	FY95	FY96	FY97	FY98	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Number of activations	20	4	12	16	21	12	23	17	28	30	22	23
Number of days activated	20	4	14	18	24	12	25	20	28	33	23	27
Total volume treated (MG)	76	24	96.63	153.81	166	59.3	96.93	65.69	50.26	75.92	73.76	80.66
Maximum flow (MGD)	12	10	17.23	45.16	39	14.8	24.66	16.16	5.67	7.16	20.4	11.72
Minimum flow (MGD)	0.4	1.5	1.09	0.26	0.171	0.31	0.47	0.03	0.2	0.06	0.35	0.43
Average flow (MGD)	3.8	6	6.90	8.55	6.92	4.94	3.88	3.28	1.79	2.3	3.51	3.1
Total rainfall (inches)	45	37.4	42.55	48.79	50.87	32.41	46.08	41.02	34.14	43.51	42.02	43.81

Average flow = Total volume treated divided by the number of days activated.

Figure III.D.1. Fox Point CSO Activations Compared to Precipitation, FY94-05


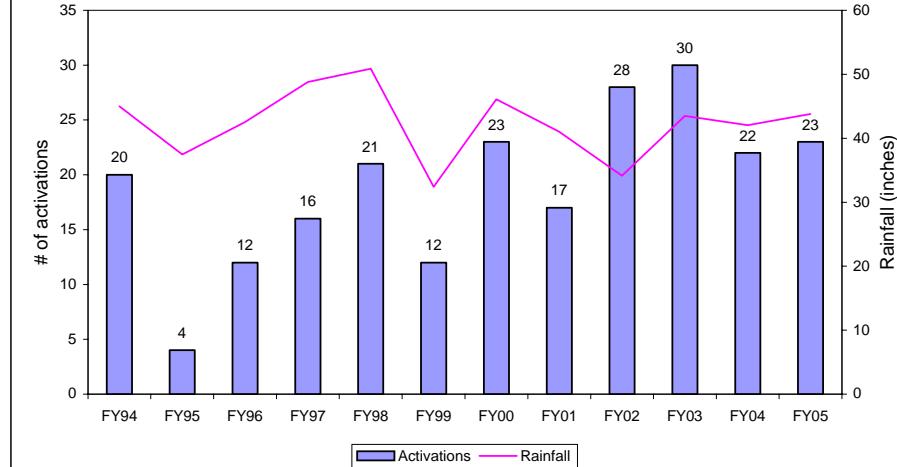


Figure III.D.2. Fox Point CSO Volume Treated Compared to Precipitation, FY94-05

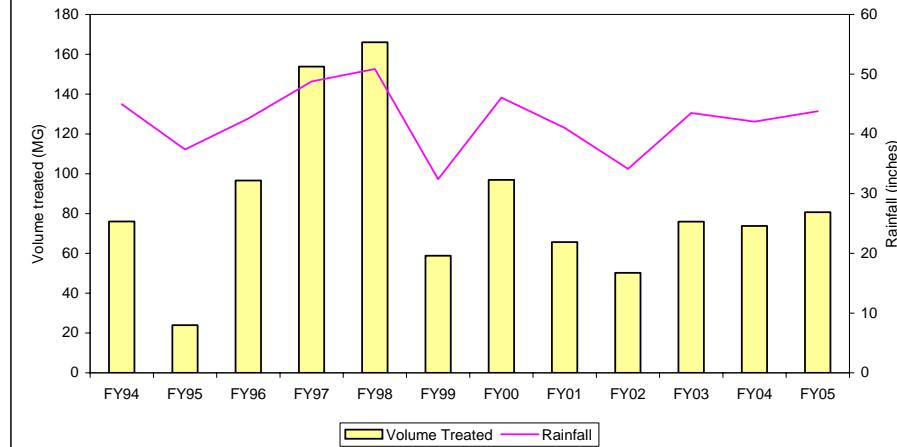

**III.D.2
Fox Point
Conventional
Parameters**

Appendix E, Table E-1, provides data on conventional pollutants collected at Fox Point in FY05. Results are summarized below in Table III.D.2.

Table III.D.2. Fox Point CSO Effluent Characteristics, FY05			
Parameter	Minimum	Average	Maximum
TSS (mg/L)	22.0	107.2	295.0
BOD (mg/L)	7.0	20.8	50.4
Fecal Coliform (col/100 mL)	10	81	1100
pH (SU)	6.5		7.5

**III.D.3
Fox Point
Effluent
Metals**

The results of sampling for priority pollutants at Fox Point can be found in Appendix E, Tables E-2 and E-3. Table III.D.3 summarizes the average metals concentrations in FY05.

Parameter	Average Concentration	Times Detected
Cadmium (ug/L)	1.26	3 of 4
Chromium (ug/L)	6.28	2 of 2
Copper (ug/L)	27.95	2 of 2
Lead (ug/L)	107.25	2 of 2
Mercury (ug/L)	0.23	2 of 2
Nickel (ug/L)	4.59	3 of 3
Zinc (ug/L)	101.20	2 of 2


III.E.1 Commercial Point Activations


Data on Commercial Point activations can be found in Appendix F, and in the table and two figures below.

In FY04, Commercial Point discharged substantially more effluent than in FY03 – in fact, the most the facility has discharged since FY97. This trend continued in FY05. Number of activations hovered around the same level as FY04, and although the amount discharged dropped considerably, it was still over 100 million gallons. The amount discharged per activation did drop compared to FY04, however.

	Table III.E.1. Commercial Point CSO Activations Summary											
	FY94	FY95	FY96	FY97	FY98	FY99	FY00	FY01	FY02	FY03	FY04	FY05
Number of activations	25	19	13	23	25	20	32	19	32	30	25	23
Number of days activated	25	19	14	24	28	20	36	24	35	32	26	28
Total volume treated (MG)	93	55.95	70.14	158.14	124.74	62.78	101.33	93.77	79.23	64.5	124.92	105.4 ^a
Maximum flow (MGD)	16.52	16.7	18.42	53.86	25	12.39	30.42	30.84	7.8	7.3	35.85	16.28
Minimum flow (MGD)	0.21	0.15	0.06	0.19	0.14	0.1	0.03	0.06	0.2	0.05	0.03	0.42
Average flow (MGD)	3.72	2.94	5.01	6.59	4.46	3.14	2.81	3.91	2.26	2.02	4.8	3.77
Total rainfall (inches)	45	37.47	42.55	48.79	50.87	32.41	46.08	41.02	34.14	43.51	42.02	43.81

Average flow = Total volume treated divided by the number of days activated.

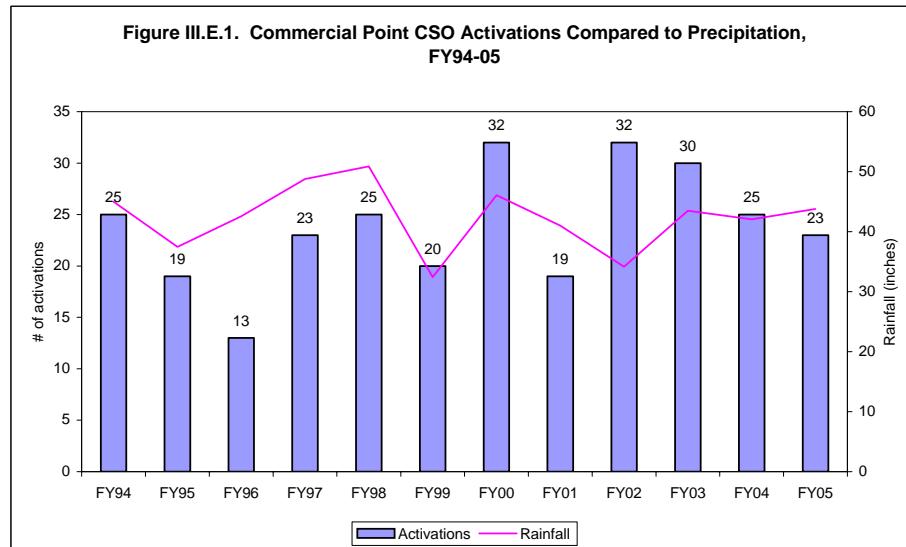

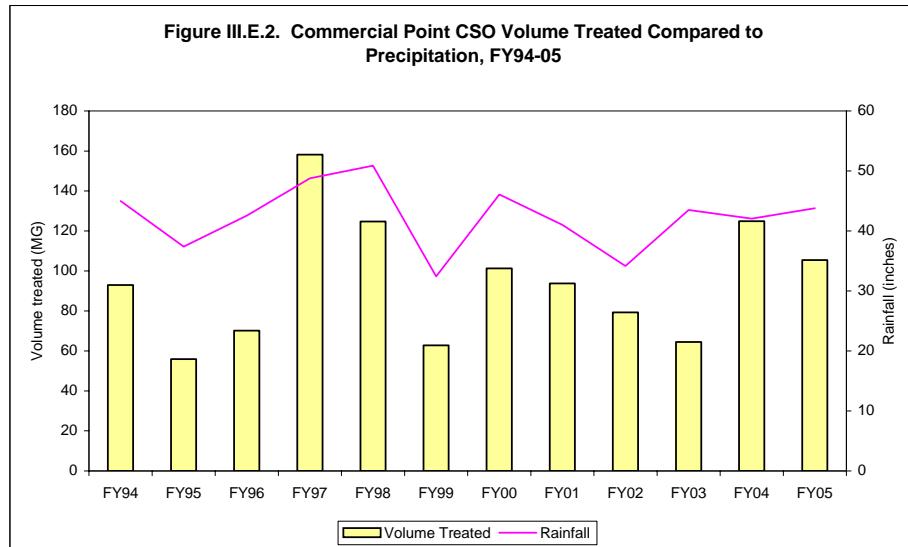

III.E.2 Commercial Point Conventional Parameters

Appendix F, Table F-1 presents data for conventional parameters sampled at Commercial Point in FY05. Results are summarized in Table III.E.2 below.

Table III.E.2. Commercial Point CSO Effluent Characteristics, FY05			
Parameter	Minimum	Average	Maximum
TSS (mg/L)	42.2	173.2	433.3
BOD (mg/L)	8.0	24.8	52.3
Fecal Coliform (col/100 mL)	20	137	117000
pH (SU)	6.0		7.3

III.E.3 Commercial Point Effluent Metals

Table III.E.3 summarizes data from Appendix F, Tables F-2 and F-3 regarding priority pollutants at Commercial Point. Metals were found in detectable amounts in nearly all the samples.

Table III.E.3. Commercial Point CSO Effluent Metals, FY05		
Parameter	Average Concentration	Times Detected
Cadmium (ug/L)	0.55	5 of 10
Chromium (ug/L)	13.52	5 of 6
Copper (ug/L)	40.60	6 of 7
Lead (ug/L)	140.05	5 of 5
Mercury (ug/L)	0.18	5 of 5
Nickel (ug/L)	6.02	6 of 8
Zinc (ug/L)	179.50	5 of 5

IV: Sludge Processing

Overview In December 1991, the MWRA ceased discharge of sludge into Boston Harbor. The digested sludge is now sent to a new plant located on the Fore River in Quincy for processing into fertilizer pellets.

IV.A Pelletizing Process

The pelletizing process begins at the Deer Island Treatment Plant, where gravity thickeners handle sludge and scum from the plant's primary batteries. Centrifuges thicken secondary sludge and scum, with the help of added polymers. Centrate, or the liquid produced by these processes, is sent back to the head of the plant for treatment.

The thickened product is then transferred to Deer Island's most distinctive feature, the egg-shaped anaerobic digesters. In the digesters, bacteria break down the sludge into methane, carbon dioxide, organic material, and water. The methane is tapped, stored, and used later to generate electrical power or heat for Deer Island. The digested sludge is pumped via the Inter-Island Tunnel across the Harbor to the Fore River Pelletizing facility. This tunnel connection became fully operational in April 2005.

The connection from Deer Island to the Fore River facility is part of the Inter-Island Tunnel which connects Deer Island to Nut Island. Inside the tunnel that carries sewage from Nut Island to Deer Island are two smaller pipes, one which carries sludge from Deer Island to the pelletizing facility as mentioned above, and one which carries centrifuge centrate from the pelletizing plant back to Deer Island for treatment (described below).

At the pelletizing plant, centrifuges dewater the sludge into "cake," and dryers further process the sludge into the fertilizer pellets. The centrate from the centrifuges is transferred back to Deer Island for treatment via the Inter-Island Tunnel. The tunnel replaced the earlier barge service on December 16, 2004. The pellets, marketed as "Bay State Fertilizer," are stored at the facility after production. They can either be packaged on-site, or loaded and shipped out in bulk by rail.

Bay State Fertilizer is available in limited quantities to the general public, and is more widely available to local municipalities and for wholesale purchase.

IV.B Sludge Pellet Regulations

Both the federal government and the Commonwealth of Massachusetts have regulations for the composition of fertilizer pellets. The federal government regulates copper, molybdenum, nickel, zinc, arsenic, cadmium, lead, mercury, and selenium. Massachusetts sets limits for all of the above except arsenic and selenium, while adding limits for boron and chromium. In most cases the Massachusetts standard are tougher than the federal standards. Meeting these regulations has generally not been a problem for the MWRA. Table IV.B.1 (next page) summarizes the applicable standards.

Table IV.B.1 Federal and State Limits for Sludge Pellet Metals		
Parameter	Federal Limit (ppm)	Massachusetts Type 1* Limit (ppm)
Arsenic	41	NR
Boron	NR	300
Cadmium	39	14
Chromium	NR	1000
Copper	1500	1000
Lead	300	300
Mercury	17	10
Molybdenum	75	25
Nickel	420	200
Selenium	100	NR
Zinc	2800	2500

NR: Not regulated
*: Type 1 pellets are certified for marketing and distribution in Massachusetts by MADEP

Due to the February 19 annual submittal date for sludge data, sludge data is compiled by calendar year. However, in calendar year 2004 (CY04) and CY05, there were no violations of federal standards for sludge pellets. In seven and three months there were violations of the Massachusetts standard for molybdenum for CY04 and CY05, respectively. Table IV.B.2 summarizes the analytical results for both years. The plant processed 32,620 dry tons of sludge in CY04, and 36,042 tons in CY05.

Table IV.B.2a Summary of Sludge Pellet Analysis, Calendar Year 2004

Parameter	Jan-04	Feb-04	Mar-04	Apr-04	May-04	Jun-04	Jul-04	Aug-04	Sep-04	Oct-04	Nov-04	Dec-04
Arsenic (mg/kg, dry weight)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Boron (mg/kg, dry weight)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Cadmium (mg/kg, dry weight)	2.0	2.0	2.6	2.0	2.3	2.2	2.0	1.6	2.5	1.8	2.5	2.4
Chromium (mg/kg, dry weight)	53.9	53.8	53.8	58.5	65.4	56.2	50.6	55.7	55.9	58.4	42.0	54.9
Copper (mg/kg, dry weight)	686.3	676.8	716.6	694.0	683.3	686.4	725.3	795.5	739.4	744.3	757.8	699.6
Lead (mg/kg, dry weight)	177.3	147.5	160.6	177.0	201.5	181.0	193.8	203.3	216.6	215.3	186.5	183.6
Mercury (mg/kg, dry weight)	3.2	3.4	4.3	3.5	4.4	3.8	4.0	4.0	3.8	3.7	3.7	2.9
Molybdenum (mg/kg, dry weight)	25.2	19.2	19.2	16.8	16.7	22.2	35.6	40.3	35.7	36.6	32.0	26.6
Nickel (mg/kg, dry weight)	26.0	25.8	28.7	28.5	27.7	25.1	26.2	27.1	25.0	26.7	25.0	26.1
Selenium (mg/kg, dry weight)	5.3	5.5	5.4	5.1	5.0	5.3	4.5	4.9	5.2	6.0	5.7	5.7
Zinc (mg/kg, dry weight)	1130.0	848.0	1212.0	1192.5	1187.5	1178.0	1267.5	1325.0	1248.0	1250.0	1262.5	1230.0

ND: No data

Bold indicates violations of the MADEP limits for Type 1 sludge. There were no violation of the federal limits.**Table IV.B.2b Summary of Sludge Pellet Analysis, Calendar Year 2005**

Parameter	Jan-05	Feb-05	Mar-05	Apr-05	May-05	Jun-05	Jul-05	Aug-05	Sep-05	Oct-05	Nov-05	Dec-05
Arsenic (mg/kg, dry weight)	ND	ND	ND	ND	ND							
Boron (mg/kg, dry weight)	ND	ND	ND	ND	ND							
Cadmium (mg/kg, dry weight)	2.7	2.3	2.1	2.8	2.2	2.6	2.2	2.4	2.1	2.5	2.2	2.3
Chromium (mg/kg, dry weight)	55.5	58.2	54.9	52.9	41.2	48.7	44.2	46.0	41.9	45.6	49.6	46.3
Copper (mg/kg, dry weight)	679.0	6968.0	634.2	600.8	605.3	640.8	623.5	680.6	676.8	695.8	643.0	623.3
Lead (mg/kg, dry weight)	188.0	192.5	168.4	163.0	165.0	172.3	156.8	192.0	167.5	178.0	176.0	164.8
Mercury (mg/kg, dry weight)	3.0	3.3	3.0	3.0	2.6	2.6	2.5	2.4	2.2	2.2	2.1	2.8
Molybdenum (mg/kg, dry weight)	18.4	14.7	13.8	11.7	12.1	14.9	22.2	26.5	34.8	39.2	22.8	14.3
Nickel (mg/kg, dry weight)	26.6	28.9	27.5	27.4	24.4	23.9	23.3	23.6	21.4	25.0	23.3	23.0
Selenium (mg/kg, dry weight)	5.6	5.9	5.9	6.1	5.1	5.8	5.7	5.5	5.2	5.2	5.3	5.5
Zinc (mg/kg, dry weight)	1180.0	1270.0	1192.0	1130.0	1077.0	1145.0	1080.0	1160.0	1130.0	1215.0	1112.0	1107.5

ND: No data

Bold indicates violations of the MADEP limits for Type 1 sludge. There were no violation of the federal limits.

V: Transport Systems

V.A.1 North System Headworks Choking

Figure V.A.1 below shows the number of hours of maintenance- and rain-related choking at the remote headworks since FY94. Testing and maintenance hours have steadily declined as the MWRA has completed the new DITP.



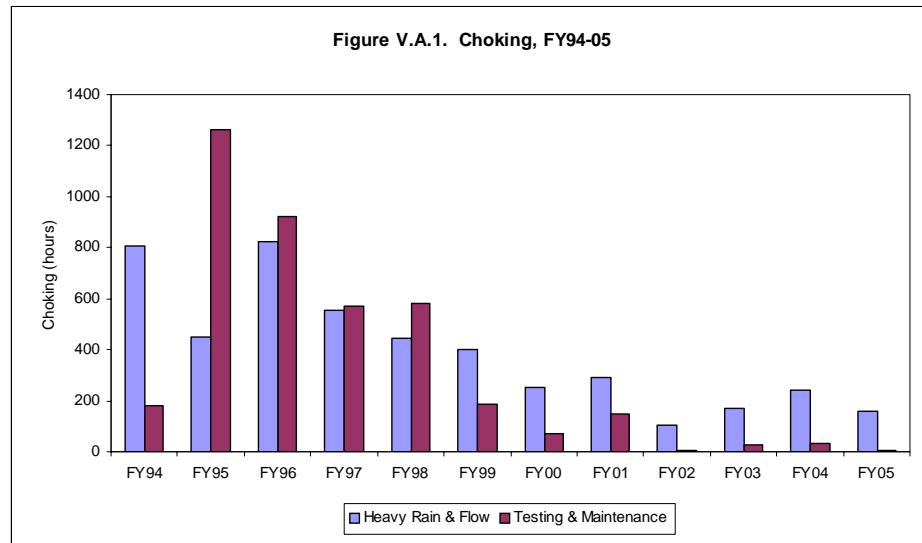


Figure V.A.2 shows the influence of the number of rainy days in a year on the hours of rain-related choking. A rainy day is defined as a day with greater than 0.09 inches of rainfall. Differences in storm intensity between the years can explain years that have similar amounts of rainy days yet vastly different choking hours (i.e., FY96 versus FY98 and the compare the years FY02-FY05, which have similar levels of rainfall but differing amounts of choking).

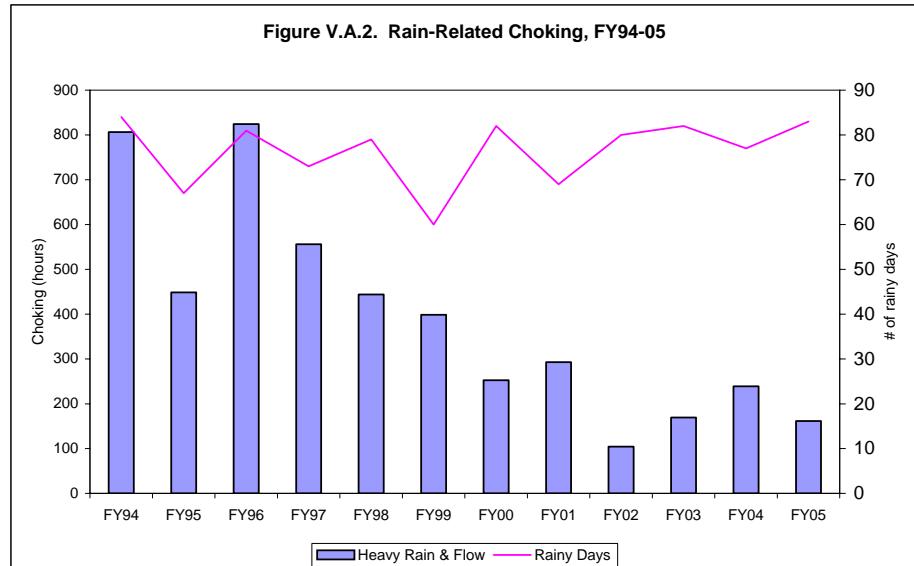

Choking for maintenance purposes is plotted in Figure V.A.3. Maintenance choking peaked in FY95 due to the maintenance and testing involved in bringing the new primary treatment plant on-line. From FY96 to FY98 the number of hours of maintenance-related choking continued to be fairly high because of maintenance and testing related to the startup of the new primary and secondary treatment plants. For example, in FY98, of the approximately 580 choking hours related to testing and maintenance, 442 hours were due to testing. Since there were no new systems to test in FY99, there was a significant decrease in the testing/maintenance choking hours from FY98 to FY99. Testing and maintenance increased in FY01 due to the finishing of both secondary Battery C and the outfall tunnel. With no new systems post-FY02, choking due to testing and maintenance fell to minimal levels.

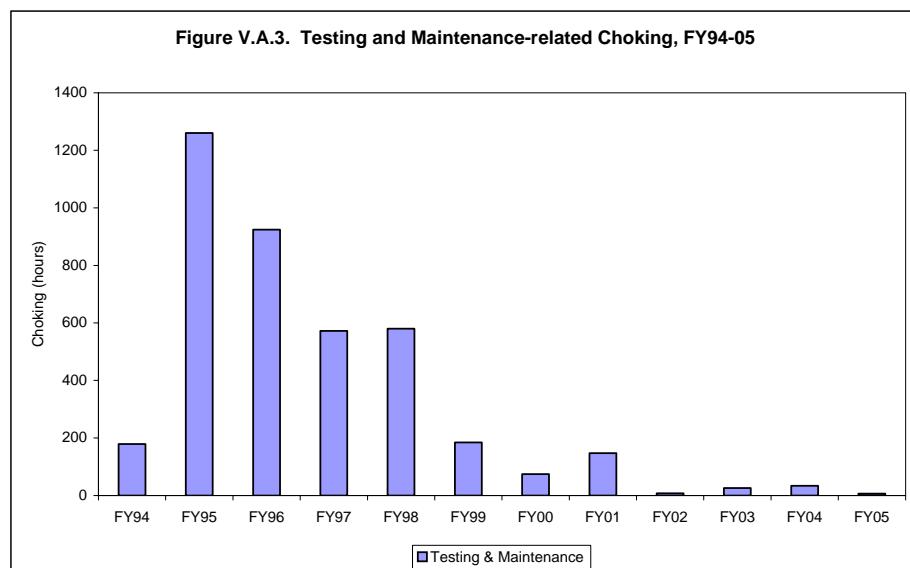

V.A.2 North System Sanitary Sewer Overflows

MWRA monitors sanitary sewer overflows (SSOs) visually and with meters in both the North and South Systems. SSOs occur when extreme rainfall overwhelms the transport system. Note that SSOs differ from CSOs (combined sewer overflows) in that CSO relief points are pipes that were specifically designed to relieve the combined sewer system. When the system becomes overloaded, these CSOs discharge combined sewage and storm water into a receiving body of water, such as the Charles River. SSOs, on the other hand, are weak points in the separate system, such as manholes, which will overflow during heavy rain events.

There was one reported overflow in FY05 for the North System (see Table V.A.1). However, this count includes only overflows at MWRA-owned overflow areas. There may be overflows for which the local municipalities are responsible. MWRA monitors these local overflows less frequently, and only when notified by municipalities or concerned citizens. A list of all the known overflow locations in MWRA lines is provided in Appendix H, Table H-4.

Table V.A.1. Sanitary Sewer Overflows, North System, FY04-05		
Location	Number of Overflows	
	FY04	FY05
Pleasant Street, Watertown		1
Section 107 Medford (Rt. 16)	1	
Section B Cambridge (near MBTA garage)	1	
Cottage Farm CSO	1	
Section 95A-40 Malden	1	
Section C Medford (Auburn St./Rt. 16)	1	
Section 91B Medford (headhouse)	1	
Section 91B Medford (manhole)	1	
Section 51 Melrose (Brunswick Park)	1	
Section 113 Winchester (Ginn Field)	1	

**V.B
South System
Sanitary
Sewer
Overflows**

There were no reported overflows in the South System in FY05.

Table V.B.1. Sanitary Sewer Overflows, South System, FY04-05		
Location	Number of Overflows	
	FY04	FY05
Section 626 Braintree/Weymouth (Smelt Brook)	8	
Section 570 Boston (Archdale St.)	1	

**V.C
Inflow and
Infiltration**

Inflow and infiltration (I/I) is a potentially serious problem that affects all sewerage systems. The NPDES permit requires the MWRA to address issues associated with I/I. Inflow is defined as the introduction of non-sanitary sewer water such as stormwater, residential basement pump-out, and industrial cooling water, into sanitary sewers. Infiltration is the leakage of groundwater into sewage lines through cracks, inadequately sealed joints, etc. In both cases, this additional load decreases system capacity, potentially leading to SSOs. I/I poses both a wet and dry weather problem; however, wet weather exacerbates I/I problems.

A summary of all actions minimizing I/I is prepared annually by MWRA. In addition, the MWRA participates in a Regional I/I Task Force responsible for creating a Regional I/I Reduction Plan for both MWRA and local community collection systems. The I/I Task Force includes MWRA staff, state regulators, and representatives from local communities. To reduce I/I, the MWRA “may consider incentive programs, rate structures, grant and loan programs, technical assistance and public education efforts as well as regulatory and enforcement mechanisms...” (permit section 18.bb.iv) At the end of FY03, MWRA submitted the Regional I/I Reduction Plan for regulatory review.

Find permit-related I/I materials at:
<http://www.mwra.state.ma.us/harbor/html/operations.htm>

VI: Miscellaneous NPDES Permit Requirements

Overview	The MWRA's NPDES permit includes a number of other sections other than effluent quality for Deer Island and the CSO facilities, making it one of the most comprehensive permits ever issued by EPA.
-----------------	---

VI.A Facility Best Management Practices Plans	Best Management Practices Plans (BMPs) are designed to minimize the environmental impact of MWRA facilities. The MWRA has developed plans for the following facilities:
--	---

- Deer Island Treatment Plant
- Nut Island Headworks
- Ward Street Headworks
- Columbus Park Headworks
- Chelsea Creek Headworks
- Cottage Farm CSO facility
- Prison Point CSO facility
- Somerville Marginal CSO facility
- Fox Point CSO facility
- Commercial Point CSO facility
- Fore River Pelletizing Plant

The objectives of BMPs are “(1) minimize the potential for violations of the permit, (2) protect the designated water uses of the surrounding water bodies, and (3) mitigate pollution from materials storage areas, site runoff, improper use of waste disposal system, accidental spillage, etc.” (permit section 9.a)

BMPs are available at the above facilities or at the MWRA offices in Charlestown.

VI.B Water Conservation / Dry Day Flow Limit	As described in the Executive Summary, one of the requirements of the permit is the adherence to a 436 MGD dry day flow limit. In FY05, the MWRA was well within compliance for this limit. See Figure 2 in the Executive Summary for details. If dry day flow reaches 415 MGD, MWRA cannot accept new connections larger than 1.4 MGD.
---	---

Additionally, a report is prepared annually documenting the MWRA's demand management program. The demand management program, run with the cooperation of member communities, reviews historical water and wastewater use, and looks at the effectiveness of past and future conservation programs.

Find permit-related water conservation and dry day flow limit materials at:
<http://www.mwra.state.ma.us/harbor/html/flow.htm>

VI.C Pollution Prevention	The pollution prevention requirement of the permit requires MWRA to develop strategies to reduce pollutant loadings from households and permitted
--	---

Program

industries in the service area. The main target of the program is polychlorinated biphenyls, or PCBs, a known human carcinogen. Manufacture of PCBs has been banned for several decades; however, quantities remain in the environment. The other main aspect of the program is the development of educational materials regarding domestic household hazardous waste, with the aim of preventing those materials from entering the MWRA sewerage system through proper disposal techniques.

For more information on the MWRA's pollution prevention program, visit:
<http://www.mwra.state.ma.us/harbor/html/pollution.htm>

**VI.D
Groundwater
Remediation**

Currently, groundwater remediation site waters cannot be discharged into the MWRA sewer system. If this prohibition is ever relaxed, a comprehensive assessment of its effects on the sewage system and treatment process is required. As of the end of FY05, no action has been taken on this section.

**VI.E
Local Limits
and Industrial
Pretreatment
Programs**

These two related programs deal exclusively with non-domestic users, which are primarily industry. Under the local limits program, the MWRA develops and enforces specific limits on effluent from industrial users.

The industrial pretreatment program requires the MWRA to inspect and sample industrial users as specified by 40 CFR (Code of Federal Regulations) Part 403. 40 CFR Part 403 is designed as a source reduction program to limit the amount of pollutants in treatment plant influent.

Both programs result in cleaner influent to Deer Island, reducing stress on the plant, improving the efficiency of the treatment process, and reducing "pass-through" of contaminants to the effluent. Additionally, the sludge produced is cleaner and more amenable to safe fertilizer production.

More information on local limits and the pretreatment program is on-line at:
<http://www.mwra.state.ma.us/harbor/html/local.htm>

**VI.F
Reporting**

Finally, the permit also requires the MWRA to provide the public with easy access to permit compliance reports and other information.

MWRA maintains a NPDES permit website at:
http://www.mwra.state.ma.us/harbor/html/ditp_performance.htm

EPA maintains an electronic mailing list for permit-related announcements:
<http://www.epa.gov/region1/eco/mwra/listserv.html>

Finally, there are two library repositories for permit documents:

MWRA Library
Charlestown Navy Yard
100 First Avenue
Boston, MA 02129

Hyannis Public Library
401 Main Street
Hyannis, MA 02601

Appendix A

- | | |
|------------|---|
| Table A-1 | Deer Island Treatment Plant Operations Summary, Fiscal Year 2005 |
| Table A-2 | Deer Island Influent Characterization (North & South Systems), Fiscal Year 2005 |
| Table A-3 | Deer Island Influent Loadings (North & South Systems), Fiscal Year 2005 |
| Table A-4 | Deer Island Influent Characterization (North System), Fiscal Year 2005 |
| Table A-5 | Deer Island Influent Loadings (North System), Fiscal Year 2005 |
| Table A-6 | Deer Island Influent Characterization (South System), Fiscal Year 2005 |
| Table A-7 | Deer Island Influent Loadings (South System), Fiscal Year 2005 |
| Table A-8 | Deer Island Effluent Characterization, Fiscal Year 2005 |
| Table A-9 | Deer Island Effluent Loadings, Fiscal Year 2005 |
| Table A-10 | Deer Island Effluent Characterization (DEC), Fiscal Year 2005 |
| Table A-11 | Deer Island Effluent Loadings (DEC), Fiscal Year 2005 |

Table A-1. Deer Island Treatment Plant Operations Summary, FY05

North System Influent													Annual Average		
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Min	Average	Max
Flow (mgd)															
Average	200.8	223.8	243.7	223.1	212.9	267.3	291.8	284.3	295.2	302.1	278.4	227.9		254.3	
Minimum	162.8	170.5	172.2	198.4	171.5	212.3	225.6	223.6	225.2	229.6	214.9	196.8	162.8		
Maximum	364.9	380.2	547.4	363.3	349.7	443.4	494.4	440.3	617.0	580.6	559.1	356.2			617.0
Temperature (deg F)															
Average	69.7	70.4	68.5	66.6	62.8	61.0	56.7	61.0	59.4	59.9	61.2	64.6		63.5	
Minimum	67.1	65.8	63.3	60.6	59.7	56.1	49.6	55.0	52.0	54.7	56.3	57.2	49.6		
Maximum	72.7	73.9	73.8	77.0	65.5	65.7	61.3	64.8	63.3	68.4	70.9	70.3			77.0
pH (SU)															
Average	6.9	7.0	7.0	6.9	7.1	7.0	7.0	7.0	7.0	7.0	7.0	7.0		7.0	
Minimum	6.7	6.7	6.5	6.6	6.8	6.6	6.6	6.5	6.8	6.6	6.6	6.3	6.3		
Maximum	7.3	7.2	7.8	7.1	7.3	7.3	7.2	7.3	7.2	7.7	7.2	7.9			7.9
North System Influent: Conventional Parameters (mg/L)													Annual Average		
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Min	Average	Max
Total Suspended Solids															
Average	211	188	198	172	240	207	176	187	162	197	172	230		195	
Minimum	55	52	46	10	128	48	102	46	36	76	40	50	10		
Maximum	384	368	460	268	445	443	316	434	256	370	276	582			582
cBOD															
Average	116	116	113	106	143	111	101	98	94	87	93	116		108	
Minimum	68	68	55	33	104	68	44	70	44	41	46	75	33		
Maximum	191	295	240	150	230	149	186	136	149	129	126	292			295
Settleable Solids (mL/L)															
Average	6.1	6.3	6.7	6.2	7.8	6.5	3.9	6.7	5.9	4.8	5.8	6.3		6.1	
Minimum	3.6	1.5	1.0	0.1	3.0	2.0	1.0	0.1	1.0	1.5	1.0	3.0	0.1		
Maximum	10.0	18.0	14.0	24.0	15.0	24.0	19.0	60.0	23.0	11.0	22.0	12.0			60.0
Total Solids															
Average	1451	1419	1141	1410	1387	1373	1273	1664	1635	1404	1334	1399		1407	
Minimum	696	1	616	836	868	0	3	1020	6	1070	932	0	0		
Maximum	2860	2380	1810	2190	2420	2500	2750	2650	2980	1690	1770	2380			2980
Volatile Solids															
Average	443	423	336	362	403	362	322	346	342	360	350	433		374	
Minimum	216	228	148	132	284	152	160	188	212	244	192	248	132		
Maximum	828	640	596	616	876	516	428	568	564	536	468	732			876
Volatile Suspended Solids															
Average	183	161	168	151	211	180	151	165	141	171	148	198		169	
Minimum	49	44	42	9	116	44	76	44	32	66	36	44	9		
Maximum	304	310	380	234	375	350	274	398	228	306	232	498			498

Table A-1. Deer Island Treatment Plant Operations Summary, FY05 (cont.)

North System Influent: Conventional Parameters (mg/L; cont.)													Min	Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun				
BOD																
Average	179	177	170	156	222	175	157	163	155	171	162	186		173		
Minimum	101	103	78	31	140	72	74	78	76	76	86	120	31			
Maximum	283	387	369	215	346	251	260	243	260	334	301	610			610	
COD																
Average	116	116	113	106	143	111	101	98	94	87	93	116		108		
Minimum	68	68	55	33	104	68	44	70	44	41	46	75	33			
Maximum	191	295	240	150	230	149	186	136	149	129	126	292			295	
Chloride																
Average	537	532	372	532	458	566	530	715	684	531	488	501		537		
Minimum	267	260	182	243	222	298	287	318	398	403	302	285	182			
Maximum	1290	979	614	915	969	1080	1310	1290	1430	720	680	979			1430	
North System Influent: Nutrients (mg/L)													Min	Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun				
Ammonia																
Average	22.1	22.2	20.3	23.5	23.2	17.5	13.4	13.6	14.0	17.9	12.3	24.7		18.7		
Minimum	14.9	21.6	13.5	19.3	23.1	14.6	12.2	10.0	8.2	11.8	6.7	12.3	6.7			
Maximum	29.8	22.8	25.9	29.2	23.2	20.0	14.4	16.8	16.3	28.2	18.0	37.4			37.4	
Nitrite																
Average	0.29	0.58	0.11	0.01	0.01	0.26	0.20	0.46	0.62	0.18	0.90	0.12		0.31		
Minimum	0.01	0.47	0.01	0.01	0.01	0.05	0.11	0.26	0.17	0.01	0.20	0.01	0.01			
Maximum	1.13	0.69	0.43	0.01	0.02	0.70	0.34	0.77	1.02	0.31	1.60	0.59			1.60	
Nitrate																
Average	0.04	0.09	0.01	0.01	0.01	0.05	0.20	0.25	0.55	0.21	1.10	0.03		0.21		
Minimum	0.01	0.04	0.01	0.01	0.01	0.01	0.06	0.04	0.14	0.01	0.04	0.01	0.01			
Maximum	0.14	0.14	0.01	0.01	0.01	0.11	0.36	0.53	1.64	0.59	2.17	0.14			2.17	
Total Kjeldahl Nitrogen																
Average	32.0	29.2	31.7	31.2	35.8	27.4	21.7	23.9	20.7	32.5	20.3	39.0		28.8		
Minimum	21.6	27.2	24.6	28.1	34.8	20.3	18.8	18.1	14.9	19.3	14.5	20.8	14.5			
Maximum	43.5	31.2	42.3	36.7	36.7	32.0	23.4	31.6	25.5	53.8	26.0	63.0			63.0	
Orthophosphates																
Average	2.3	2.7	2.3	2.8	2.3	1.9	1.2	1.2	1.3	1.8	1.2	3.0		2.0		
Minimum	1.6	2.6	1.2	2.4	2.2	1.6	1.0	0.8	0.6	0.9	0.7	1.1	0.6			
Maximum	3.0	2.9	3.4	3.1	2.5	2.4	1.4	1.5	1.8	3.3	1.7	5.5			5.5	
Total Phosphorus																
Average	5.0	5.2	5.2	5.2	5.3	4.5	3.6	3.5	3.2	5.1	3.1	6.7		4.7		
Minimum	3.7	4.5	4.1	4.3	5.3	3.1	3.3	2.8	2.4	3.0	2.3	2.9	2.3			
Maximum	6.5	5.9	7.1	5.7	5.4	5.5	3.8	4.2	4.0	9.2	4.0	10.2			10.2	

Table A-1. Deer Island Treatment Plant Operations Summary, FY05 (cont.)

South System Influent													Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Min	Annual Average	Max
Flow (mgd)															
Average	90.0	96.6	106.2	114.8	105.0	150.0	173.4	163.0	179.5	181.6	163.2	128.6		137.7	
Minimum	80.3	80.6	82.5	100.8	87.1	125.0	123.3	119.7	132.4	130.3	122.5	101.3	80.3		
Maximum	114.5	126.0	208.7	156.1	146.5	205.2	256.1	235.0	343.1	328.8	329.0	186.4			343.1
Temperature (deg F)															
Average	67.1	68.3	68.0	64.9	60.7	57.3	55.0	53.0	53.1	54.9	58.4	61.3		60.2	
Minimum	59.4	67.1	65.1	62.2	58.1	55.0	52.2	49.8	49.5	50.2	55.8	57.2	49.5		
Maximum	76.6	72.3	72.5	68.7	62.8	65.5	64.2	65.5	70.9	63.9	74.1	65.1			76.6
pH (SU)															
Average	6.7	6.8	6.8	6.7	6.9	6.9	6.8	6.9	6.9	6.8	6.9	6.9		6.8	
Minimum	6.5	6.5	6.5	6.6	6.4	6.6	6.5	6.7	6.7	6.5	6.6	6.5	6.4		
Maximum	6.9	7.1	7.0	6.8	7.0	7.7	7.7	7.5	7.3	7.0	7.1	7.2			7.7
South System Influent: Conventional Parameters (mg/L)													Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Min	Annual Average	Max
Total Suspended Solids															
Average	255	223	207	438	224	485	588	339	117	331	338	214		313	
Minimum	74	49	63	116	102	140	130	105	41	58	63	66	41		
Maximum	452	516	620	1520	556	1090	1060	653	216	1110	796	648			1520
cBOD															
Average	144	135	125	171	137	177	205	139	73	108	113	102		136	
Minimum	99	68	53	82	88	74	68	65	27	34	33	54	27		
Maximum	204	348	196	544	271	413	396	265	122	235	229	233			544
Settleable Solids (mL/L)															
Average	9.1	11.5	8.1	17.2	11.4	33.1	38.3	24.3	4.4	21.6	21.4	9.6		17.5	
Minimum	5.0	3.5	3.5	4.0	3.5	4.0	16.0	3.0	1.0	1.5	2.0	4.0	1.0		
Maximum	16.0	40.0	15.0	58.0	55.0	80.0	60.0	40.0	6.0	68.0	50.0	26.0			80.0
Total Solids															
Average	1502	1233	1006	1368	1275	1198	1353	1279	1110	1160	1244	1285		1251	
Minimum	2	1	0	1	944	0	6	2	3	3	1	2	0		
Maximum	2250	2200	1880	4990	1800	1960	2100	1870	1620	1860	2520	2010			4990
Volatile Solids															
Average	533	463	394	649	404	596	676	459	254	446	484	415		481	
Minimum	280	200	196	228	244	192	256	232	168	156	148	256	148		
Maximum	852	920	676	3800	740	1220	1130	776	356	932	1000	676			3800
Volatile Suspended Solids															
Average	224	197	183	381	198	421	515	298	102	288	285	184		273	
Minimum	66	43	56	106	90	120	112	92	38	51	53	62	38		
Maximum	387	448	510	1300	488	938	944	573	180	940	670	536			1300

Table A-1. Deer Island Treatment Plant Operations Summary, FY05 (cont.)

South System Influent: Conventional Parameters (mg/L; cont.)													Min	Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun				
BOD																
Average	223	215	187	317	211	336	390	282	111	230	224	178		242		
Minimum	135	93	78	124	123	110	73	142	51	60	59	86	51			
Maximum	323	490	309	994	421	901	597	576	193	606	365	306			994	
COD																
Average	533	453	434	718	455	750	791	574	243	505	547	408		534		
Minimum	318	203	188	237	270	270	277	266	135	129	130	178	129			
Maximum	805	638	808	2220	1020	1510	1350	1100	441	1280	1060	890			2220	
Chloride																
Average	580	516	432	449	413	322	341	420	446	370	420	448		430		
Minimum	406	342	318	298	284	259	269	312	306	270	334	337	259			
Maximum	924	871	590	711	669	466	498	671	711	470	740	802			924	
South System Influent: Nutrients (mg/L)													Min	Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun				
Ammonia																
Average	24.6	24.5	18.5	21.8	21.0	15.3	14.6	15.5	17.5	25.4	27.4	27.5		21.1		
Minimum	20.8	16.5	11.6	19.4	17.5	11.3	13.2	9.7	13.4	13.0	18.4	17.6	9.7			
Maximum	27.2	32.2	24.5	27.5	24.9	21.2	16.1	20.7	19.6	33.8	34.2	41.7			41.7	
Nitrite																
Average	0.08	0.01	0.01	0.01	0.01	0.07	0.26	0.05	0.15	0.06	0.15	0.17		0.08		
Minimum	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
Maximum	0.24	0.01	0.01	0.01	0.01	0.16	0.46	0.15	0.30	0.16	0.57	0.80			0.80	
Nitrate																
Average	0.02	0.01	0.02	0.01	0.01	0.01	0.01	0.21	0.35	0.18	0.02	0.01		0.07		
Minimum	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
Maximum	0.04	0.01	0.06	0.01	0.03	0.04	0.01	0.83	1.71	0.70	0.05	0.03			1.71	
Total Kjeldahl Nitrogen																
Average	31.3	35.5	31.2	33.8	34.7	40.4	39.8	36.1	23.3	47.4	43.6	40.0		36.4		
Minimum	26.0	26.4	17.2	17.3	27.2	21.2	37.3	23.6	17.5	18.7	35.6	26.5	17.2			
Maximum	37.9	41.8	41.0	43.5	41.3	63.4	44.0	51.2	26.7	81.4	54.8	71.1			81.4	
Orthophosphates																
Average	3.8	3.0	2.3	2.7	2.6	2.0	1.6	1.7	1.5	2.6	3.1	3.1		2.5		
Minimum	2.7	2.2	1.0	2.6	2.1	1.3	1.6	0.8	0.9	1.1	2.4	2.2	0.8			
Maximum	5.8	3.8	3.1	3.0	3.1	3.4	1.7	2.5	1.9	3.7	3.5	4.5			5.8	
Total Phosphorus																
Average	5.6	6.8	5.5	6.9	5.2	7.7	8.5	6.3	3.8	9.9	8.1	5.7		6.7		
Minimum	4.3	4.9	3.3	5.4	4.6	3.5	7.8	3.4	2.5	2.8	6.7	4.3	2.5			
Maximum	7.4	9.4	7.1	8.8	6.8	13.9	9.6	8.2	4.6	20.7	10.6	7.9			20.7	

Table A-1. Deer Island Treatment Plant Operations Summary, FY05 (cont.)

Flow-Weighted Influent (North+South Systems): Conventional Parameters (mg/L)													Min	Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun				
Total Suspended Solids																
Average	225	198	201	262	235	307	329	243	145	247	233	225	145	237	329	
cBOD																
Average	125	122	116	128	141	135	139	113	86	95	100	111	86	118	141	
Settleable Solids (mL/L)																
Average	7.0	7.8	7.1	9.9	9.0	16.0	16.7	13.1	5.3	11.1	11.6	7.5	5.3	10.2	16.7	
Total Solids																
Average	1467	1363	1100	1396	1350	1310	1303	1524	1436	1312	1301	1358	1100	1352	1524	
Volatile Solids																
Average	471	435	353	459	404	446	454	387	309	393	399	427	309	411	471	
Volatile Suspended Solids																
Average	196	172	173	230	206	267	287	214	126	215	199	193	126	206	287	
BOD																
Average	193	188	175	210	218	233	244	206	138	193	185	183	138	197	244	
COD																
Average	245	218	210	314	246	341	358	272	150	244	260	221	150	257	358	
Chloride																
Average	550	527	390	504	443	478	460	608	594	470	463	482	390	497	608	
Flow-Weighted Influent (North+South Systems): Nutrients (mg/L)													Min	Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun				
Ammonia																
Average	22.9	22.9	19.8	22.9	22.4	16.7	13.8	14.3	15.3	20.7	17.9	25.7	13.8	19.6	25.7	
Nitrite																
Average	0.22	0.41	0.08	0.01	0.01	0.19	0.22	0.31	0.44	0.13	0.62	0.14	0.01	0.23	0.62	
Nitrate																
Average	0.03	0.07	0.01	0.01	0.01	0.03	0.13	0.23	0.48	0.20	0.70	0.03	0.01	0.16	0.70	
Total Kjeldahl Nitrogen																
Average	31.8	31.1	31.6	32.1	35.4	32.1	28.5	28.3	21.7	38.1	28.9	39.4	21.7	31.6	39.4	
Orthophosphates																
Average	2.8	2.8	2.3	2.8	2.4	2.0	1.4	1.4	1.3	2.1	1.9	3.0	1.3	2.2	3.0	
Total Phosphorus																
Average	5.2	5.7	5.3	5.8	5.3	5.7	5.4	4.5	3.5	6.9	5.0	6.4	3.5	5.4	6.9	

Table A-1. Deer Island Treatment Plant Operations Summary, FY05 (cont.)

Final Effluent													Annual Average		
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Min	Average	Max
Flow (mgd)															
Average	290.8	320.4	349.9	338.0	317.9	417.4	465.8	447.3	474.6	483.6	441.5	356.6		392.0	
Minimum	243.2	251.1	255.1	301.9	269.4	344.0	350.0	344.6	357.6	364.4	337.2	298.6	243.2		
Maximum	479.3	493.4	713.5	480.4	481.5	628.0	750.5	628.4	871.4	865.0	803.1	501.0			871.4
Temperature (deg F)															
Average	69.1	70.5	69.6	67.2	63.8	60.1	55.7	54.7	54.3	56.8	60.5	64.2		62.2	
Minimum	67.8	69.1	66.6	65.7	58.6	54.9	53.6	50.9	51.8	52.5	55.9	59.7	50.9		
Maximum	70.7	73.0	71.2	68.7	66.0	63.9	58.5	57.7	56.8	59.4	68.9	68.0			73.0
pH (SU)*															
Average	6.6	6.7	6.7	6.7	6.8	6.8	6.8	6.7	6.7	6.7	6.7	6.7		6.7	
Minimum	6.4	6.3	6.3	6.4	6.5	6.6	6.5	6.5	6.5	6.4	6.5	6.5	6.3		
Maximum	6.8	6.8	6.8	6.8	7.0	7.0	7.1	7.1	6.9	7.1	7.0	7.0			7.1
Final Effluent: Conventional Parameters (mg/L)													Annual Average		
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Min	Average	Max
Total Suspended Solids															
Average	13.6	11.6	14.1	14.5	18.5	19.5	23.2	18.9	12.6	11.1	10.5	9.2		14.8	
Minimum	6.0	5.0	6.5	5.0	5.0	5.5	14.0	5.5	5.0	4.5	5.5	5.0	4.5		
Maximum	40.5	33.0	62.0	44.0	55.0	58.0	37.0	36.0	33.0	24.0	26.0	16.7			62.0
cBOD															
Average	10.3	8.3	9.0	7.8	11.9	11.2	15.5	13.5	10.1	8.3	7.0	5.7		9.9	
Minimum	5.4	3.4	4.3	3.5	2.4	4.4	8.0	4.2	5.5	5.1	4.1	2.5	2.4		
Maximum	30.3	23.1	33.4	18.2	32.7	37.6	25.3	26.5	25.4	19.3	13.4	11.2			37.6
Settleable Solids (mL/L)															
Average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1		0.1	
Minimum	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1		
Maximum	0.1	0.7	1.0	1.0	0.2	1.2	0.6	0.1	0.1	0.2	0.1	0.1			1.2
Total Chlorine Residual*															
Average	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.04	0.04	0.04	0.04	0.04		0.04	
Minimum	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.03		
Maximum	0.10	0.03	0.03	0.03	0.03	0.04	0.06	0.04	0.07	0.05	0.06	0.04			0.10
Fecal Coliform (colonies/100mL)*															
Geometric Mean	23	19	30	13	15	15	22	11	12	16	11	10		16	
Minimum	6	5	5	5	5	5	5	5	5	5	5	5	5		
Maximum	1501	1881	8134	116	469	90	442	126	50	190	133	32			8134
Total Solids															
Average	1320	1246	1141	1177	1203	988	1142	1210	1288	1044	1119	1171		1171	
Minimum	828	708	744	848	836	760	828	848	924	880	932	896	708		
Maximum	2020	1910	1610	1530	1910	1360	1600	1820	2000	1330	1410	1570			2020

Table A-1. Deer Island Treatment Plant Operations Summary, FY05 (cont.)

Final Effluent: Conventional Parameters (mg/L; cont.)													Min	Annual Average	Max	
	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun				
Volatile Solids																
Average	12	10	13	13	17	15	20	16	11	10	9	8		13		
Minimum	6	5	6	5	4	5	12	5	5	4	5	5	4			
Maximum	33	28	54	40	48	40	31	30	26	20	21	14			54	
Volatile Suspended Solids																
Average	12.1	10.4	12.6	13.1	16.6	15.5	19.6	15.9	10.9	9.9	9.1	8.0		12.8		
Minimum	6.0	5.0	6.0	5.0	4.0	5.0	12.0	5.0	5.0	4.0	5.0	4.5	4.0			
Maximum	33.0	27.5	54.0	40.0	48.0	39.5	31.0	30.0	25.5	19.5	20.5	14.0			54.0	
BOD																
Average	19.4	21.1	23.7	25.0	29.5	26.9	27.5	22.8	21.8	23.5	25.0	31.1		24.8		
Minimum	9.6	7.2	11.9	10.5	6.0	9.9	17.4	8.7	9.2	9.7	14.9	6.8	6.0			
Maximum	44.6	45.7	65.6	49.5	67.2	64.0	41.0	41.7	43.4	48.6	55.0	48.8			67.2	
COD																
Average	88	77	81	82	90	73	87	92	73	71	61	65		78		
Minimum	65	43	55	59	56	48	60	61	53	45	42	50	42			
Maximum	110	131	165	122	169	133	138	154	102	104	114	86			169	
Total Organic Carbon																
Average	23.2	22.2	20.0	11.8	12.6	19.9	14.3	17.9	13.7	10.0	14.5	11.2		15.9		
Minimum	22.4	21.9	17.4	11.3	11.8	12.4	13.6	16.0	12.4	10.0	14.0	10.9	10.0			
Maximum	24.0	22.5	22.5	12.2	13.3	27.3	15.0	19.8	15.0	10.1	14.9	11.5			27.3	
Chloride																
Average	580	509	465	510	507	422	487	562	552	428	476	471		498		
Minimum	360	275	246	346	329	305	311	376	375	278	378	336	246			
Maximum	1040	818	673	704	892	608	781	969	922	562	640	690			1040	
Fats, Oils, and Grease																
Average	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0		7.0		
Minimum	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0			
Maximum	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0	7.0			7.0	

Table A-1. Deer Island Treatment Plant Operations Summary, FY05 (cont.)

Final Effluent: Nutrients (mg/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Min	Annual Average	Max
Ammonia															
Average	19.9	20.3	16.2	16.8	22.5	14.8	14.0	14.7	15.1	15.4	13.4	16.5		16.6	
Minimum	15.0	15.4	9.4	14.2	18.9	8.6	12.0	11.1	8.7	4.5	8.8	10.6	4.5		
Maximum	23.1	24.9	20.0	19.5	28.7	18.6	18.4	19.5	20.3	24.1	17.6	21.4			28.7
Nitrite															
Average	0.25	0.54	0.37	0.40	0.36	0.30	0.43	0.60	1.34	0.76	0.51	0.64		0.54	
Minimum	0.03	0.32	0.03	0.09	0.08	0.07	0.27	0.15	0.87	0.21	0.37	0.28	0.03		
Maximum	0.34	0.74	0.86	0.61	0.67	0.56	0.54	1.15	1.71	1.31	0.74	1.22			1.71
Nitrate															
Average	2.74	4.06	1.38	2.86	2.55	2.67	1.85	0.24	0.59	2.41	3.19	2.39		2.24	
Minimum	2.12	2.56	0.01	0.02	0.01	0.02	0.04	0.07	0.07	1.66	2.56	0.13	0.01		
Maximum	3.44	5.77	2.72	4.52	4.44	4.24	2.88	0.73	1.92	3.39	3.81	4.56			5.77
Total Kjeldahl Nitrogen															
Average	21.8	21.2	17.9	17.8	23.6	17.4	16.0	17.9	15.3	15.9	15.0	18.8		18.2	
Minimum	16.5	17.3	12.5	13.3	22.0	12.2	13.2	14.9	10.4	6.6	10.0	12.8	6.6		
Maximum	24.3	25.4	21.7	21.2	30.9	20.8	22.1	23.4	19.1	24.8	19.8	22.7			30.9
Orthophosphates															
Average	2.3	2.3	1.9	2.3	2.6	1.5	1.4	1.4	1.1	1.7	1.5	2.1		1.8	
Minimum	1.8	2.0	1.2	2.2	2.4	0.9	1.2	1.0	0.5	0.8	0.8	1.1	0.5		
Maximum	2.6	2.6	2.2	2.5	2.9	1.9	1.8	2.3	1.7	2.4	1.8	2.9			2.9
Total Phosphorus															
Average	3.0	2.9	2.8	2.9	3.3	2.5	2.2	2.2	1.7	2.2	1.9	2.6		2.5	
Minimum	2.5	2.7	2.0	2.6	3.0	1.4	1.7	1.6	1.1	1.1	1.5	1.5	1.1		
Maximum	3.2	3.1	3.7	3.1	3.7	3.4	2.8	3.2	2.1	2.8	2.3	3.4			3.7

~: No data collected

*: Effluent pH, TCR, and fecal coliform are sampled multiple times daily. The minimum and maximum are the minimum and maximum daily averages, not single sample minimums and maximums.

Table A-2. Deer Island Influent Characterization (North & South Systems), FY05

Metals (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ANTIMONY	12.5		12.5		12.5	12.5	12.5	12.5	12.5		12.5	12.5	12.5	12.5	0 of 32
ARSENIC	1.29		1.12		1.2	0.997	1.46	0.4	1.18		0.4	0.4	0.931	1.65	13 of 32
BERYLLIUM	0.25		0.25		0.25	0.25	0.25	0.25	0.25		0.25	0.25	0.25	0.25	0 of 32
BORON	168		163		125	125	125	125	125		125	125	133	201	3 of 32
CADMIUM	0.566		0.375		0.289	0.254	0.912	0.753	0.582		0.515	0.397	0.485	0.912	32 of 32
CHROMIUM	6.14		7.95		3.56	3.94	5.26	4.47	6.3		3.76	2.78	4.84	8.78	33 of 33
COPPER	122		83.6		61	51.2	84.1	94	82.4		63.7	50.3	74.1	141	32 of 32
HEXAVALENT CHROMIUM	2.5		2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	0 of 38
IRON	3350		2480		1970	1710	2980	2860	2690		2040	1950	2370	3840	32 of 32
LEAD	16.8		15.9		6.77	14.7	12.2	12.5	20.8		9.3	4.63	12.9	29.5	32 of 32
MERCURY	0.296		0.178		0.143	0.127	0.304	0.236	0.458		0.196	0.235	0.244	0.562	34 of 34
MOLYBDENUM	13.9		9.55		5.55	6.42	5.12	9.4	6.41		13.6	8	8.65	15.7	33 of 33
NICKEL	5.37		8.12		3.63	2.08	5.64	3.55	4.44		3.2	3.12	4.16	9.88	32 of 32
SELENIUM	0.45		0.45		0.45	0.45	0.45	0.45	0.45		0.45	0.45	0.45	0.45	0 of 32
SILVER	3.23		2.32		1.84	1.63	2.44	2.57	1.69		2.14	1.58	2.07	3.92	33 of 33
THALLIUM	0.5		0.5		0.5	0.5	0.5	0.5	0.5		0.5	0.5	0.5	0.5	0 of 32
ZINC	212		144		116	104	184	176	165		112	111	142	246	32 of 32
Cyanide (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
CYANIDE	5			5	5	5	5	5	5	5	5	5	5	5	0 of 36
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (mg/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
FATS OIL AND GREASE	45.5		156.0	40.6	48.2	35.0		59.3	40.1	15.4	51.5	31.4	46.7	267.0	36 of 36
MBAS	4.64		5.9		4.53	2.85	1.63	3.49	2.8		3.16	3.93	3.61	7.2	32 of 32
PETROLEUM HYDROCARBON	0.898		4.41	0.944	1.98	0.661	1.29	3.13	1.13	0.327	4.16	6.17	2.17	12.7	38 of 38

Table A-2. Deer Island Influent Characterization (North & South Systems), FY05 (cont.)

Organochlorine Pesticides and PCBs (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
2,4'-DDD						0.00576		0.00011			0.000105		0.00266	0.00822	7 of 19
2,4'-DDE						0.000123		0.00011			0.000105		0.000114	0.000131	0 of 19
2,4'-DDT						0.000123		0.00011			0.000105		0.000114	0.000131	0 of 19
4,4'-DDD	0.00227	0.00202		0.0021	0.00181	0.00263	0.00131	0.00219		0.00217	0.000784	0.00191	0.00263	5 of 51	
4,4'-DDE	0.00227	0.00202		0.0021	0.00214	0.00386	0.00364	0.00219		0.00251	0.00186	0.00238	0.00386	23 of 51	
4,4'-DDT	0.00227	0.00202		0.0021	0.000933	0.00222	0.00183	0.00219		0.0022	0.000784	0.00178	0.00256	1 of 51	
ALDRIN	0.00227	0.00202		0.0021	0.000933	0.00222	0.00079	0.00219		0.0022	0.000784	0.00172	0.00256	0 of 51	
ALPHA-BHC	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
ALPHA-CHLORDANE	0.00227	0.00202		0.0021	0.00279	0.00851	0.00572	0.00577		0.00557	0.00368	0.00415	0.00896	28 of 51	
ACROCLOR-1016	0.0567	0.0505		0.0526	0.0583	0.0556	0.0538	0.0548		0.0551	0.0535	0.0548	0.0642	0 of 32	
ACROCLOR-1221	0.113	0.101		0.105	0.117	0.112	0.108	0.109		0.11	0.107	0.11	0.128	0 of 32	
ACROCLOR-1232	0.0567	0.0505		0.0526	0.0583	0.0556	0.0538	0.0548		0.0551	0.0535	0.0548	0.0642	0 of 32	
ACROCLOR-1242	0.0567	0.0505		0.0526	0.0583	0.0556	0.0538	0.0548		0.0551	0.0535	0.0548	0.0642	0 of 32	
ACROCLOR-1248	0.0567	0.0505		0.0526	0.0583	0.0556	0.0538	0.0548		0.0551	0.0535	0.0548	0.0642	0 of 32	
ACROCLOR-1254	0.0567	0.0505		0.0526	0.0583	0.0556	0.0826	0.0548		0.0551	0.0535	0.0566	0.0826	1 of 32	
ACROCLOR-1260	0.0567	0.0505		0.0526	0.0583	0.0595	0.0765	0.0548		0.0551	0.0535	0.0565	0.0765	2 of 32	
BETA-BHC	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
C13-4,4'-DDT (SURR)						0.0375	0.0645					0.058	0.0499	0.0645	19 of 19
C13-GAMMA-BHC (SURR)						0.0593	0.0716					0.06	0.0617	0.0716	19 of 19
CHLORDANE (TECHNICAL)	0.0567	0.0505		0.0526	0.0583	0.0556	0.0538	0.0548		0.0551	0.0535	0.0548	0.0642	0 of 32	
CIS-NONACHLOR						0.000353	0.00408					0.000402	0.000381	0.000418	19 of 19
DDMU						0.000123	0.00011					0.000105	0.000114	0.000131	0 of 19
DELTA-BHC	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
DIELDRIN	0.00227	0.00202		0.0021	0.000933	0.00222	0.00079	0.00219		0.0022	0.000784	0.00172	0.00256	0 of 51	
ENDOSULFAN I	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
ENDOSULFAN II	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
ENDOSULFAN SULFATE	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
ENDRIN	0.00227	0.00202		0.0021	0.000933	0.00222	0.00079	0.00219		0.0022	0.000784	0.00172	0.00256	0 of 51	
ENDRIN ALDEHYDE	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
ENDRIN KETONE	0.00227	0.00202		0.0021	0.00233	0.00222	0.00215	0.00219		0.0022	0.00214	0.00219	0.00256	0 of 32	
GAMMA-BHC (LINDANE)	0.00227	0.0499		0.0021	0.000933	0.00222	0.00079	0.00219		0.0022	0.000784	0.00639	0.0787	2 of 51	
GAMMA-CHLORDANE	0.00227	0.00202		0.0021	0.00271	0.00859	0.00679	0.00614		0.00521	0.00446	0.00431	0.00859	28 of 51	
HEPTACHLOR	0.00227	0.00202		0.0021	0.000933	0.00222	0.00079	0.00219		0.0022	0.000784	0.00172	0.00256	0 of 51	
HEPTACHLOR EPOXIDE	0.00227	0.00202		0.0021	0.000933	0.00222	0.00079	0.00219		0.0022	0.000784	0.00172	0.00256	0 of 51	
HEXA-CHLOROBENZENE						0.000191	0.000179					0.000187	0.000187	0.000209	19 of 19
METHOXYCHLOR	0.0227	0.0202		0.021	0.0233	0.0222	0.0215	0.0219		0.022	0.0214	0.0219	0.0256	0 of 32	
MIREX						0.000123	0.00011					0.000105	0.000114	0.000131	0 of 19
OXYCHLORDANE						0.000123	0.00011					0.000105	0.000114	0.000131	0 of 19
TOTAL CHLORDANE						0.0043	0.00589					0.00533	0.00497	0.00589	19 of 19
TOTAL DDT						0.00914	0.00315					0.00172	0.00532	0.0128	19 of 19
TOXAPHENE	0.0567	0.0505		0.0526	0.0583	0.0556	0.0538	0.0548		0.0551	0.0535	0.0548	0.0642	0 of 32	
TRANS-NONACHLOR						0.00131	0.00192					0.00167	0.00155	0.00192	19 of 19

Table A-2. Deer Island Influent Characterization (North & South Systems), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
1,2-DICHLOROBENZENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
1,3-DICHLOROBENZENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
1,4-DICHLOROBENZENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2,2'-OXYBIS(1-CHLOROPROPANE)	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2,4,5-TRICHLOROPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2,4,6-TRICHLOROPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2,4-DICHLOROPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2,4-DIMETHYLPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2,4-DINITROPHENOL	2.11		2.03		2.18	2.35	2.22	2.09	2.25		2.13	2.11	2.18	2.35	0 of 32
2,4-DINITROTOLUENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2,6-DINITROTOLUENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2-CHLORONAPHTHALENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2-CHLOROPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2-METHYL-4,6-DINITROPHENOL	10.6		10.2		10.9	11.7	11.1	10.4	11.3		10.6	10.5	10.9	11.7	0 of 32
2-METHYLNAPHTHALENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2-METHYLPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2-NITROANILINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
2-NITROPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
3,3'-DICHLOROBENZIDINE	2.11		2.03		2.18	2.35	2.22	2.09	2.25		2.13	2.11	2.18	2.35	0 of 32
3-NITROANILINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
4-BROMOPHENYL PHENYL ETHER	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
4-CHLORO-3-METHYLPHENOL	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
4-CHLOROANILINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
4-CHLOROPHENYL PHENYL ETHER	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	20.2		17		12.4	10.8	2.86	5.48	9.85		13.5	9.63	11.7	26.1	25 of 32
4-NITROANILINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
4-NITROPHENOL	2.11		2.03		2.18	2.35	2.22	2.09	2.25		2.13	2.11	2.18	2.35	0 of 32
ACENAPHTHENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
ACENAPHTHYLENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
ANILINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
ANTHRACENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
BENZIDINE	5.28		5.08		5.45	5.87	5.55	5.22	5.63		5.32	5.27	5.44	5.87	0 of 32
BENZO(A)ANTHRACENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
BENZO(A)PYRENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32

Table A-2. Deer Island Influent Characterization (North & South Systems), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
BENZO(G,H,I)PERYLENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
BENZO(K)FLUORANTHENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
BENZOIC ACID	6.93		5.3		2.18	13.7	2.22	2.09	2.25		2.13	2.11	4.77	33	3 of 32
BENZYL ALCOHOL	15.7		13.2		17.4	4.98	1.11	3.84	7.14		7.83	6.66	8.62	20.7	24 of 32
BIS(2-CHLOROETHOXY)METHANE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
BIS(2-CHLOROETHYL)ETHER	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
BIS(2-ETHYLHEXYL)PHthalate	16.4		16.2		14.5	11.1	5.25	14.1	14.8		7.02	11.1	12.2	20.4	31 of 32
BUTYL BENZYL PHTHALATE	1.06		1.02		2.34	1.17	1.11	1.04	1.13		1.06	1.05	1.21	3.69	1 of 32
CARBAZOLE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
CHRYSENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
DIBENZO(A,H)ANTHRACENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
DIBENZOFURAN	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
DIETHYL PHTHALATE	5.48		1.02		2.07	1.17	1.11	1.04	1.13		1.06	1.05	1.64	8.65	2 of 32
DIMETHYL PHTHALATE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
DI-N-BUTYLPHthalate	1.72		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.16	2.17	1 of 32
DI-N-OCTYLPHthalate	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
FLUORANTHENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
FLUORENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
HEXACHLOROBENZENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
HEXACHLOROBUTADIENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
HEXACHLOROCYCLOPENTADIENE	5.28		5.08		5.45	5.87	5.55	5.22	5.63		5.32	5.27	5.44	5.87	0 of 32
HEXACHLOROETHANE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
INDENO(1,2,3-CD)PYRENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
ISOPHORONE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
NAPHTHALENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
N-DECANE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
NITROBENZENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
N-NITROSODIMETHYLAMINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
N-NITROSODI-N-PROPYLAMINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
N-NITROSODIPHENYLAMINE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
N-OCTADECANE	1.06		1.02		1.09	1.17	1.11	3.03	1.13		1.06	1.05	1.21	3.03	1 of 32
PENTACHLOROPHENOL	3.17		3.05		3.27	3.52	3.33	3.13	3.38		3.19	3.16	3.26	3.52	0 of 32
PHENANTHRENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32
PHENOL		3.76		3.64	3.72	2.35	2.22	2.09	2.25		2.13	2.11	2.65	5.3	3 of 32
PYRENE	1.06		1.02		1.09	1.17	1.11	1.04	1.13		1.06	1.05	1.09	1.17	0 of 32

Table A-2. Deer Island Influent Characterization (North & South Systems), FY05 (cont.)

Volatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,1,2,2-TETRACHLOROETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,1,2-TRICHLOROETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,1-DICHLOROETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,1-DICHLOROETHENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,2-DICHLOROBENZENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,2-DICHLOROETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,2-DICHLOROPROPANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
1,3-DICHLOROBENZENE	1.32		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.569	2.01	1 of 38
1,4-DICHLOROBENZENE	0.956		0.816	0.5	1.05	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.601	1.59	3 of 38
2-BUTANONE	1.09		4.58	2.55	0.5	0.5	0.5	5.07	2.82	0.5	0.5	0.5	1.42	5.79	10 of 38
2-CHLOROETHYL VINYL ETHER	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
2-HEXANONE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
4-METHYL-2-PENTANONE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
ACETONE	89.3		266	110	147	106	63.3	100	54.3	79.4	71.9	89.8	101	437	36 of 38
ACROLEIN	1		1	1	1	1	1	1	1	1	1	1	1	1	0 of 38
ACRYLONITRILE	1		1	1	1	1	1	1	1	1	1	1	1	1	0 of 38
BENZENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
BROMODICHLOROMETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
BROMOFORM	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
BROMOMETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
CARBON DISULFIDE	0.5		0.5	0.5	2.26	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.628	4.04	1 of 38
CARBON TETRACHLORIDE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
CHLOROBENZENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
CHLOROETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
CHLOROFORM	13.3		6	6.74	6.88	5.68	4.78	9.63	6.3	4.9	8.94	10.3	7.37	15.3	38 of 38
CHLOROMETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
CIS-1,2-DICHLOROETHENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
CIS-1,3-DICHLOROPROPENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
DIBROMOCHLOROMETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
ETHYLBENZENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
MP-XYLENE	1		1	1	1	1	1	2.05	1	1	1.33	1	1.08	2.05	2 of 38
METHYLENE CHLORIDE	0.892		0.883	0.633	0.5	1.37	0.5	0.5	0.5	0.5	1.09	0.5	0.739	1.77	10 of 38
O-XYLENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
STYRENE	0.5		0.5	0.5	4.81	1.21	4.23	0.5	0.5	0.5	0.5	0.5	1.18	9.17	3 of 38
TETRACHLOROETHENE	1.86		2.5	1.64	5.16	0.838	1.46	1.49	3.69	1.72	1.11	1.67	2.06	7.22	19 of 38
TOLUENE	4.91		4.52	3.32	4.17	3.68	1.28	3.7	2.89	0.5	3.56	3.56	3.09	6.44	31 of 38
TRANS-1,2-DICHLOROETHENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
TRANS-1,3-DICHLOROPROPENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
TRICHLOROETHENE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	2.34	2.45	0.5	0.965	2.55
TRICHLOROFLUOROMETHANE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
VINYL ACETATE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38
VINYL CHLORIDE	0.5		0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 38

Notes

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-3. Deer Island Influent Loadings (North & South Systems), FY05

Metals (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected	
ANTIMONY	32.4		30.3		29.2	48.4	47.9	38.5	46.8		40.6	39.6	38.8	61	0 of 32	
ARSENIC		3.34		2.7		2.81	3.86	5.59	1.23	4.43		1.3	1.27	2.89	7.02	13 of 32
BERYLLIUM	0.649		0.606		0.584	0.969	0.958	0.77	0.937		0.812	0.792	0.777	1.22	0 of 32	
BORON	435		395		292	484	479	385	468		406	396	414	610	3 of 32	
CADMIUM	1.47		0.907		0.676	0.985	3.49	2.32	2.18		1.67	1.26	1.51	3.49	32 of 32	
CHROMIUM	15.9		19.3		8.33	15.3	20.1	13.8	23.6		12.2	8.81	15	33.7	33 of 33	
COPPER	318		203		143	198	322	290	309		207	159	230	425	32 of 32	
HEXAVALENT CHROMIUM	6.97		6.06	7.04	6.03	11	12.2	7.63	9.81	12.6	7.91	9.15	8.73	13	0 of 38	
IRON	8680		6020		4610	6620	11400	8830	10100		6630	6190	7370	14600	32 of 32	
LEAD	43.6		38.5		15.8	56.8	46.8	38.6	77.8		30.2	14.7	40	126	32 of 32	
MERCURY	0.769		0.432		0.335	0.491	1.16	0.727	1.71		0.636	0.746	0.759	2.39	34 of 34	
MOLYBDENUM	36.1		23.1		13	24.9	19.6	29	24		44.3	25.4	26.9	48.6	33 of 33	
NICKEL	13.9		19.7		8.48	8.05	21.6	10.9	16.6		10.4	9.9	12.9	24	32 of 32	
SELENIUM	1.17		1.09		1.05	1.74	1.72	1.39	1.69		1.46	1.43	1.4	2.2	0 of 32	
SILVER	8.37		5.62		4.3	6.32	9.34	7.91	6.33		6.94	5.02	6.44	11.8	33 of 33	
THALLIUM	1.3		1.21		1.17	1.94	1.92	1.54	1.87		1.62	1.58	1.55	2.44	0 of 32	
ZINC	550		349		270	401	704	542	619		364	353	441.00	828.00	32 of 32	
Cyanide (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected	
CYANIDE		13.9			14.1	12.1	22	23.5	15.3	19.6	25.2	15.8	18.3	18.3	26	0 of 36
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected	
FATS OIL AND GREASE	127000		379000	114000	116000	154000		181000	158000	77500	163000	115000	160000	644000	36 of 36	
MBAS	12000		14200.0		10600	11000	6260	10700	10700.0		10300	12500	11200	17500	32 of 32	
PETROLEUM HYDROCARBON	2500		10700	2660	4780	2910	6260	9560	4440	1650	13200	22600	7570	39800	38 of 38	

Table A-3. Deer Island Influent Loadings (North & South Systems), FY05 (cont.)

Organochlorine Pesticides and PCBs (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected	
2,4'-DDD						0.0223		0.00034				0.000333	0.00913	0.0401	7 of 19	
2,4'-DDE						0.000477		0.00034				0.000333	0.000392	0.000639	0 of 19	
2,4'-DDT						0.000477		0.00034				0.000333	0.000392	0.000639	0 of 19	
4,4'-DDD	0.00588	0.00489		0.00492	0.00701	0.0101	0.00404	0.0082		0.00704	0.00248	0.00593	0.0111	5 of 51		
4,4'-DDE	0.00588	0.00489		0.00492	0.00828	0.0148	0.0112	0.0082		0.00814	0.0059	0.0074	0.0148	23 of 51		
4,4'-DDT	0.00588	0.00489		0.00492	0.00361	0.00852	0.00565	0.0082		0.00715	0.00248	0.00553	0.00965	1 of 51		
ALDRIN	0.00588	0.00489		0.00492	0.00361	0.00852	0.00243	0.0082		0.00715	0.00248	0.00533	0.00965	0 of 51		
ALPHA-BHC	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
ALPHA-CHLORDANE	0.00588	0.00489		0.00492	0.0108	0.0326	0.0176	0.0216		0.0181	0.0117	0.0129	0.0326	28 of 51		
ACOCLOR-1016	0.147	0.122		0.123	0.226	0.213	0.166	0.205		0.179	0.17	0.17	0.292	0 of 32		
ACOCLOR-1221	0.294	0.244		0.246	0.452	0.428	0.333	0.41		0.358	0.34	0.341	0.586	0 of 32		
ACOCLOR-1232	0.147	0.122		0.123	0.226	0.213	0.166	0.205		0.179	0.17	0.17	0.292	0 of 32		
ACOCLOR-1242	0.147	0.122		0.123	0.226	0.213	0.166	0.205		0.179	0.17	0.17	0.292	0 of 32		
ACOCLOR-1248	0.147	0.122		0.123	0.226	0.213	0.166	0.205		0.179	0.17	0.17	0.292	0 of 32		
ACOCLOR-1254	0.147	0.122		0.123	0.226	0.213	0.255	0.205		0.179	0.17	0.176	0.292	1 of 32		
ACOCLOR-1260	0.147	0.122		0.123	0.226	0.228	0.236	0.205		0.179	0.17	0.175	0.292	2 of 32		
BETA-BHC	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
C13-4,4'-DDT (SURR)						0.145	0.199					0.184	0.171	0.199	19 of 19	
C13-GAMMA-BHC (SURR)						0.23	0.221					0.19	0.212	0.295	19 of 19	
CHLORDANE (TECHNICAL)	0.147	0.122		0.123	0.226	0.213	0.166	0.205		0.179	0.17	0.17	0.292	0 of 32		
CIS-NONACHLOR						0.00137	0.00126					0.00127	0.00131	0.00189	19 of 19	
DDMU						0.000477		0.00034				0.000333	0.000392	0.000639	0 of 19	
DELTA-BHC	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
DIELDRIN	0.00588	0.00489		0.00492	0.00361	0.00852	0.00243	0.0082		0.00715	0.00248	0.00533	0.00965	0 of 51		
ENDOSULFAN I	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
ENDOSULFAN II	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
ENDOSULFAN SULFATE	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
ENDRIN	0.00588	0.00489		0.00492	0.00361	0.00852	0.00243	0.0082		0.00715	0.00248	0.00533	0.00965	0 of 51		
ENDRIN ALDEHYDE	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
ENDRIN KETONE	0.00588	0.00489		0.00492	0.00903	0.00852	0.00662	0.0082		0.00715	0.00678	0.0068	0.0117	0 of 32		
GAMMA-BHC (LINDANE)	0.00588		0.121	0.00492	0.00361	0.00852	0.00243	0.0082		0.00715	0.00248	0.0198	0.191	2 of 51		
GAMMA-CHLORDANE	0.00588	0.00489		0.00492	0.0105	0.0329	0.0209	0.023		0.0169	0.0141	0.0134	0.0329	28 of 51		
HEPTACHLOR	0.00588	0.00489		0.00492	0.00361	0.00852	0.00243	0.0082		0.00715	0.00248	0.00533	0.00965	0 of 51		
HEPTACHLOR EPOXIDE	0.00588	0.00489		0.00492	0.00361	0.00852	0.00243	0.0082		0.00715	0.00248	0.00533	0.00965	0 of 51		
HEXACHLOROBENZENE						0.00074	0.000552					0.000593	0.000643	0.000961	19 of 19	
METHOXYPYRROLE	0.0588	0.0489		0.0492	0.0903	0.0852	0.0662	0.082		0.0715	0.0678	0.068	0.117	0 of 32		
MIREX						0.000477		0.00034				0.000333	0.000392	0.000639	0 of 19	
OXYCHLORDANE						0.000477		0.00034				0.000333	0.000392	0.000639	0 of 19	
TOTAL CHLORDANE						0.0167	0.0181					0.0169	0.0171	0.0247	19 of 19	
TOTAL DDT						0.0354	0.00972					0.00546	0.0183	0.0622	19 of 19	
TOXAPHENE	0.147	0.122		0.123	0.226	0.213	0.166	0.205		0.179	0.17	0.17	0.292	0 of 32		
TRANS-NONACHLOR						0.00509	0.0059					0.0053	0.00534	0.00706	19 of 19	

Table A-3. Deer Island Influent Loadings (North & South Systems), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
1,2-DICHLOROBENZENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
1,3-DICHLOROBENZENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
1,4-DICHLOROBENZENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2,2'-OXYBIS(1-CHLOROPROPANE)	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2,4,5-TRICHLOROPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2,4,6-TRICHLOROPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2,4-DICHLOROPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2,4-DIMETHYLPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2,4-DINITROPHENOL	5.48	4.92		5.09	9.09	8.51	6.43	8.43			6.91	6.69	6.76	11.4	0 of 32
2,4-DINITROTOLUENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2,6-DINITROTOLUENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2-CHLORONAPHTHALENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2-CHLOROPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2-METHYL-4,6-DINITROPHENOL	27.4	24.6		25.5	45.5	42.6	32.2	42.1			34.5	33.4	33.8	57.2	0 of 32
2-METHYLNAPHTHALENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2-METHYLPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2-NITROANILINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
2-NITROPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
3,3'-DICHLOROBENZIDINE	5.48	4.92		5.09	9.09	8.51	6.43	8.43			6.91	6.69	6.76	11.4	0 of 32
3-NITROANILINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
4-BROMOPHENYL PHENYL ETHER	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
4-CHLORO-3-METHYLPHENOL	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
4-CHLOROANILINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
4-CHLOROPHENYL PHENYL ETHER	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	52.3	41.2		29	41.9	11	16.9	36.9			43.9	30.5	36.2	78.6	25 of 32
4-NITROANILINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
4-NITROPHENOL	5.48	4.92		5.09	9.09	8.51	6.43	8.43			6.91	6.69	6.76	11.4	0 of 32
ACENAPHTHENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
ACENAPHTHYLENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
ANILINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
ANTHRACENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
BENZIDINE	13.7	12.3		12.7	22.7	21.3	16.1	21.1			17.3	16.7	16.9	28.6	0 of 32
BENZO(A)ANTHRACENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
BENZO(A)PYRENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32

Table A-3. Deer Island Influent Loadings (North & South Systems), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
BENZO(GH)PERYLENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
BENZO(K)FLUORANTHENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
BENZOIC ACID	18	12.8		5.09	53.1	8.51	6.43	8.43			6.91	6.69	14.8	94.8	3 of 32
BENZYL ALCOHOL	40.8	32.1		40.8	19.3	4.26	11.8	26.7			25.4	21.1	26.8	60.6	24 of 32
BIS(2-CHLOROETHOXY)METHANE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
BIS(2-CHLOROETHYL)ETHER	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
BIS(2-ETHYLHEXYL)PHTHALATE	42.5	39.2		33.8	42.8	20.1	43.4	55.4			22.8	35.1	37.9	71.7	31 of 32
BUTYL BENZYL PHTHALATE	2.74	2.46		5.48	4.55	4.26	3.22	4.21			3.45	3.34	3.75	8.31	1 of 32
CARBAZOLE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
CHRYSENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
DIBENZO(A,H)ANTHRACENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
DIBENZOFURAN	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
DIETHYL PHTHALATE	14.2	2.46		4.84	4.55	4.26	3.22	4.21			3.45	3.34	5.1	26.1	2 of 32
DIMETHYL PHTHALATE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
DI-N-BUTYLPHTHALATE	4.46	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.6	6.53	1 of 32
DI-N-OCTYLPHTHALATE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
FLUORANTHENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
FLUORENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
HEXACHLOROBENZENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
HEXACHLOROBUTADIENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
HEXACHLOROCYCLOPENTADIENE	13.7	12.3		12.7	22.7	21.3	16.1	21.1			17.3	16.7	16.9	28.6	0 of 32
HEXACHLOROETHANE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
INDENO(1,2,3-CD)PYRENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
ISOPHORONE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
NAPHTHALENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
N-DECANE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
NITROBENZENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
N-NITROSODIMETHYLAMINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
N-NITROSODI-N-PROPYLAMINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
N-NITROSODIPHENYLAMINE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
N-OCTADECANE	2.74	2.46		2.55	4.55	4.26	9.33	4.21			3.45	3.34	3.76	9.33	1 of 32
PENTACHLOROPHENOL	8.21	7.38		7.64	13.6	12.8	9.65	12.6			10.4	10	10.1	17.2	0 of 32
PHENANTHRENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32
PHENOL	9.75	8.82		8.7	9.09	8.51	6.43	8.43			6.91	6.69	8.23	14.7	3 of 32
PYRENE	2.74	2.46		2.55	4.55	4.26	3.22	4.21			3.45	3.34	3.38	5.72	0 of 32

Table A-3. Deer Island Influent Loadings (North & South Systems), FY05 (cont.)

Volatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,1,2,2-TETRACHLOROETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,1,2-TRICHLOROETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,1-DICHLOROETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,1-DICHLOROETHENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,2-DICHLOROBENZENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,2-DICHLOROETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,2-DICHLOROPROPANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
1,3-DICHLOROBENZENE	3.67		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.99	6.07	1 of 38
1,4-DICHLOROBENZENE	2.66		1.21	1.41	2.52	2.2	2.44	1.53	1.96	2.52	1.58	1.83	2.1	4.05	3 of 38
2-BUTANONE	3.03		11.1	7.17	1.21	2.2	2.44	15.5	11.1	2.52	1.58	1.83	4.95	15.5	10 of 38
2-CHLOROETHYL VINYL ETHER	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
2-HEXANONE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
4-METHYL-2-PENTANONE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
ACETONE	249		645	310	354	465	308	305	213	399	228	329	352	1060	36 of 38
ACROLEIN	2.79		2.42	2.81	2.41	4.4	4.87	3.05	3.93	5.03	3.16	3.66	3.49	5.2	0 of 38
ACRYLONITRILE	2.79		2.42	2.81	2.41	4.4	4.87	3.05	3.93	5.03	3.16	3.66	3.49	5.2	0 of 38
BENZENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
BROMODICHLOROMETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
BROMOFORM	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
BROMOMETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
CARBON DISULFIDE	1.39		1.21	1.41	5.46	2.2	2.44	1.53	1.96	2.52	1.58	1.83	2.19	9.7	1 of 38
CARBON TETRACHLORIDE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
CHLOROBENZENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
CHLOROETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
CHLOROFORM	37		14.5	19	16.6	25	23.3	29.4	24.7	24.7	28.3	37.6	25.7	45.9	38 of 38
CHLOROMETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
CIS-1,2-DICHLOROETHENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
CIS-1,3-DICHLOROPROPENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
DIBROMOCHLOROMETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
ETHYLBENZENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
M,P-XYLENE	2.79		2.42	2.81	2.41	4.4	4.87	6.27	3.93	5.03	4.2	3.66	3.77	6.27	2 of 38
METHYLENE CHLORIDE	2.49		2.14	1.78	1.21	6.04	2.44	1.53	1.96	2.52	3.45	1.83	2.58	8.62	10 of 38
O-XYLENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
STYRENE	1.39		1.21	1.41	11.6	5.31	20.6	1.53	1.96	2.52	1.58	1.83	4.12	22	3 of 38
TETRACHLOROETHENE	5.18		6.05	4.62	12.4	3.69	7.12	4.55	14.5	8.64	3.51	6.1	7.18	17.5	19 of 38
TOLUENE	13.7		11	9.35	10.1	16.2	6.25	11.3	11.3	2.52	11.3	13	10.8	19.4	31 of 38
TRANS-1,2-DICHLOROETHENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
TRANS-1,3-DICHLOROPROPENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
TRICHLOROETHENE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	11.8	7.75	1.83	3.37	12.4	4 of 38
TRICHLOROFLUOROMETHANE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
VINYL ACETATE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38
VINYL CHLORIDE	1.39		1.21	1.41	1.21	2.2	2.44	1.53	1.96	2.52	1.58	1.83	1.75	2.6	0 of 38

Notes

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-4. Deer Island Influent Characterization (North System), FY05

Metals (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ANTIMONY	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	0 of 25
ARSENIC	1.35	1.7	1.44	1.35	1.63	1.25	0.69	0.4	1.27	0.4	0.4	0.4	0.97	1.92	14 of 25
BERYLLIUM	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0 of 25
BORON	125	125	125	125	125	125	125	125	125	125	125	125	125	125	0 of 25
CADMIUM	0.516	0.351	0.433	0.357	0.352	0.248	0.556	0.678	0.573	0.443	0.357	0.43	0.449	0.784	25 of 25
CHROMIUM	5.69	5.69	9.06	3.52	4.22	4.2	4.61	7.96	7.08	3.76	2.87	3.11	5.1	10.8	25 of 25
COPPER	102	81.5	90.1	46.3	64.4	50.1	42.7	82.4	86.8	51.3	51.3	53.1	65	105	25 of 25
HEXAVALENT CHROMIUM	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	0 of 24
IRON	2860	2480	2840	1740	2230	1670	2220	3350	2800	1920	1600	2180	2310	3850	25 of 25
LEAD	17.8	14.6	20.6	6.39	7.95	17.3	19.7	30.3	26	11.4	9.76	5.56	16.1	39.6	25 of 25
MERCURY	0.246	0.182	0.212	0.195	0.111	0.131	0.103	0.172	0.288	0.201	0.189	0.318	0.193	0.53	26 of 26
MOLYBDENUM	14.5	11.2	11.1	4.67	6.05	8.03	5.26	9	8.35	2.89	18.9	9.96	8.71	21.5	25 of 25
NICKEL	4.84	4.98	4.95	3.04	3.98	1.92	4.81	5.39	3.99	3.6	2.58	3.51	3.91	6.58	25 of 25
SELENIUM	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0 of 25
SILVER	2.32	2.31	2.51	1.15	2.09	1.62	1.25	1.9	1.52	1.18	1.93	1.72	1.71	3.13	25 of 25
THALLIUM	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 25
ZINC	183	144	156	87.4	125	105	117	174	158	105	91.7	124	129	198	25 of 25
Cyanide (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
CYANIDE	5	5	5	5	5	5	5	5	5	5	5	5	5	5	0 of 23
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (mg/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
FATS OIL AND GREASE	40	46.2	193	38.7	48.3	37.3	18.3	31.6	36.9	15.4	43.4	30.1	43.5	348	24 of 24
MBAS	4.21	4.74	5.49	3.73	4.28	2.74	1.22	2.18	2.52	2.46	3.25	4.09	3.19	6.92	25 of 25
PETROLEUM HYDROCARBON	0.766	1.1	5.06	0.894	2.28	0.68	0.569	1.8	0.924	0.312	2.73	8.7	2.05	19.8	24 of 24

Table A-4. Deer Island Influent Characterization (North System), FY05 (cont.)

Organochlorine Pesticides and PCBs (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
2,4'-DDD		0.00012		0.000871		0.0011		0.0217		0.000154		0.000105	0.00463	0.0336	9 of 23
2,4'-DDE		0.00012		0.000122		0.000115		0.000139		0.000154		0.000105	0.000128	0.000215	0 of 23
2,4'-DDT		0.00012		0.000122		0.000115		0.000139		0.000154		0.000105	0.000128	0.000215	0 of 23
4,4'-DDD	0.00214	0.00269	0.002	0.000881	0.002	0.00221	0.00221	0.000786	0.00225	0.000929	0.00224	0.000787	0.0017	0.00364	6 of 48
4,4'-DDE	0.00214	0.00529	0.002	0.00215	0.002	0.00204	0.00221	0.00239	0.00225	0.00141	0.0022	0.00194	0.00227	0.00726	22 of 48
4,4'-DDT	0.00214	0.00574	0.002	0.0017	0.002	0.000967	0.00221	0.00316	0.00225	0.000929	0.00224	0.000787	0.0021	0.00857	9 of 48
ALDRIN	0.00214	0.000928	0.002	0.000881	0.002	0.000967	0.00221	0.000786	0.00225	0.000929	0.00224	0.000787	0.00146	0.00238	0 of 48
ALPHA-BHC	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
ALPHA-CHLORDANE	0.00214	0.00235	0.002	0.00241	0.002	0.00253	0.00221	0.00266	0.00225	0.00421	0.00402	0.00298	0.00269	0.00575	25 of 48
AROCLOR-1016	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
AROCLOR-1221	0.107	0.127	0.1	0.104	0.1	0.118	0.111	0.104	0.113	0.104	0.112	0.107	0.109	0.13	0 of 25
AROCLOR-1232	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
AROCLOR-1242	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
AROCLOR-1248	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
AROCLOR-1254	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
AROCLOR-1260	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
BETA-BHC	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
C13-4,4'-DDT (SURR)		0.0927		0.0779		0.0306		0.0635		0.0383		0.058	0.0578	0.106	23 of 23
C13-GAMMA-BHC (SURR)		0.0848		0.0512		0.0584		0.065		0.0559		0.0629	0.0615	0.105	23 of 23
CHLORDANE (TECHNICAL)	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
CIS-NONACHLOR		0.00038		0.000331		0.000238		0.000414		0.000768		0.000349	0.00042	0.000814	23 of 23
DDMU		0.00012		0.000122		0.000115		0.000139		0.000154		0.000105	0.000128	0.000215	0 of 23
DELTA-BHC	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
DIELDRIN	0.00214	0.000928	0.002	0.000881	0.002	0.000967	0.00221	0.000786	0.00225	0.000929	0.00224	0.000787	0.00146	0.00238	0 of 48
ENDOSULFAN I	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
ENDOSULFAN II	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
ENDOSULFAN SULFATE	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
ENDRIN	0.00214	0.000928	0.002	0.000881	0.002	0.000967	0.00221	0.000786	0.00225	0.000929	0.00224	0.000787	0.00146	0.00238	0 of 48
ENDRIN ALDEHYDE	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
ENDRIN KETONE	0.00214	0.00254	0.002	0.00208	0.002	0.00235	0.00221	0.00208	0.00225	0.00207	0.00224	0.00215	0.00218	0.0026	0 of 25
GAMMA-BHC (LINDANE)	0.00214	0.000928	0.072	0.000881	0.002	0.000967	0.00221	0.000786	0.00225	0.000929	0.00224	0.000787	0.00576	0.114	2 of 48
GAMMA-CHLORDANE	0.00214	0.00236	0.002	0.00231	0.002	0.00242	0.00221	0.00288	0.00225	0.00405	0.00333	0.00355	0.00267	0.00487	25 of 48
HEPTACHLOR	0.00214	0.000928	0.002	0.000881	0.002	0.000967	0.00221	0.000786	0.00225	0.000929	0.00224	0.000787	0.00146	0.00238	0 of 48
HEPTACHLOR EPOXIDE	0.00214	0.000928	0.002	0.000881	0.002	0.000967	0.00221	0.000786	0.00225	0.000929	0.00224	0.000787	0.00146	0.00238	0 of 48
HEXAACHLOROBENZENE		0.000508		0.000407		0.000216		0.000233		0.00044		0.000236	0.000333	0.000534	23 of 23
METHOXYCHLOR	0.0214	0.0254	0.02	0.0208	0.02	0.0235	0.0221	0.0208	0.0225	0.0207	0.0224	0.0215	0.0218	0.026	0 of 25
MIREX		0.00012		0.000122		0.000115		0.000139		0.000154		0.000105	0.000128	0.000215	0 of 23
OXYCHLORDANE		0.00012		0.000122		0.000115		0.000139		0.000154		0.000105	0.000128	0.000215	0 of 23
TOTAL CHLORDANE		0.00381		0.00395		0.00348		0.00462		0.00851		0.0046	0.00493	0.0105	23 of 23
TOTAL DDT		0.0168		0.00443		0.00487		0.0279		0.00112		0.00183	0.00949	0.0421	21 of 23
TOXAPHENE	0.0536	0.0636	0.05	0.052	0.05	0.0589	0.0554	0.052	0.0564	0.0518	0.0561	0.0537	0.0544	0.0649	0 of 25
TRANS-NONACHLOR		0.00156		0.00137		0.000911		0.00166		0.00302		0.00141	0.00168	0.00382	23 of 23

Table A-4. Deer Island Influent Characterization (North System), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
1,2-DICHLOROBENZENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
1,3-DICHLOROBENZENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
1,4-DICHLOROBENZENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2,2'-OXYBIS(1-CHLOROPROPANE)	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2,4,5-TRICHLOROPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2,4,6-TRICHLOROPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2,4-DICHLOROPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2,4-DIMETHYLPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2,4-DINITROPHENOL	2.02	2.44	2	2.13	2.1	2.33	2.18	2.02	2.31	2.1	2.16	2.13	2.16	2.63	0 of 25
2,4-DINITROTOLUENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2,6-DINITROTOLUENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2-CHLORONAPHTHALENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2-CHLOROPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2-METHYL-4,6-DINITROPHENOL	10.1	12.2	10	10.7	10.5	11.6	10.9	10.1	11.6	10.5	10.8	10.7	10.8	13.2	0 of 25
2-METHYLNAPHTHALENE	1.01	4.19	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.27	6.63	1 of 25
2-METHYLPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2-NITROANILINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
2-NITROPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
3,3'-DICHLOROBENZIDINE	2.02	2.44	2	2.13	2.1	2.33	2.18	2.02	2.31	2.1	2.16	2.13	2.16	2.63	0 of 25
3-NITROANILINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
4-BROMOPHENYL PHENYL ETHER	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
4-CHLORO-3-METHYLPHENOL	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
4-CHLOROANILINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
4-CHLOROPHENYL PHENYL ETHER	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	14.8	11.6	12.9	12.9	3.06	10.8	1.09	9.15	9.73	12.9	13.9	12.3	10.3	30.1	18 of 25
4-NITROANILINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
4-NITROPHENOL	2.02	2.44	2	2.13	2.1	2.33	2.18	2.02	2.31	2.1	2.16	2.13	2.16	2.63	0 of 25
ACENAPHTHENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
ACENAPHTHYLENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
ANILINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
ANTHRACENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
BENZIDINE	5.06	6.1	5	5.33	5.26	5.82	5.46	5.05	5.78	5.24	5.39	5.33	5.41	6.58	0 of 25
BENZO(A)ANTHRACENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
BENZO(A)PYRENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25

Table A-4. Deer Island Influent Characterization (North System), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
BENZO(GHI)PERYLENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
BENZO(K)FLUORANTHENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
BENZOIC ACID	8.71	13.2	6.77	2.13	2.1	18.4	2.18	2.02	2.31	8.17	2.16	2.13	5.84	50.5	5 of 25
BENZYL ALCOHOL	14.4	17.5	11.3	10.5	17.4	5.33	1.09	1.01	6.27	5.31	7.4	6.1	7.67	23.6	17 of 25
BIS(2-CHLOROETHOXY)METHANE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
BIS(2-CHLOROETHYL)ETHER	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
BIS(2-ETHYLHEXYL)PHTHALATE	15	17.3	18	9.75	15.1	11.6	7.05	14	17.2	11.8	6.86	12.4	12.6	23.6	24 of 25
BUTYL BENZYL PHTHALATE	1.01	1.22	1	1.07	2.98	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.19	5.1	1 of 25
CARBAZOLE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
CHRYSENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
DIBENZO(A,H)ANTHRACENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
DIBENZOFURAN	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
DIETHYL PHTHALATE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
DIMETHYL PHTHALATE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
DI-N-BUTYLPHthalate	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
DI-N-OCTYLPHthalate	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
FLUORANTHENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
FLUORENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
HEXACHLOROBENZENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
HEXACHLOROBUTADIENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
HEXACHLOROCYCLOPENTADIENE	5.06	6.1	5	5.33	5.26	5.82	5.46	5.05	5.78	5.24	5.39	5.33	5.41	6.58	0 of 25
HEXACHLOROETHANE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
INDENO(1,2,3-CD)PYRENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
ISOPHORONE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
NAPHTHALENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
N-DECANE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
NITROBENZENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
N-NITROSODIMETHYLAMINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
N-NITROSODI-N-PROPYLAMINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
N-NITROSODIPHENYLAMINE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
N-OCTADECANE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
PENTACHLOROPHENOL	3.04	3.66	3	3.2	3.16	3.49	3.28	3.03	3.47	3.14	3.23	3.2	3.24	3.95	0 of 25
PHENANTHRENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25
PHENOL	2.02	2.44	2	2.13	2.1	2.33	2.18	2.02	2.31	2.1	2.16	2.13	2.16	2.63	0 of 25
PYRENE	1.01	1.22	1	1.07	1.05	1.16	1.09	1.01	1.16	1.05	1.08	1.07	1.08	1.32	0 of 25

Table A-4. Deer Island Influent Characterization (North System), FY05 (cont.)

Volatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1,2,2-TETRACHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1,2-TRICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1-DICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROPROPANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,3-DICHLOROBENZENE	1.63	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.585	2.51	1 of 24
1,4-DICHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
2-BUTANONE	0.5	0.5	1.65	0.5	0.5	0.5	0.5	1.43	2.87	0.5	0.5	0.5	0.875	3.11	4 of 24
2-CHLOROETHYL VINYL ETHER	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
2-HEXANONE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
4-METHYL-2-PENTANONE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
ACETONE	96.6	115	326	102	131	102	68.1	51.3	67.3	78.3	71	104	102	573	24 of 24
ACROLEIN	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
ACRYLONITRILE	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
BENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMODICHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMOFORM	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMOMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CARBON DISULFIDE	0.5	0.5	0.5	0.5	0.5	3.14	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.657	5.8
CARBON TETRACHLORIDE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROFORM	8.75	11.1	6.2	6.9	7.54	6.39	5.16	7.67	7.22	6.03	10.4	11.4	7.69	12.2	24 of 24
CHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CIS-1,2-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CIS-1,3-DICHLOROPROPENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
DIBROMOCHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
ETHYLBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
M,P-XYLENE	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
METHYLENE CHLORIDE	0.5	2.31	0.837	1.01	0.5	0.834	0.5	0.871	0.5	0.5	1.44	0.5	0.796	4.07	8 of 24
O-XYLENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
STYRENE	0.5	0.5	0.5	0.5	0.5	6.96	0.5	2.23	0.5	0.5	0.5	0.5	1.08	13.5	2 of 24
TETRACHLOROETHENE	1.99	0.5	0.5	0.5	1.7	0.5	9.48	1.65	4.66	0.5	0.5	0.5	2.18	19.7	6 of 24
TOLUENE	5.34	6.42	3.51	3.39	4	2.85	0.5	1.68	3.39	0.5	3.71	3.41	2.92	7.69	19 of 24
TRANS-1,2-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRANS-1,3-DICHLOROPROPENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	3.65	3.61	0.5	1.07	3.99
TRICHLOROFLUOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
VINYL ACETATE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
VINYL CHLORIDE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24

Notes

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-5. Deer Island Influent Loadings (North System), FY05

Metals (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ANTIMONY	23.4	21	20.7	22.3	19	34.2	34.6	35.6	30.9	34.7	25.6	24.8	27	45.9	0 of 25
ARSENIC	2.53	2.86	2.4	2.41	2.49	3.4	1.91	1.14	3.15	1.11	0.819	0.793	2.1	6.08	14 of 25
BERYLLIUM	0.468	0.42	0.415	0.445	0.381	0.683	0.693	0.713	0.618	0.694	0.512	0.496	0.541	0.919	0 of 25
BORON	234	210	207	223	190	342	346	356	309	347	256	248	270	459	0 of 25
CADMIUM	0.965	0.59	0.718	0.635	0.536	0.677	1.54	1.93	1.42	1.23	0.73	0.852	0.971	2.29	25 of 25
CHROMIUM	10.6	9.55	15	6.27	6.43	11.5	12.8	22.7	17.5	10.4	5.87	6.17	11	37.5	25 of 25
COPPER	191	137	150	82.5	98.1	137	118	235	215	142	105	105	141	299	25 of 25
HEXAVALENT CHROMIUM	5.04	3.77	4.18	4.51	4.02	7.59	7.56	5.98	6.31	7.35	4.96	6.19	5.62	9.1	0 of 24
IRON	5350	4160	4710	3100	3400	4560	6160	9540	6930	5330	3270	4320	4990	14100	25 of 25
LEAD	33.2	24.5	34.3	11.4	12.1	47.4	54.6	86.3	64.2	31.7	20	11	34.9	146	25 of 25
MERCURY	0.461	0.306	0.352	0.348	0.17	0.357	0.284	0.489	0.713	0.558	0.386	0.631	0.418	1.05	26 of 26
MOLYBDENUM	27.2	18.9	18.4	8.32	9.21	21.9	14.6	25.6	20.7	8.02	38.7	19.8	18.8	44.8	25 of 25
NICKEL	9.05	8.36	8.22	5.41	6.06	5.24	13.3	15.4	9.88	9.98	5.28	6.95	8.47	24.2	25 of 25
SELENIUM	0.842	0.756	0.747	0.801	0.685	1.23	1.25	1.28	1.11	1.25	0.921	0.893	0.973	1.65	0 of 25
SILVER	4.34	3.88	4.17	2.05	3.18	4.42	3.48	5.42	3.75	3.28	3.95	3.4	3.71	5.88	25 of 25
THALLIUM	0.936	0.84	0.83	0.89	0.761	1.37	1.39	1.43	1.24	1.39	1.02	0.992	1.08	1.84	0 of 25
ZINC	343	242	258	156	190	287	324	495	390	292	188	245	279	691	25 of 25
Cyanide (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
CYANIDE	10.1	7.55	8.46	9.03	8.04	15.2	15.1	12	12.6	14.7	9.92	12.4	11.4	18.2	0 of 23
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
FATS OIL AND GREASE	80600	69800	323000	69800	77700	113000	48300	75600	93000	45300	86100	74400	96400	575000	24 of 24
MBAS	7880	7960	9110	6650	6510	7480	3380	6210	6230	6840	6650	8120	6910	11500	25 of 25
PETROLEUM HYDROCARBON	1540	1660	8460	1610	3670	2060	1720	4310	2330	916	5420	21500	4600	39200	24 of 24

Table A-5. Deer Island Influent Loadings (North System), FY05 (cont.)

Organochlorine Pesticides and PCBs (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
2,4'-DDD		0.000202		0.00155		0.00302		0.0618		0.000427		0.000208	0.0105	0.123	9 of 23
2,4'-DDE		0.000202		0.000218		0.000315		0.000397		0.000427		0.000208	0.000289	0.000581	0 of 23
2,4'-DDT		0.000202		0.000218		0.000315		0.000397		0.000427		0.000208	0.000289	0.000581	0 of 23
4,4'-DDD	0.00401	0.00451	0.00332	0.00157	0.00304	0.00603	0.00613	0.00224	0.00557	0.00258	0.00459	0.00156	0.00368	0.0101	6 of 48
4,4'-DDE	0.00401	0.00888	0.00332	0.00383	0.00304	0.00557	0.00613	0.0068	0.00557	0.00392	0.0045	0.00384	0.00491	0.0136	22 of 48
4,4'-DDT	0.00401	0.00964	0.00332	0.00303	0.00304	0.00264	0.00613	0.00902	0.00557	0.00258	0.00459	0.00156	0.00453	0.0164	9 of 48
ALDRIN	0.00401	0.00156	0.00332	0.00157	0.00304	0.00264	0.00613	0.00224	0.00557	0.00258	0.00459	0.00156	0.00317	0.00697	0 of 48
ALPHA-BHC	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
ALPHA-CHLORDANE	0.00401	0.00395	0.00332	0.00429	0.00304	0.00692	0.00613	0.00758	0.00557	0.0117	0.00822	0.0059	0.00582	0.016	25 of 48
AROCLOR-1016	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
AROCLOR-1221	0.2	0.214	0.166	0.185	0.152	0.322	0.308	0.297	0.278	0.288	0.229	0.213	0.236	0.462	0 of 25
AROCLOR-1232	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
AROCLOR-1242	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
AROCLOR-1248	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
AROCLOR-1254	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
AROCLOR-1260	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
BETA-BHC	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
C13-4,4'-DDT (SURR)		0.156		0.139		0.0838		0.181		0.106		0.115	0.131	0.236	23 of 23
C13-GAMMA-BHC (SURR)		0.142		0.0911		0.16		0.185		0.155		0.125	0.139	0.24	23 of 23
CHLORDANE (TECHNICAL)	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
CIS-NONACHLOR				0.000638		0.00059		0.000651		0.00118		0.00213	0.000692	0.000951	0.00252
DDMU		0.000202		0.000218		0.000315		0.000397		0.000427		0.000208	0.000289	0.000581	0 of 23
DELTA-BHC	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
DIELDRIN	0.00401	0.00156	0.00332	0.00157	0.00304	0.00264	0.00613	0.00224	0.00557	0.00258	0.00459	0.00156	0.00317	0.00697	0 of 48
ENDOSULFAN I	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
ENDOSULFAN II	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
ENDOSULFAN SULFATE	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
ENDRIN	0.00401	0.00156	0.00332	0.00157	0.00304	0.00264	0.00613	0.00224	0.00557	0.00258	0.00459	0.00156	0.00317	0.00697	0 of 48
ENDRIN ALDEHYDE	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
ENDRIN KETONE	0.00401	0.00427	0.00332	0.00371	0.00304	0.00643	0.00613	0.00593	0.00557	0.00575	0.00459	0.00426	0.00471	0.00921	0 of 25
GAMMA-BHC (LINDANE)	0.00401	0.00156	0.119	0.00157	0.00304	0.00264	0.00613	0.00224	0.00557	0.00258	0.00459	0.00156	0.0125	0.19	2 of 48
GAMMA-CHLORDANE	0.00401	0.00396	0.00332	0.00412	0.00304	0.00661	0.00613	0.00822	0.00557	0.0112	0.00681	0.00704	0.00577	0.0151	25 of 48
HEPTACHLOR	0.00401	0.00156	0.00332	0.00157	0.00304	0.00264	0.00613	0.00224	0.00557	0.00258	0.00459	0.00156	0.00317	0.00697	0 of 48
HEPTACHLOR EPOXIDE	0.00401	0.00156	0.00332	0.00157	0.00304	0.00264	0.00613	0.00224	0.00557	0.00258	0.00459	0.00156	0.00317	0.00697	0 of 48
HEXAACHLOROBENZENE				0.000853		0.000724		0.000591		0.000665		0.00122	0.000468	0.000752	0.00158
METHOXYCHLOR	0.0401	0.0427	0.0332	0.0371	0.0304	0.0643	0.0613	0.0593	0.0557	0.0575	0.0459	0.0426	0.0471	0.0921	0 of 25
MIREX		0.000202		0.000218		0.000315		0.000397		0.000427		0.000208	0.000289	0.000581	0 of 23
OXYCHLORDANE		0.000202		0.000218		0.000315		0.000397		0.000427		0.000208	0.000289	0.000581	0 of 23
TOTAL CHLORDANE		0.00641		0.00703		0.00952		0.0132		0.0236		0.00911	0.0111	0.0325	23 of 23
TOTAL DDT				0.0282		0.00789		0.0133		0.0795		0.00311	0.00363	0.0215	0.155
TOXAPHENE	0.1	0.107	0.083	0.0926	0.0761	0.161	0.153	0.148	0.139	0.144	0.115	0.107	0.118	0.23	0 of 25
TRANS-NONACHLOR				0.00261		0.00243		0.00249		0.00474		0.0084	0.0028	0.0038	0.0118

Table A-5. Deer Island Influent Loadings (North System), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
1,2-DICHLOROBENZENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
1,3-DICHLOROBENZENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
1,4-DICHLOROBENZENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2,2'-OXYBIS(1-CHLOROPROPANE)	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2,4,5-TRICHLOROPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2,4,6-TRICHLOROPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2,4-DICHLOROPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2,4-DIMETHYLPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2,4-DINITROPHENOL	3.79	4.1	3.32	3.8	3.2	6.36	6.05	5.76	5.72	5.82	4.41	4.23	4.68	8.56	0 of 25
2,4-DINITROTOLUENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2,6-DINITROTOLUENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2-CHLORONAPHTHALENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2-CHLOROPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2-METHYL-4,6-DINITROPHENOL	18.9	20.5	16.6	19	16	31.8	30.3	28.8	28.6	29.1	22.1	21.2	23.4	42.8	0 of 25
2-METHYLNAPHTHALENE	1.89	7.04	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.74	12.4	1 of 25
2-METHYLPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2-NITROANILINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
2-NITROPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
3,3'-DICHLOROBENZIDINE	3.79	4.1	3.32	3.8	3.2	6.36	6.05	5.76	5.72	5.82	4.41	4.23	4.68	8.56	0 of 25
3-NITROANILINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
4-BROMOPHENYL PHENYL ETHER	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
4-CHLORO-3-METHYLPHENOL	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
4-CHLOROANILINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
4-CHLOROPHENYL PHENYL ETHER	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	27.7	19.5	21.4	22.9	4.66	29.6	3.03	26.1	24.1	35.9	28.5	24.3	22.3	69.2	18 of 25
4-NITROANILINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
4-NITROPHENOL	3.79	4.1	3.32	3.8	3.2	6.36	6.05	5.76	5.72	5.82	4.41	4.23	4.68	8.56	0 of 25
ACENAPHTHENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
ACENAPHTHYLENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
ANILINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
ANTHRACENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
BENZIDINE	9.47	10.2	8.3	9.5	8.01	15.9	15.1	14.4	14.3	14.5	11	10.6	11.7	21.4	0 of 25
BENZO(A)ANTHRACENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
BENZO(A)PYRENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25

Table A-5. Deer Island Influent Loadings (North System), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
BENZO(GHI)PERYLENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
BENZO(K)FLUORANTHENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
BENZOIC ACID	16.3	22.2	11.2	3.8	3.2	50.4	6.05	5.76	5.72	22.7	4.41	4.23	12.6	92.2	5 of 25
BENZYL ALCOHOL	26.9	29.4	18.7	18.6	26.4	14.6	3.03	2.88	15.5	14.8	15.1	12.1	16.6	42.4	17 of 25
BIS(2-CHLOROETHOXY)METHANE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
BIS(2-CHLOROETHYL)ETHER	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
BIS(2-ETHYLHEXYL)PHTHALATE	28.1	29	29.8	17.4	23	31.8	19.5	39.8	42.6	32.8	14	24.6	27.3	57.4	24 of 25
BUTYL BENZYL PHTHALATE	1.89	2.05	1.66	1.9	4.54	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.57	7.3	1 of 25
CARBAZOLE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
CHRYSENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
DIBENZO(A,H)ANTHRACENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
DIBENZOFURAN	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
DIETHYL PHTHALATE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
DIMETHYL PHTHALATE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
DI-N-BUTYLPHTHALATE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
DI-N-OCTYLPHTHALATE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
FLUORANTHENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
FLUORENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
HEXACHLOROBENZENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
HEXACHLOROBUTADIENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
HEXACHLOROCYCLOPENTADIENE	9.47	10.2	8.3	9.5	8.01	15.9	15.1	14.4	14.3	14.5	11	10.6	11.7	21.4	0 of 25
HEXACHLOROETHANE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
INDENO(1,2,3-CD)PYRENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
ISOPHORONE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
NAPHTHALENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
N-DECANE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
NITROBENZENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
N-NITROSODIMETHYLAMINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
N-NITROSODI-N-PROPYLAMINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
N-NITROSODIPHENYLAMINE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
N-OCTADECANE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
PENTACHLOROPHENOL	5.68	6.15	4.98	5.7	4.81	9.55	9.08	8.64	8.58	8.73	6.62	6.35	7.02	12.8	0 of 25
PHENANTHRENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25
PHENOL	3.79	4.1	3.32	3.8	3.2	6.36	6.05	5.76	5.72	5.82	4.41	4.23	4.68	8.56	0 of 25
PYRENE	1.89	2.05	1.66	1.9	1.6	3.18	3.03	2.88	2.86	2.91	2.21	2.12	2.34	4.28	0 of 25

Table A-5. Deer Island Influent Loadings (North System), FY05 (cont.)

Volatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,1,2,2-TETRACHLOROETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,1,2-TRICHLOROETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,1-DICHLOROETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,1-DICHLOROETHENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,2-DICHLOROBENZENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,2-DICHLOROETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,2-DICHLOROPROpane	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
1,3-DICHLOROBENZENE	3.29	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.31	5.7	1 of 24
1,4-DICHLOROBENZENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
2-BUTANONE	1.01	0.755	2.76	0.903	0.804	1.52	1.51	3.41	7.24	1.47	0.992	1.24	1.97	7.62	4 of 24
2-CHLOROETHYL VINYL ETHER	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
2-HEXANONE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
4-METHYL-2-PENTANONE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
ACETONE	195	174	545	185	210	309	206	123	170	230	141	257	229	970	24 of 24
ACROLEIN	2.01	1.51	1.67	1.81	1.61	3.04	3.02	2.39	2.52	2.94	1.98	2.48	2.25	3.64	0 of 24
ACRYLONITRILE	2.01	1.51	1.67	1.81	1.61	3.04	3.02	2.39	2.52	2.94	1.98	2.48	2.25	3.64	0 of 24
BENZENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
BROMODICHLOROMETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
BROMOFORM	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
BROMOMETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
CARBON DISULFIDE	1.01	0.755	0.836	0.903	5.05	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.48	9.3	1 of 24
CARBON TETRACHLORIDE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
CHLOROBENZENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
CHLOROETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
CHLOROFORM	17.6	16.7	10.4	12.5	12.1	19.4	15.6	18.3	18.2	17.7	20.7	28.1	17.3	35.4	24 of 24
CHLOROMETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
CIS-1,2-DICHLOROETHENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
CIS-1,3-DICHLOROPROPENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
DIBROMOCHLOROMETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
ETHYLBENZENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
M,P-XYLENE	2.01	1.51	1.67	1.81	1.61	3.04	3.02	2.39	2.52	2.94	1.98	2.48	2.25	3.64	0 of 24
METHYLENE CHLORIDE	1.01	3.49	1.4	1.83	0.804	2.53	1.51	2.08	1.26	1.47	2.86	1.24	1.79	6.23	8 of 24
O-XYLENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
STYRENE	1.01	0.755	0.836	0.903	11.2	1.52	6.74	1.2	1.26	1.47	0.992	1.24	2.43	21.6	2 of 24
TETRACHLOROETHENE	4.01	0.755	0.836	0.903	2.74	1.52	28.7	3.95	11.8	1.47	0.992	1.24	4.9	55.7	6 of 24
TOLUENE	10.8	9.7	5.88	6.13	6.44	8.65	1.51	4.01	8.57	1.47	7.35	8.44	6.58	13.9	19 of 24
TRANS-1,2-DICHLOROETHENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
TRANS-1,3-DICHLOROPROPENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
TRICHLOROETHENE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	10.7	7.16	1.24	2.41	11.4	4 of 24
TRICHLOROFLUOROMETHANE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
VINYL ACETATE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24
VINYL CHLORIDE	1.01	0.755	0.836	0.903	0.804	1.52	1.51	1.2	1.26	1.47	0.992	1.24	1.12	1.82	0 of 24

Notes

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-6. Deer Island Influent Characterization (South System), FY05

Metals (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ANTIMONY	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	0 of 24
ARSENIC	1.12	0.4	0.4	0.817	0.4	0.4	1.95	0.4	1	0.4	0.4	0.4	0.7	2.03	6 of 24
BERYLLIUM	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0 of 24
BORON	278	294	245	125	125	125	125	125	125	125	125	125	149	367	5 of 24
CADMIUM	0.695	0.244	0.248	0.346	0.171	0.27	1.2	0.724	0.6	0.264	0.785	0.343	0.509	1.28	24 of 24
CHROMIUM	7.3	3.42	5.53	4.31	2.33	3.34	10.1	5.73	4.78	1.57	5.28	2.22	4.54	11.2	25 of 25
COPPER	176	80.6	69.5	88.8	54.5	53.8	164	114	74	19.9	84.6	45.5	80.3	257	24 of 24
HEXAVALENT CHROMIUM	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	0 of 24
IRON	4600	1910	1710	2860	1490	1810	5410	3810	2480	887	2790	1580	2550	7020	24 of 24
LEAD	14.3	8.31	5.51	11.6	4.56	8.24	24.7	11.9	10.7	2.51	8.52	3.07	9.43	25.5	23 of 24
MERCURY	0.426	0.188	0.106	0.276	0.203	0.117	0.866	0.599	0.786	0.0565	0.208	0.0971	0.332	1.05	25 of 25
MOLYBDENUM	12.4	6.02	6.19	5.31	4.62	2.58	4.75	6.04	2.63	4.29	4.67	4.71	4.97	17.6	25 of 25
NICKEL	6.73	4.44	15	4.63	2.96	2.47	7.91	4.22	5.29	2.25	4.25	2.48	4.81	20.9	24 of 24
SELENIUM	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0 of 24
SILVER	5.58	1.84	1.9	2.51	1.38	1.67	4.88	2.73	2.02	0.635	2.48	1.36	2.29	9.34	25 of 25
THALLIUM	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
ZINC	287	132	119	166	98.9	100	338	234	180	53.1	147	90.8	157	423	24 of 24
Cyanide (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
CYANIDE	5	5	5	5	5	5	5	5	5	5	5	5	5	5	0 of 23
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (mg/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
FATS OIL AND GREASE	59.7	55	74.7	39.4	48.1	30	58.6	79.3	46	15.4	65.1	34.2	46.9	90.8	24 of 24
MBAS	5.73	6.42	6.71	4.12	5.01	3.11	2.84	4.2	3.47	1.68	3.01	3.65	3.7	7.75	24 of 24
PETROLEUM HYDROCARBON	1.24	1.39	2.95	1.12	1.38	0.618	2.29	5.56	1.5	0.35	6.57	0.888	2.04	10	24 of 24

Table A-6. Deer Island Influent Characterization (South System), FY05 (cont.)

Organochlorine Pesticides and PCBs (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
2,4'-DDD		0.00477		0.00254		0.0169		0.00197		0.000124		0.000105	0.00376	0.0292	14 of 24
2,4'-DDE		0.000103		0.0001		0.000142		0.000111		0.000124		0.000105	0.000116	0.000168	0 of 24
2,4'-DDT		0.000103		0.000387		0.000142		0.000111		0.000124		0.000105	0.000157	0.00069	1 of 24
4,4'-DDD	0.00258	0.00154	0.00206	0.000809	0.0023	0.000853	0.00281	0.00168	0.00207	0.00105	0.00204	0.000778	0.00165	0.00318	9 of 48
4,4'-DDE	0.00258	0.0027	0.00206	0.0022	0.0023	0.00238	0.00633	0.00632	0.00207	0.00185	0.00304	0.00174	0.003	0.00659	29 of 48
4,4'-DDT	0.00258	0.000768	0.00206	0.00128	0.0023	0.000853	0.00219	0.00301	0.00207	0.00166	0.00214	0.000778	0.00179	0.00385	6 of 48
ALDRIN	0.00258	0.000768	0.00206	0.000809	0.0023	0.000853	0.00219	0.000773	0.00207	0.00105	0.00214	0.000778	0.00148	0.00312	0 of 48
ALPHA-BHC	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
ALPHA-CHLORDANE	0.00258	0.00922	0.00206	0.00408	0.0023	0.00342	0.0174	0.0103	0.0126	0.00775	0.00822	0.00486	0.0078	0.0182	34 of 48
ACOCLOR-1016	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0547	0.0524	0.0517	0.0723	0.0535	0.0532	0.0576	0.0926	0 of 24
ACOCLOR-1221	0.129	0.105	0.103	0.112	0.115	0.114	0.11	0.105	0.103	0.145	0.107	0.106	0.115	0.185	0 of 24
ACOCLOR-1232	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0547	0.0524	0.0517	0.0723	0.0535	0.0532	0.0576	0.0926	0 of 24
ACOCLOR-1242	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0547	0.0524	0.0517	0.0723	0.0535	0.0532	0.0576	0.0926	0 of 24
ACOCLOR-1248	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0547	0.0524	0.0517	0.0723	0.0535	0.0532	0.0576	0.0926	0 of 24
ACOCLOR-1254	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0547	0.114	0.0517	0.0723	0.0535	0.0532	0.0622	0.138	2 of 24
ACOCLOR-1260	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0595	0.0985	0.0517	0.0723	0.0535	0.0532	0.0616	0.12	3 of 24
BETA-BHC	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
C13-4,4'-DDT (SURR)		0.0925		0.0803		0.0538		0.0672		0.0566		0.0581	0.0647	0.0988	24 of 24
C13-GAMMA-BHC (SURR)		0.0693		0.0496		0.0614		0.0838		0.0521		0.055	0.0597	0.085	24 of 24
CHLORDANE (TECHNICAL)	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0547	0.0524	0.0517	0.0723	0.0535	0.0532	0.0576	0.0926	0 of 24
CIS-NONACHLOR		0.000717		0.000663		0.000627		0.000638		0.00128		0.00049	0.000822	0.00152	24 of 24
DDMU		0.000103		0.0001		0.000142		0.000111		0.000124		0.000105	0.000116	0.000168	0 of 24
DELTA-BHC	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
DIELDRIN	0.00258	0.000768	0.00206	0.000809	0.0023	0.000853	0.00219	0.000773	0.00207	0.00105	0.00214	0.000778	0.00148	0.00312	0 of 48
ENDOSULFAN I	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
ENDOSULFAN II	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
ENDOSULFAN SULFATE	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
ENDRIN	0.00258	0.000768	0.00206	0.000809	0.0023	0.000853	0.00219	0.000773	0.00207	0.00105	0.00214	0.000778	0.00148	0.00312	0 of 48
ENDRIN ALDEHYDE	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
ENDRIN KETONE	0.00258	0.0021	0.00206	0.00223	0.0023	0.00227	0.00219	0.0021	0.00207	0.00289	0.00214	0.00212	0.0023	0.0037	0 of 24
GAMMA-BHC (LINDANE)	0.00258	0.000768	0.00206	0.000809	0.0023	0.000853	0.00219	0.000773	0.00207	0.00105	0.00214	0.000778	0.00148	0.00312	0 of 48
GAMMA-CHLORDANE	0.00258	0.00912	0.00206	0.00373	0.0023	0.00341	0.0198	0.0128	0.0137	0.00812	0.00842	0.00598	0.0085	0.0211	34 of 48
HEPTACHLOR	0.00258	0.000768	0.00206	0.000809	0.0023	0.000853	0.00219	0.000773	0.00207	0.00105	0.00214	0.000778	0.00148	0.00312	0 of 48
HEPTACHLOR EPOXIDE	0.00258	0.000768	0.00206	0.000809	0.0023	0.000853	0.00219	0.000773	0.00207	0.00105	0.00214	0.000778	0.00148	0.00312	0 of 48
HEXAChLOROBENZENE		0.000319		0.000178		0.00013		0.000274		0.000127		0.000105	0.00017	0.000368	24 of 24
METHOXYCHLOR	0.0258	0.021	0.0206	0.0223	0.023	0.0227	0.0219	0.021	0.0207	0.0289	0.0214	0.0212	0.023	0.037	0 of 24
MIREX		0.000103		0.0001		0.000142		0.000111		0.000124		0.000105	0.000116	0.000168	0 of 24
OXYCHLORDANE		0.000103		0.0001		0.000142		0.000111		0.000124		0.000105	0.000116	0.000168	0 of 24
TOTAL CHLORDANE		0.00812		0.00738		0.00627		0.00961		0.0155		0.00656	0.00998	0.0183	24 of 24
TOTAL DDT		0.00903		0.00579		0.0193		0.00749		0.00231		0.00154	0.00667	0.0325	24 of 24
TOXAPHENE	0.0647	0.0526	0.0516	0.0557	0.0574	0.0568	0.0547	0.0524	0.0517	0.0723	0.0535	0.0532	0.0576	0.0926	0 of 24
TRANS-NONACHLOR		0.00317		0.00237		0.00228		0.00309		0.00536		0.00211	0.00342	0.00639	24 of 24

Table A-6. Deer Island Influent Characterization (South System), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
1,2-DICHLOROBENZENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
1,3-DICHLOROBENZENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
1,4-DICHLOROBENZENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2,2'-OXYBIS(1-CHLOROPROPANE)	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2,4,5-TRICHLOROPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2,4,6-TRICHLOROPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2,4-DICHLOROPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2,4-DIMETHYLPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2,4-DINITROPHENOL	2.33	2.02	2.1	2	2.32	2.39	2.11	2.07	2.13	2.57	2.08	2.07	2.21	3.03	0 of 24
2,4-DINITROTOLUENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2,6-DINITROTOLUENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2-CHLORONAPHTHALENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2-CHLOROPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2-METHYL-4,6-DINITROPHENOL	11.7	10.1	10.5	10	11.6	12	10.6	10.4	10.6	12.9	10.4	10.3	11.1	15.2	0 of 24
2-METHYLNAPHTHALENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2-METHYLPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2-NITROANILINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
2-NITROPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
3,3'-DICHLOROBENZIDINE	2.33	2.02	2.1	2	2.32	2.39	2.11	2.07	2.13	2.57	2.08	2.07	2.21	3.03	0 of 24
3-NITROANILINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
4-BROMOPHENYL PHENYL ETHER	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
4-CHLORO-3-METHYLPHENOL	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
4-CHLOROANILINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
4-CHLOROPHENYL PHENYL ETHER	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	34	22.4	26	3.46	29.9	10.8	3.22	16.3	10.1	1.29	12.8	5.21	11.7	44.4	17 of 24
4-NITROANILINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
4-NITROPHENOL	2.33	2.02	2.1	2	2.32	2.39	2.11	2.07	2.13	2.57	2.08	2.07	2.21	3.03	0 of 24
ACENAPHTHENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
ACENAPHTHYLENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
ANILINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
ANTHRACENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
BENZIDINE	5.83	5.05	5.25	5	5.79	5.98	5.28	5.18	5.32	6.44	5.2	5.17	5.53	7.58	0 of 24
BENZO(A)ANTHRACENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
BENZO(A)PYRENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24

Table A-6. Deer Island Influent Characterization (South System), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
BENZO(GHI)PERYLENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
BENZO(K)FLUORANTHENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
BENZOIC ACID	2.33	6.7	2.1	2	2.32	2.39	2.11	2.07	2.13	2.57	2.08	2.07	2.46	11.5	1 of 24
BENZYL ALCOHOL	19.2	9.78	17.5	1	17.6	4.14	1.06	7.58	8.81	1.29	8.57	7.6	7.09	24.3	15 of 24
BIS(2-CHLOROETHOXY)METHANE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
BIS(2-CHLOROETHYL)ETHER	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
BIS(2-ETHYLHEXYL)PHTHALATE	19.8	9.11	12.3	6.14	13.2	9.72	22.9	24.1	10.1	1.29	7.3	8.81	11.2	33.5	21 of 24
BUTYL BENZYL PHTHALATE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
CARBAZOLE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
CHRYSENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
DIBENZO(A,H)ANTHRACENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
DIBENZOFURAN	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
DIETHYL PHTHALATE	17	1.01	1.05	1	3.97	1.2	1.06	1.04	1.06	1.29	1.04	1.03	2.11	31.9	2 of 24
DIMETHYL PHTHALATE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
DI-N-BUTYLPHTHALATE	3.55	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.23	5.66	1 of 24
DI-N-OCTYLPHTHALATE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
FLUORANTHENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
FLUORENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
HEXACHLOROBENZENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
HEXACHLOROBUTADIENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
HEXACHLOROCYCLOPENTADIENE	5.83	5.05	5.25	5	5.79	5.98	5.28	5.18	5.32	6.44	5.2	5.17	5.53	7.58	0 of 24
HEXACHLOROETHANE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
INDENO(1,2,3-CD)PYRENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
ISOPHORONE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
NAPHTHALENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
N-DECANE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
NITROBENZENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
N,N-NITROSODIMETHYLAMINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
N,N-NITROSODI-N-PROPYLAMINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
N,N-NITROSODIPHENYLAMINE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
N-OCTADECANE	1.17	1.01	1.05	1	1.16	1.2	1.06	8.51	1.06	1.29	1.04	1.03	1.67	10.3	2 of 24
PENTACHLOROPHENOL	3.5	3.03	3.15	3	3.47	3.59	3.17	3.11	3.19	3.86	3.12	3.1	3.32	4.55	0 of 24
PHENANTHRENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24
PHENOL	8.23	6.62	7.21	2	6.74	2.39	2.11	2.07	2.13	2.57	2.08	2.07	3.31	13.5	4 of 24
PYRENE	1.17	1.01	1.05	1	1.16	1.2	1.06	1.04	1.06	1.29	1.04	1.03	1.11	1.52	0 of 24

Table A-6. Deer Island Influent Characterization (South System), FY05 (cont.)

Volatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1,2,2-TETRACHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1,2-TRICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1-DICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROPROPANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,3-DICHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,4-DICHLOROBENZENE	2.14	2.84	1.52	0.5	2.14	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.861	3.91	5 of 24
2-BUTANONE	2.62	5.8	11.1	269	0.5	0.5	0.5	9.48	2.72	0.5	0.5	0.5	21.6	524	10 of 24
2-CHLOROETHYL VINYL ETHER	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
2-HEXANONE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
4-METHYL-2-PENTANONE	0.5	7.35	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.848	14.2	1 of 24
ACETONE	70.3	161	133	119	178	114	47.6	130	30.9	80.8	73.5	60.2	91.4	220	22 of 24
ACROLEIN	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
ACRYLONITRILE	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
BENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMODICHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMOFORM	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMOMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CARBON DISULFIDE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CARBON TETRACHLORIDE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROFORM	25.1	8.61	5.57	5.46	5.56	4.12	3.57	7.32	4.64	3.32	6.48	7.98	6.42	38.8	24 of 24
CHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CIS-1,2-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CIS-1,3-DICHLOROPROPENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
DIBROMOCHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
ETHYLBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
M,P-XYLENE	1	1	1	1	1	1	1	2.5	1	1	1.88	1	1.19	4.22	2 of 24
METHYLENE CHLORIDE	1.91	1.54	0.985	3.39	0.5	2.58	0.5	0.5	0.5	0.5	0.5	0.5	1.07	5.83	7 of 24
O-XYLENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
STYRENE	0.5	0.5	0.5	0.5	0.5	0.5	2.79	6.25	2.87	0.5	0.5	0.5	1.56	11.5	3 of 24
TETRACHLOROETHENE	1.51	1.86	6.94	2.1	12.1	1.59	3.04	3.32	1.95	3.43	2.14	4.1	3.4	20.5	18 of 24
TOLUENE	3.8	6.77	6.77	4.26	4.5	5.53	2.73	4.02	1.98	0.5	3.32	3.88	3.54	7.9	20 of 24
TRANS-1,2-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRANS-1,3-DICHLOROPROPENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRICHLOROFLUOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
VINYL ACETATE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
VINYL CHLORIDE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24

Notes

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-7. Deer Island Influent Loadings (South System), FY05

Metals (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ANTIMONY	9.05	8.99	9.54	13	10.2	14.3	19.4	12.8	15.9	28.6	15	14.8	14.3	30	0 of 24
ARSENIC	0.811	0.288	0.305	0.851	0.326	0.456	3.02	0.411	1.27	0.915	0.481	0.475	0.801	3.05	6 of 24
BERYLLIUM	0.181	0.18	0.191	0.261	0.204	0.285	0.387	0.257	0.318	0.572	0.3	0.297	0.286	0.599	0 of 24
BORON	202	211	187	130	102	143	194	128	159	286	150	148	170	300	5 of 24
CADMIUM	0.503	0.175	0.189	0.361	0.14	0.308	1.85	0.744	0.764	0.604	0.943	0.407	0.583	2.04	24 of 24
CHROMIUM	5.28	2.46	4.22	4.49	1.9	3.81	15.6	5.89	6.09	3.6	6.34	2.63	5.2	16.3	25 of 25
COPPER	127	58	53	92.5	44.5	61.4	254	117	94.2	45.4	102	54	91.9	266	24 of 24
HEXAVALENT CHROMIUM	1.93	1.77	1.88	2.5	2.01	3.41	3.95	2.69	3.5	5.23	2.95	2.96	2.9	5.45	0 of 24
IRON	3330	1380	1300	2980	1220	2060	8370	3910	3160	2030	3350	1870	2910	8900	24 of 24
LEAD	10.4	5.98	4.2	12.1	3.72	9.4	38.3	12.2	13.6	5.74	10.2	3.64	10.8	40.7	23 of 24
MERCURY	0.308	0.135	0.0805	0.288	0.166	0.133	1.34	0.615	1	0.129	0.249	0.115	0.38	1.67	25 of 25
MOLYBDENUM	8.95	4.33	4.72	5.53	3.77	2.94	7.36	6.2	3.35	9.82	5.61	5.59	5.68	13.1	25 of 25
NICKEL	4.87	3.19	11.4	4.83	2.42	2.81	12.2	4.34	6.74	5.15	5.11	2.95	5.51	16	24 of 24
SELENIUM	0.326	0.324	0.343	0.469	0.367	0.513	0.697	0.462	0.573	1.03	0.541	0.534	0.515	1.08	0 of 24
SILVER	4.04	1.33	1.45	2.61	1.12	1.9	7.55	2.8	2.58	1.45	2.98	1.62	2.62	8.6	25 of 25
THALLIUM	0.362	0.36	0.381	0.521	0.408	0.57	0.774	0.514	0.637	1.14	0.601	0.593	0.572	1.2	0 of 24
ZINC	208	95.2	91.1	173	80.6	114	523	240	229	122	177	108	180	557	24 of 24
Cyanide (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
CYANIDE	3.86	3.54	3.8	5	4.02	6.81	8.39	5.37	7.01	10.5	5.89	5.93	5.93	10.9	0 of 23
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
FATS OIL AND GREASE	46200	38900	56100	39400	38600	40800	92600	85200	64500	32200	76700	40600	54300	104000	24 of 24
MBAS	4140	4610	5120	4300	4090	3550	4400	4310	4420	3840	3620	4340	4230	5940	24 of 24
PETROLEUM HYDROCARBON	959	984	2220	1120	1110	842	3610	5980	2110	731	7730	1050	2370	11700	24 of 24

Table A-7. Deer Island Influent Loadings (South System), FY05 (cont.)

Organochlorine Pesticides and PCBs (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
2,4'-DDD		0.00343		0.00265		0.0193		0.00203		0.000283		0.000125	0.00464	0.0361	14 of 24
2,4'-DDE		0.0000739		0.000104		0.000162		0.000114		0.000283		0.000125	0.000144	0.000305	0 of 24
2,4'-DDT		0.0000739		0.000403		0.000162		0.000114		0.000283		0.000125	0.000193	0.000699	1 of 24
4,4'-DDD	0.00187	0.00111	0.00158	0.000844	0.00187	0.000973	0.00435	0.00173	0.00263	0.00239	0.00245	0.000923	0.00189	0.00477	9 of 48
4,4'-DDE	0.00187	0.00194	0.00158	0.00229	0.00187	0.00271	0.00981	0.00649	0.00263	0.00423	0.00365	0.00206	0.00343	0.0101	29 of 48
4,4'-DDT	0.00187	0.000553	0.00158	0.00133	0.00187	0.000973	0.00338	0.00309	0.00263	0.0038	0.00257	0.000923	0.00205	0.0047	6 of 48
ALDRIN	0.00187	0.000553	0.00158	0.000844	0.00187	0.000973	0.00338	0.000794	0.00263	0.00239	0.00257	0.000923	0.0017	0.00354	0 of 48
ALPHA-BHC	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
ALPHA-CHLORDANE	0.00187	0.00663	0.00158	0.00426	0.00187	0.0039	0.027	0.0106	0.0161	0.0177	0.00987	0.00577	0.00893	0.0273	34 of 48
ACROCLOR-1016	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0847	0.0539	0.0659	0.165	0.0642	0.0631	0.0659	0.202	0 of 24
ACROCLOR-1221	0.0935	0.0755	0.0786	0.116	0.0938	0.13	0.17	0.108	0.132	0.331	0.129	0.126	0.132	0.403	0 of 24
ACROCLOR-1232	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0847	0.0539	0.0659	0.165	0.0642	0.0631	0.0659	0.202	0 of 24
ACROCLOR-1242	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0847	0.0539	0.0659	0.165	0.0642	0.0631	0.0659	0.202	0 of 24
ACROCLOR-1248	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0847	0.0539	0.0659	0.165	0.0642	0.0631	0.0659	0.202	0 of 24
ACROCLOR-1254	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0847	0.117	0.0659	0.165	0.0642	0.0631	0.0711	0.202	2 of 24
ACROCLOR-1260	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0922	0.101	0.0659	0.165	0.0642	0.0631	0.0705	0.202	3 of 24
BETA-BHC	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
C13-4,4'-DDT (SURR)		0.0665		0.0836		0.0614		0.0691		0.129		0.0689	0.0798	0.149	24 of 24
C13-GAMMA-BHC (SURR)		0.0498		0.0517		0.0701		0.0861		0.119		0.0653	0.0737	0.132	24 of 24
CHLORDANE (TECHNICAL)	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0847	0.0539	0.0659	0.165	0.0642	0.0631	0.0659	0.202	0 of 24
CIS-NONACHLOR		0.000516		0.000691		0.000716		0.000656		0.00293		0.000581	0.00101	0.00364	24 of 24
DDMU		0.0000739		0.000104		0.000162		0.000114		0.000283		0.000125	0.000144	0.000305	0 of 24
DELTA-BHC	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
DIELDRIN	0.00187	0.000553	0.00158	0.000844	0.00187	0.000973	0.00338	0.000794	0.00263	0.00239	0.00257	0.000923	0.0017	0.00354	0 of 48
ENDOSULFAN I	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
ENDOSULFAN II	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
ENDOSULFAN SULFATE	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
ENDRIN	0.00187	0.000553	0.00158	0.000844	0.00187	0.000973	0.00338	0.000794	0.00263	0.00239	0.00257	0.000923	0.0017	0.00354	0 of 48
ENDRIN ALDEHYDE	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
ENDRIN KETONE	0.00187	0.00151	0.00158	0.00232	0.00187	0.00259	0.00338	0.00215	0.00263	0.00661	0.00257	0.00252	0.00263	0.00806	0 of 24
GAMMA-BHC (LINDANE)	0.00187	0.000553	0.00158	0.000844	0.00187	0.000973	0.00338	0.000794	0.00263	0.00239	0.00257	0.000923	0.0017	0.00354	0 of 48
GAMMA-CHLORDANE	0.00187	0.00656	0.00158	0.00388	0.00187	0.00389	0.0306	0.0131	0.0174	0.0186	0.0101	0.0071	0.00972	0.0336	34 of 48
HEPTACHLOR	0.00187	0.000553	0.00158	0.000844	0.00187	0.000973	0.00338	0.000794	0.00263	0.00239	0.00257	0.000923	0.0017	0.00354	0 of 48
HEPTACHLOR EPOXIDE	0.00187	0.000553	0.00158	0.000844	0.00187	0.000973	0.00338	0.000794	0.00263	0.00239	0.00257	0.000923	0.0017	0.00354	0 of 48
HEXA-CHLOROBENZENE		0.000229		0.000185		0.000148		0.000281		0.000291		0.000125	0.00021	0.000301	24 of 24
METHOXYCHLOR	0.0187	0.0151	0.0158	0.0232	0.0187	0.0259	0.0338	0.0215	0.0263	0.0661	0.0257	0.0252	0.0263	0.0806	0 of 24
MIREX		0.0000739		0.000104		0.000162		0.000114		0.000283		0.000125	0.000144	0.000305	0 of 24
OXYCHLORDANE		0.0000739		0.000104		0.000162		0.000114		0.000283		0.000125	0.000144	0.000305	0 of 24
TOTAL CHLORDANE		0.00584		0.00769		0.00715		0.00987		0.0355		0.00779	0.0123	0.0439	24 of 24
TOTAL DDT		0.0065		0.00603		0.0221		0.00769		0.00528		0.00183	0.00823	0.0402	24 of 24
TOXAPHENE	0.0468	0.0378	0.0394	0.058	0.0468	0.0648	0.0847	0.0539	0.0659	0.165	0.0642	0.0631	0.0659	0.202	0 of 24
TRANS-NONACHLOR		0.00228		0.00247		0.0026		0.00317		0.0123		0.00251	0.00421	0.0153	24 of 24

Table A-7. Deer Island Influent Loadings (South System), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
1,2-DICHLOROBENZENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
1,3-DICHLOROBENZENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
1,4-DICHLOROBENZENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2,2'-OXYBIS(1-CHLOROPROPANE)	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2,4,5-TRICHLOROPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2,4,6-TRICHLOROPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2,4-DICHLOROPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2,4-DIMETHYLPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2,4-DINITROPHENOL	1.69	1.45	1.6	2.08	1.89	2.73	3.27	2.13	2.71	5.89	2.5	2.46	2.53	6.6	0 of 24
2,4-DINITROTOLUENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2,6-DINITROTOLUENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2-CHLORONAPHTHALENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2-CHLOROPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2-METHYL-4,6-DINITROPHENOL	8.44	7.27	8.01	10.4	9.44	13.6	16.3	10.6	13.6	29.4	12.5	12.3	12.7	33	0 of 24
2-METHYLNAPHTHALENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2-METHYLPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2-NITROANILINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
2-NITROPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
3,3'-DICHLOROBENZIDINE	1.69	1.45	1.6	2.08	1.89	2.73	3.27	2.13	2.71	5.89	2.5	2.46	2.53	6.6	0 of 24
3-NITROANILINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
4-BROMOPHENYL PHENYL ETHER	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
4-CHLORO-3-METHYLPHENOL	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
4-CHLOROANILINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
4-CHLOROPHENYL PHENYL ETHER	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	24.6	16.1	19.9	3.6	24.4	12.3	4.98	16.8	12.9	2.94	15.4	6.19	13.3	32.2	17 of 24
4-NITROANILINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
4-NITROPHENOL	1.69	1.45	1.6	2.08	1.89	2.73	3.27	2.13	2.71	5.89	2.5	2.46	2.53	6.6	0 of 24
ACENAPHTHENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
ACENAPHTHYLENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
ANILINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
ANTHRACENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
BENZIDINE	4.22	3.63	4	5.21	4.72	6.82	8.17	5.32	6.78	14.7	6.25	6.14	6.33	16.5	0 of 24
BENZO(A)ANTHRACENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
BENZO(A)PYRENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24

Table A-7. Deer Island Influent Loadings (South System), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
BENZO(GHI)PERYLENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
BENZO(K)FLUORANTHENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
BENZOIC ACID	1.69	4.82	1.6	2.08	1.89	2.73	3.27	2.13	2.71	5.89	2.5	2.46	2.81	8.14	1 of 24
BENZYL ALCOHOL	13.9	7.04	13.3	1.04	14.3	4.73	1.63	7.78	11.2	2.94	10.3	9.02	8.11	18.1	15 of 24
BIS(2-CHLOROETHOXY)METHANE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
BIS(2-CHLOROETHYL)ETHER	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
BIS(2-ETHYLHEXYL)PHTHALATE	14.4	6.55	9.35	6.4	10.8	11.1	35.4	24.7	12.9	2.94	8.77	10.5	12.8	53.3	21 of 24
BUTYL BENZYL PHTHALATE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
CARBAZOLE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
CHRYSENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
DIBENZO(A,H)ANTHRACENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
DIBENZOFURAN	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
DIETHYL PHTHALATE	12.3	0.727	0.801	1.04	3.24	1.36	1.63	1.06	1.36	2.94	1.25	1.23	2.42	23.8	2 of 24
DIMETHYL PHTHALATE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
DI-N-BUTYLPHTHALATE	2.57	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.41	4.22	1 of 24
DI-N-OCTYLPHTHALATE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
FLUORANTHENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
FLUORENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
HEXACHLOROBENZENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
HEXACHLOROBUTADIENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
HEXACHLOROCYCLOPENTADIENE	4.22	3.63	4	5.21	4.72	6.82	8.17	5.32	6.78	14.7	6.25	6.14	6.33	16.5	0 of 24
HEXACHLOROETHANE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
INDENO(1,2,3-CD)PYRENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
ISOPHORONE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
NAPHTHALENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
N-DECANE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
NITROBENZENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
N-NITROSODIMETHYLAMINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
N-NITROSODI-N-PROPYLAMINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
N-NITROSODIPHENYLAMINE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
N-OCTADECANE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	8.74	1.36	2.94	1.25	1.23	1.91	10.2	2 of 24
PENTACHLOROPHENOL	2.53	2.18	2.4	3.13	2.83	4.09	4.9	3.19	4.07	8.83	3.75	3.68	3.8	9.9	0 of 24
PHENANTHRENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24
PHENOL	5.96	4.76	5.5	2.08	5.49	2.73	3.27	2.13	2.71	5.89	2.5	2.46	3.79	10.1	4 of 24
PYRENE	0.844	0.727	0.801	1.04	0.944	1.36	1.63	1.06	1.36	2.94	1.25	1.23	1.27	3.3	0 of 24

Table A-7. Deer Island Influent Loadings (South System), FY05 (cont.)

Volatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,1,2,2-TETRACHLOROETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,1,2-TRICHLOROETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,1-DICHLOROETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,1-DICHLOROETHENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,2-DICHLOROBENZENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,2-DICHLOROETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,2-DICHLOROPROPANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,3-DICHLOROBENZENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
1,4-DICHLOROBENZENE	1.66	2.01	1.14	0.5	1.72	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.998	3.04	5 of 24
2-BUTANONE	2.02	4.11	8.34	269	0.402	0.681	0.79	10.2	3.81	1.05	0.589	0.593	25.1	531	10 of 24
2-CHLOROETHYL VINYL ETHER	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
2-HEXANONE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
4-METHYL-2-PENTANONE	0.386	5.2	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.984	10	1 of 24
ACETONE	54.3	114	99.8	119	143	155	75.2	140	43.2	169	86.6	71.3	106	181	22 of 24
ACROLEIN	0.773	0.708	0.751	1	0.804	1.36	1.58	1.07	1.4	2.09	1.18	1.19	1.16	2.18	0 of 24
ACRYLONITRILE	0.773	0.708	0.751	1	0.804	1.36	1.58	1.07	1.4	2.09	1.18	1.19	1.16	2.18	0 of 24
BENZENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
BROMODICHLOROMETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
BROMOFORM	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
BROMOMETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
CARBON DISULFIDE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
CARBON TETRACHLORIDE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
CHLOROBENZENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
CHLOROETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
CHLOROFORM	19.4	6.1	4.18	5.46	4.47	5.61	5.64	7.87	6.5	6.93	7.63	9.46	7.44	31.1	24 of 24
CHLOROMETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
CIS-1,2-DICHLOROETHENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
CIS-1,3-DICHLOROPROPENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
DIBROMOCHLOROMETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
ETHYLBENZENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
M,P-XYLENE	0.773	0.708	0.751	1	0.804	1.36	1.58	2.68	1.4	2.09	2.22	1.19	1.38	4.22	2 of 24
METHYLENE CHLORIDE	1.48	1.09	0.74	3.39	0.402	3.51	0.79	0.537	0.701	1.05	0.589	0.593	1.24	5.9	7 of 24
O-XYLENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
STYRENE	0.386	0.354	0.376	0.5	0.402	3.8	9.89	3.09	0.701	1.05	0.589	0.593	1.81	19	3 of 24
TETRACHLOROETHENE	1.17	1.31	5.21	2.1	9.71	2.17	4.81	3.57	2.73	7.17	2.52	4.86	3.94	16.7	18 of 24
TOLUENE	2.94	4.79	5.09	4.26	3.62	7.54	4.32	4.32	2.77	1.05	3.91	4.6	4.1	7.78	20 of 24
TRANS-1,2-DICHLOROETHENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
TRANS-1,3-DICHLOROPROPENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
TRICHLOROETHENE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
TRICHLOROFLUOROMETHANE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
VINYL ACETATE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24
VINYL CHLORIDE	0.386	0.354	0.376	0.5	0.402	0.681	0.79	0.537	0.701	1.05	0.589	0.593	0.58	1.09	0 of 24

Notes

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-8. Deer Island Effluent Characterization, FY05

Metals (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ARSENIC	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.74	0.4	0.4	0.4	0.433	0.998	1 of 24
COPPER	9.48	12.5	13.4	10.4	8.43	10.5	10.5	17.2	12.9	8.7	6	5.75	10.5	37.6	113 of 166
LEAD	2	1.1	1.3	1	0.88	3.9	1.4	0.74	4.2	0.83	1	0.72	1.75	4.2	12 of 12
MERCURY	0.0239	0.0159	0.0195	0.014	0.0122	0.0187	0.0252	0.026	0.0224	0.0188	0.0133	0.013	0.0188	0.0575	86 of 109
Cyanide (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
CYANIDE	5	5	5	5	5	5	5	5	5	5	5	5	5	5	0 of 24
Organochlorine Pesticides and PCBs (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
4,4'-DDD	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
4,4'-DDE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
4,4'-DDT	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ALDRIN	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ALPHA-BHC	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ALPHA-CHLORDANE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ACROCLOR-1016	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24
ACROCLOR-1221	0.113	0.119	0.11	0.121	0.165	0.115	0.103	0.102	0.106	0.114	0.106	0.109	0.114	0.2	0 of 24
ACROCLOR-1232	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24
ACROCLOR-1242	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24
ACROCLOR-1248	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24
ACROCLOR-1254	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24
ACROCLOR-1260	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24
BETA-BHC	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
CHLORDANE (TECHNICAL)	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24
DELTA-BHC	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
DIELDRIN	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ENDOSULFAN I	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ENDOSULFAN II	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ENDOSULFAN SULFATE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ENDRIN	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ENDRIN ALDEHYDE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
ENDRIN KETONE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
GAMMA-BHC (LINDANE)	0.00225	0.00237	0.0295	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00396	0.0311	2 of 24
GAMMA-CHLORDANE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
HEPTACHLOR	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
HEPTACHLOR EPOXIDE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
HEXACHLOROBENZENE	0.00225	0.00237	0.0022	0.00241	0.00331	0.0023	0.00206	0.00203	0.00211	0.00228	0.00212	0.00219	0.00227	0.004	0 of 24
METHOXYCHLOR	0.0225	0.0237	0.022	0.0241	0.0331	0.023	0.0206	0.0203	0.0211	0.0228	0.0212	0.0214	0.022	0.04	0 of 24
TOXAPHENE	0.0563	0.0592	0.0551	0.0603	0.0827	0.0575	0.0515	0.0508	0.0528	0.0571	0.053	0.0547	0.0568	0.1	0 of 24

Table A-8. Deer Island Effluent Characterization, FY05 (cont.)

Volatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1,2,2-TETRACHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1,2-TRICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1-DICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,1-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,2-DICHLOROPROPANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,3-DICHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
1,4-DICHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
2-BUTANONE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	3.28	0.5	0.5	0.5	0.5	0.73	5.59	1 of 24
2-CHLOROETHYL VINYL ETHER	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
2-HEXANONE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
4-METHYL-2-PENTANONE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
ACETONE	13.8	15.8	15.2	1	1	8.27	10.6	3.21	16.7	18.2	1	1	9.25	21.5	13 of 24
ACROLEIN	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
ACRYLONITRILE	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
BENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMODICHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMOFORM	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
BROMOMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CARBON DISULFIDE	0.5	1.47	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.559	2.51	1 of 24
CARBON TETRACHLORIDE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CHLOROFORM	8.12	9.99	5.2	4.34	6.29	5.34	5.32	10.6	7.31	5.92	9.99	8.54	7.13	12.1	24 of 24
CHLORMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CIS-1,2-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
CIS-1,3-DICHLOROPROPENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
DIBROMOCHLOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
ETHYLBENZENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
M,P-XYLENE	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0 of 24
METHYLENE CHLORIDE	0.5	1.56	0.911	0.872	0.5	0.701	1.4	0.5	0.5	0.5	0.5	0.5	0.732	2.7	7 of 24
O-XYLENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
STYRENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TETRACHLOROETHENE	1.93	1.96	0.5	0.5	5.12	2.55	2.96	2.88	5.3	3.19	1.53	2.01	2.65	5.61	15 of 24
TOLUENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRANS-1,2-DICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRANS-1,3-DICHLOROPROPENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRICHLOROETHENE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
TRICHLOROFLUOROMETHANE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
VINYL ACETATE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
VINYL CHLORIDE	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24

Notes

Many of the compounds previously found in this Appendix have moved to the low-detection limit studies found in Appendix A-10.

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-9. Deer Island Effluent Loadings, FY05

Metals (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ARSENIC	1.04	0.976	0.969	1.14	0.935	1.55	1.59	1.23	2.77	2.18	1.3	1.27	1.41	4.25	1 of 24
COPPER	22.4	34	39.3	29.7	20.6	36.5	40.6	66.6	52.4	40.4	22.8	16.7	34.7	197	113 of 166
LEAD	6.03	2.63	3.13	2.87	2.14	19	5.36	2.26	17.9	4.32	3.2	2.26	5.93	19	12 of 12
MERCURY	0.0563	0.0433	0.057	0.0399	0.0297	0.0647	0.0976	0.1	0.0908	0.0872	0.0507	0.0377	0.0623	0.356	86 of 109
Cyanide (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
CYANIDE	13.9	12.4	12.1	13.8	12.1	22	21.8	16.8	19.6	25.2	15.8	18.3	17	26	0 of 24
Organochlorine Pesticides and PCBs (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
4,4'-DDD	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
4,4'-DDE	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
4,4'-DDT	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ALDRIN	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ALPHA-BHC	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ALPHA-CHLORDANE	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ACROCLOR-1016	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24
ACROCLOR-1221	0.292	0.289	0.266	0.342	0.386	0.446	0.41	0.311	0.396	0.622	0.344	0.346	0.371	0.704	0 of 24
ACROCLOR-1232	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24
ACROCLOR-1242	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24
ACROCLOR-1248	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24
ACROCLOR-1254	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24
ACROCLOR-1260	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24
BETA-BHC	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
CHLORDANE (TECHNICAL)	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24
DELTA-BHC	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
DIELDRIN	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ENDOSULFAN I	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ENDOSULFAN II	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ENDOSULFAN SULFATE	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ENDRIN	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ENDRIN ALDEHYDE	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
ENDRIN KETONE	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
GAMMA-BHC (LINDANE)	0.00585	0.00577	0.0715	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.0129	0.075	2 of 24
GAMMA-CHLORDANE	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
HEPTACHLOR	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
HEPTACHLOR EPOXIDE	0.00585	0.00577	0.00534	0.00685	0.00774	0.00892	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
HEXACHLOROBENZENE	0.00585	0.00577	0.00534	0.00685	0.00774	0.0089	0.00821	0.00623	0.00791	0.0124	0.00687	0.00695	0.00742	0.014	0 of 24
METHOXYCHLOR	0.0585	0.0577	0.0534	0.0685	0.0774	0.089	0.0821	0.0623	0.0791	0.124	0.0687	0.0393	0.0717	0.14	0 of 24
TOXAPHENE	0.146	0.144	0.133	0.171	0.193	0.223	0.205	0.156	0.198	0.311	0.172	0.173	0.185	0.35	0 of 24

Table A-9. Deer Island Effluent Loadings, FY05 (cont.)

Volatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,1,1-TRICHLOROETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,1,2,2-TETRACHLOROETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,1,2-TRICHLOROETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,1-DICHLOROETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,1-DICHLOROETHENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,2-DICHLOROBENZENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,2-DICHLOROETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,2-DICHLOROPROPANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,3-DICHLOROBENZENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
1,4-DICHLOROBENZENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
2-BUTANONE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	11	1.96	2.52	1.58	1.83	2.48	20.6	1 of 24
2-CHLOROETHYL VINYL ETHER	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
2-HEXANONE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
4-METHYL-2-PENTANONE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
ACETONE	38.4	39	36.8	2.77	2.41	36.4	46.2	10.8	65.7	91.8	3.16	3.66	31.4	112	13 of 24
ACROLEIN	2.79	2.47	2.42	2.77	2.41	4.4	4.35	3.36	3.93	5.03	3.16	3.66	3.4	5.2	0 of 24
ACRYLONITRILE	2.79	2.47	2.42	2.77	2.41	4.4	4.35	3.36	3.93	5.03	3.16	3.66	3.4	5.2	0 of 24
BENZENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
BROMODICHLOROMETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
BROMOFORM	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
BROMOMETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
CARBON DISULFIDE	1.39	3.64	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.9	6	1 of 24
CARBON TETRACHLORIDE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
CHLOROBENZENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
CHLOROETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
CHLOROFORM	22.6	24.7	12.6	12	15.2	23.5	23.1	35.6	28.7	29.8	31.6	31.3	24.2	44.4	24 of 24
CHLOROMETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
CIS-1,2-DICHLOROETHENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
CIS-1,3-DICHLOROPROPENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
DIBROMOCHLOROMETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
ETHYLBENZENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
M,P-XYLENE	2.79	2.47	2.42	2.77	2.41	4.4	4.35	3.36	3.93	5.03	3.16	3.66	3.4	5.2	0 of 24
METHYLENE CHLORIDE	1.39	3.87	2.21	2.42	1.21	3.08	6.07	1.68	1.96	2.52	1.58	1.83	2.49	10.2	7 of 24
O-XYLENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
STYRENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
TETRACHLOROETHENE	5.39	4.85	1.21	1.38	12.3	11.2	12.9	9.7	20.8	16.1	4.83	7.36	9	23.9	15 of 24
TOLUENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
TRANS-1,2-DICHLOROETHENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
TRANS-1,3-DICHLOROPROPENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
TRICHLOROETHENE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
TRICHLOROFLUOROMETHANE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
VINYL ACETATE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24
VINYL CHLORIDE	1.39	1.24	1.21	1.38	1.21	2.2	2.18	1.68	1.96	2.52	1.58	1.83	1.7	2.6	0 of 24

Notes

Many of the compounds previously found in this Appendix have moved to the low-detection limit studies found in Appendix A-10.

~: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-10. Deer Island Effluent Characterization (DEC), FY05

Metals (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
ANTIMONY	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	12.5	0 of 25
BERYLLIUM	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0 of 25
BORON	180	215	125	125	188	125	125	125	125	125	125	125	138	301	3 of 25
CADMIUM	0.1	0.0339	0.0742	0.026	0.0389	0.0697	0.1	0.133	0.162	0.111	0.0897	0.0601	0.0879	0.239	71 of 96
CHROMIUM	1.01	0.896	1.13	0.773	1.35	1.46	1.07	1.44	1.57	0.911	0.878	0.571	1.09	2.54	78 of 96
HEXAVALENT CHROMIUM	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	0 of 24
IRON	414	175	314	275	263	473	473	337	355	294	243	175	324	543	25 of 25
LEAD	1.2	1.79	2.67	1.2	1.2	2.02	1.86	2.84	3.61	1.2	1.2	1.2	1.88	8.12	14 of 97
MOLYBDENUM	10.6	8.77	7.87	6.66	6	5.59	4.42	5.14	4.64	7.03	8.38	7.91	6.75	13.5	65 of 65
NICKEL	3.29	3.12	3.34	1.87	2.32	2.24	2.97	2.91	3.03	2.79	2.26	2.26	2.7	6.29	97 of 98
SELENIUM	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0 of 24
SILVER	0.319	0.225	0.403	0.624	0.276	0.44	0.398	0.497	0.42	0.29	0.267	0.276	0.373	1.95	96 of 97
THALLIUM	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0 of 24
ZINC	21.6	26.1	26	22.3	20.2	30.4	35.8	46.3	43.7	35.1	24.9	23.9	30.7	69.3	96 of 96
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (mg/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
FATS OIL AND GREASE	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0 of 71
MBAS	0.648	0.454	0.629	0.201	0.117	0.31	0.297	0.394	0.368	0.319	0.163	0.149	0.322	0.99	43 of 43
PETROLEUM HYDROCARBON	0.212	0.02	0.115	0.0551	0.204	0.0196	0.158	0.22	0.0687	0.055	0.358	0.0809	0.132	0.703	23 of 64
Organochlorine Pesticides and PCBs (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
2,4'-DDD	0.000442	0.00044	0.00044	0.000384	0.0007	0.000537	0.000608	0.000119	0.000109	0.000167	0.000134	0.00011	0.000337	0.00222	59 of 115
2,4'-DDE	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 115
2,4'-DDT	0.000112	0.000197	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000126	0.000452	1 of 115
4,4'-DDD	0.000187	0.000297	0.000108	0.000109	0.000108	0.000221	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000149	0.000693	12 of 115
4,4'-DDE	0.000629	0.000623	0.000539	0.000405	0.000505	0.000619	0.000713	0.000725	0.000842	0.000486	0.000419	0.000319	0.000586	0.00136	108 of 115
4,4'-DDT	0.000242	0.000279	0.000252	0.000109	0.000108	0.000126	0.000107	0.000119	0.000884	0.000167	0.000175	0.00011	0.000247	0.00206	18 of 115
ALDRIN	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 115
ALPHA-CHLORDANE	0.000825	0.000648	0.000633	0.000874	0.0013	0.00122	0.00157	0.00368	0.0011	0.00126	0.00114	0.000862	0.00126	0.00781	115 of 115
C13-4,4'-DDT (SURR)	0.0989	0.0723	0.0764	0.0729	0.0794	0.0529	0.0619	0.0674	0.065	0.0602	0.0654	0.0533	0.066	0.105	108 of 108
C13-GAMMA-BHC (SURR)	7.1E-02	0.0621	0.0618	0.0579	0.0687	0.069	0.0794	0.0707	0.0622	0.0611	0.0561	0.0596	0.0648	0.0904	108 of 108
CIS-NONACHLOR	0.000156	0.000147	0.000133	0.00014	0.000241	0.000197	0.000209	0.000591	0.000183	0.000213	0.000169	0.000139	0.000209	0.00129	83 of 108
DDMU	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 115
DIELDRIN	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 115
ENDRIN	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 115
GAMMA-BHC (LINDANE)	0.000112	0.000116	0.0121	0.000731	0.000961	0.000126	0.000468	0.000511	0.000398	0.00248	0.000134	0.000111	0.00122	0.0357	38 of 115
GAMMA-CHLORDANE	0.000769	0.000624	0.000643	0.000786	0.00133	0.00127	0.00161	0.00382	0.0011	0.00123	0.00117	0.000884	0.00127	0.00809	115 of 115
HEPTACHLOR	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.00105	0.000109	0.000167	0.000134	0.00011	0.000185	0.00296	2 of 115
HEPTACHLOR EPOXIDE	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 115
HEXACHLOROBENZENE	0.000113	0.000097	0.0000845	0.0000708	0.0000883	0.000117	0.0000956	0.000094	0.0000879	0.000103	0.0000963	0.000105	0.0000967	0.000193	99 of 115
MIREX	0.000112	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 115
OXYCHLORDANE	0.000104	0.000116	0.000108	0.000109	0.000108	0.000126	0.000107	0.000119	0.000109	0.000167	0.000134	0.00011	0.000119	0.000243	0 of 108
TOTAL CHLORDANE	0.00183	0.00111	0.00104	0.00135	0.0021	0.00177	0.00235	0.00706	0.00182	0.0019	0.00167	0.00124	0.00207	0.0162	115 of 115
TOTAL DDT	0.00129	0.00162	0.00116	0.000748	0.00118	0.00123	0.00132	0.000725	0.00162	0.000486	0.000461	0.000319	0.00104	0.00353	109 of 115
TRANS-NONACHLOR	0.000474	0.000465	0.000404	0.00048	0.000794	0.000596	0.000773	0.00242	0.000718	0.000644	0.000529	0.000377	0.000714	0.00544	115 of 115

Table A-10. Deer Island Effluent Characterization (DEC), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
1,2-DICHLOROBENZENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
1,3-DICHLOROBENZENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
1,4-DICHLOROBENZENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2,2'-OXYBIS(1-CHLOROPROPANE)	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2,4,5-TRICHLOROPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2,4,6-TRICHLOROPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2,4-DICHLOROPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2,4-DIMETHYLPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2,4-DINITROPHENOL	2	2.41	2.22	2.05	3.34	2.09	2.08	2.07	2.17	2.17	2.12	2.08	2.2	4.44	0 of 24
2,4-DINITROTOLUENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2,6-DINITROTOLUENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2-CHLORONAPHTHALENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2-CHLOROPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2-METHYL-4,6-DINITROPHENOL	10	12.1	11.1	10.3	16.7	10.4	10.4	10.3	10.9	10.9	10.6	10.4	11	22.2	0 of 24
2-METHYLNAPHTHALENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2-METHYLPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2-NITROANILINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
2-NITROPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
3,3'-DICHLOROBENZIDINE	2	2.41	2.22	2.05	3.34	2.09	2.08	2.07	2.17	2.17	2.12	2.08	2.2	4.44	0 of 24
3-NITROANILINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
4-BROMOPHENYL PHENYL ETHER	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
4-CHLORO-3-METHYLPHENOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
4-CHLOROANILINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
4-CHLOROPHENYL PHENYL ETHER	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
4-NITROANILINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
4-NITROPHENOL	2	2.41	2.22	2.05	3.34	2.09	2.08	2.07	2.17	2.17	2.12	2.08	2.2	4.44	0 of 24
ACENAPHTHENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
ACENAPHTHYLENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
ANILINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
ANTHRACENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BENZIDINE	5	6.03	5.55	5.13	8.36	5.22	5.21	5.17	5.44	5.43	5.29	5.2	5.51	11.1	0 of 24
BENZO(A)ANTHRACENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BENZO(A)PYRENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24

Table A-10. Deer Island Effluent Characterization (DEC), FY05 (cont.)

Semivolatile Organics (ug/L)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BENZO(GH)PERYLENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BENZO(K)FLUORANTHENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BENZOIC ACID	2	2.41	2.22	2.05	3.34	2.09	2.08	2.07	2.17	2.17	2.12	2.08	2.2	4.44	0 of 24
BENZYL ALCOHOL	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BIS(2-CHLOROETHOXY)METHANE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BIS(2-CHLOROETHYL)ETHER	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BIS(2-ETHYLHEXYL)PHTHALATE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
BUTYL BENZYL PHTHALATE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
CARBAZOLE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
CHRYSENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
DI-N-BUTYLPHTHALATE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
DI-N-OCTYLPHTHALATE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
DIBENZO(A,H)ANTHRACENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
DIBENZOFURAN	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
DIETHYL PHTHALATE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
DIMETHYL PHTHALATE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
FLUORANTHENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
FLUORENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
HEXAChLOROBENZENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
HEXAChLOROBUTADIENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
HEXAChLOROCYCLOPENTADIENE	5	6.03	5.55	5.13	8.36	5.22	5.21	5.17	5.44	5.43	5.29	5.2	5.51	11.1	0 of 24
HEXAChLOROETHANE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
INDENO(1,2,3-CD)PYRENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
ISOPHORONE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
N-DECANE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
N-NITROSDI-N-PROPYLAMINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
N-NITROSDIMETHYLAMINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
N-NITROSDIPHENYLAMINE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
N-OCTADECANE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
NAPHTHALENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
NITROBENZENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
PENTACHLOROPHENOL	3	3.62	3.33	3.08	5.01	3.13	3.12	3.1	3.26	3.26	3.18	3.12	3.3	6.66	0 of 24
PHENANTHRENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24
PHENOL	2	2.41	2.22	2.05	3.34	2.09	2.08	2.07	2.17	2.17	2.12	2.08	2.2	4.44	0 of 24
PYRENE	1	1.21	1.11	1.03	1.67	1.04	1.04	1.03	1.09	1.09	1.06	1.04	1.1	2.22	0 of 24

Notes

DEC is the now-defunct Detailed Effluent Characterization project, which includes low-detection limit methods not approved by the EPA. DEC sampling is now carried out under the NP-EM project.

-: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Table A-11. Deer Island Effluent Loadings (DEC), FY05

Metals (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected	
ANTIMONY	32.4	30.5	30.3	35.5	29.2	48.4	49.8	38.3	46.8	68	40.6	39.6	40.8	70.9	0 of 25	
BERYLLIUM	0.649	0.61	0.605	0.71	0.584	0.969	0.996	0.767	0.937	1.36	0.812	0.793	0.816	1.42	0 of 25	
BORON	467	524	303	355	439	484	498	383	468	680	406	396	450	749	3 of 25	
CADMIUM	0.236	0.0925	0.217	0.074	0.095	0.241	0.389	0.513	0.659	0.516	0.341	0.174	0.291	1.25	71 of 96	
CHROMIUM	2.38	2.44	3.3	2.2	3.29	5.04	4.16	5.56	6.38	4.23	3.34	1.66	3.59	18.5	78 of 96	
HEXAVALENT CHROMIUM	6.97	6.18	6.06	6.92	6.03	11	10.9	8.41	9.81	12.6	7.91	9.15	8.49	13	0 of 24	
IRON	1070	427	761	781	614	1830	1880	1030	1330	1600	791	556	1060	2650	25 of 25	
LEAD	2.83	4.88	7.82	3.42	2.93	6.97	7.22	11	14.7	5.58	4.56	3.48	6.22	59	14 of 97	
MOLYBDENUM	25.3	24.6	19.9	18.2	14.7	19.2	16.5	19	20.1	29.5	33.2	22.9	22.1	57.4	65 of 65	
NICKEL	7.76	8.52	9.77	5.34	5.66	7.75	11.5	11.2	12.3	13	8.6	6.56	8.95	23	97 of 98	
SELENIUM	1.17	1.1	1.09	1.28	1.05	1.74	1.79	1.38	1.69	2.45	1.46	1.43	1.47	2.55	0 of 24	
SILVER	0.753	0.615	1.18	1.78	0.674	1.52	1.54	1.92	1.7	1.35	1.02	0.799	1.24	5.49	96 of 97	
THALLIUM	1.3	1.22	1.21	1.42	1.17	1.94	1.99	1.53	1.87	2.72	1.62	1.59	1.63	2.84	0 of 24	
ZINC	51	71.1	76.1	63.6	49.4	105	139	179	177	163	94.9	69.2	102	407	96 of 96	
Oil and Grease, Surfactants, and Petroleum Hydrocarbons (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected	
FATS OIL AND GREASE	1880	1790	1760	1910	1810	2640	2740	2490	3020	2860	2340	2180	2310	5090	0 of 71	
MBAS	1620	1110	2070	592	277	1170	1230	1500	1320	1780	538	438	1070	5890	43 of 43	
PETROLEUM HYDROCARBON	569	51.1	289	151	529	74.2	617	791	312	226	1200	251	433	2130	23 of 64	
Organochlorine Pesticides and PCBs (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected	
2,4'-DDD	0.00106	0.00124	0.00111	0.00105	0.00171	0.00184	0.00227	0.00044	0.000474	0.00064	0.000529	0.00032	0.00109	0.00544	59 of 115	
2,4'-DDE	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000385	0.0011	0 of 115	
2,4'-DDT	0.000268	0.00054	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000407	0.00179	1 of 115	
4,4'-DDD	0.000449	0.000836	0.000273	0.000297	0.000265	0.000758	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000481	0.00274	12 of 115	
4,4'-DDE	0.00151	0.00175	0.00136	0.00111	0.00124	0.00212	0.00266	0.00268	0.00365	0.00186	0.00166	0.000925	0.0019	0.00985	108 of 115	
4,4'-DDT	0.00058	0.000783	0.000638	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.00364	0.00064	0.000695	0.00032	0.000798	0.012
ALDRIN	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000385	0.0011	0 of 115	
ALPHA-CHLORDANE	0.00198	0.00182	0.0016	0.00239	0.00319	0.00418	0.00589	0.0136	0.0478	0.0048	0.0045	0.0025	0.00408	0.0376	115 of 115	
C13-4,4'-DDT (SURR)	0.231	0.203	0.193	0.199	0.195	0.181	0.231	0.249	0.281	0.23	0.259	0.155	0.217	0.432	108 of 108	
C13-GAMMA-BHC (SURR)	1.7E-01	0.174	0.156	0.158	0.168	0.237	0.297	0.262	0.269	0.234	0.222	0.173	0.213	0.378	108 of 108	
CIS-NONACHLOR	0.000366	0.000413	0.000337	0.000383	0.00059	0.000675	0.000783	0.000219	0.000792	0.000815	0.000668	0.000403	0.000688	0.00622	83 of 108	
DDMU	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000385	0.0011	0 of 115	
DIELDRIN	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000385	0.0011	0 of 115	
ENDRIN	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000385	0.0011	0 of 115	
GAMMA-BHC (LINDANE)	0.000268	0.000325	0.0307	0.002	0.00235	0.000432	0.00175	0.0189	0.00172	0.00949	0.000529	0.00032	0.00395	0.086	38 of 115	
GAMMA-CHLORDANE	0.00184	0.00175	0.00163	0.00215	0.00325	0.00435	0.006	0.0141	0.0478	0.00472	0.00463	0.0256	0.00412	0.039	115 of 115	
HEPTACHLOR	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.0387	0.000474	0.00064	0.000529	0.00032	0.0006	0.0142	2 of 115	
HEPTACHLOR EPOXIDE	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000385	0.0011	0 of 115	
HEXACHLOROBENZENE	0.00027	0.00028	0.000214	0.000194	0.000216	0.000403	0.000358	0.000348	0.000381	0.000393	0.000381	0.000305	0.000313	0.000697	99 of 115	
MIREX	0.000268	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000385	0.0011	0 of 115	
OXYCHLORDANE	0.000243	0.000325	0.000273	0.000297	0.000265	0.000432	0.000401	0.00044	0.000474	0.00064	0.000529	0.00032	0.000393	0.0011	0 of 108	
TOTAL CHLORDANE	0.00438	0.00312	0.00262	0.0037	0.00514	0.00607	0.00877	0.0261	0.0079	0.00727	0.00659	0.00359	0.00672	0.0781	115 of 115	
TOTAL DDT	0.00309	0.00455	0.00295	0.00204	0.0029	0.00422	0.00493	0.00268	0.00702	0.00186	0.00182	0.000925	0.00338	0.0219	109 of 115	
TRANS-NONACHLOR	0.00114	0.00131	0.00102	0.00131	0.00194	0.00205	0.00289	0.00894	0.00311	0.00246	0.0021	0.00109	0.00231	0.0262	115 of 115	

Table A-11. Deer Island Effluent Loadings (DEC), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
1,2,4-TRICHLOROBENZENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
1,2-DICHLOROBENZENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
1,2-DIPHENYLHYDRAZINE (AS AZOBENZENE)	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
1,3-DICHLOROBENZENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
1,4-DICHLOROBENZENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2,2'-OXYBIS(1-CHLOROPROPANE)	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2,4,5-TRICHLOROPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2,4,6-TRICHLOROPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2,4-DICHLOROPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2,4-DIMETHYLPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2,4-DINITROPHENOL	5.19	5.88	5.37	5.82	7.81	8.08	8.3	6.35	8.15	11.8	6.88	6.6	7.19	11.8	0 of 24
2,4-DINITROTOLUENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2,6-DINITROTOLUENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2-CHLORONAPHTHALENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2-CHLOROPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2-METHYL-4,6-DINITROPHENOL	26	29.4	26.9	29.1	39.1	40.4	41.5	31.7	40.7	59	34.4	33	35.9	59.1	0 of 24
2-METHYLNAPHTHALENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2-METHYLPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2-NITROANILINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
2-NITROPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
3,3'-DICHLOROBENZIDINE	5.19	5.88	5.37	5.82	7.81	8.08	8.3	6.35	8.15	11.8	6.88	6.6	7.19	11.8	0 of 24
3-NITROANILINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
4-BROMOPHENYL PHENYL ETHER	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
4-CHLORO-3-METHYLPHENOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
4-CHLOROANILINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
4-CHLOROPHENYL PHENYL ETHER	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
4-METHYLPHENOL (INCLUDES 3-METHYLPHENOL)	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
4-NITROANILINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
4-NITROPHENOL	5.19	5.88	5.37	5.82	7.81	8.08	8.3	6.35	8.15	11.8	6.88	6.6	7.19	11.8	0 of 24
ACENAPHTHENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
ACENAPHTHYLENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
ANILINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
ANTHRACENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BENZIDINE	13	14.7	13.4	14.6	19.5	20.2	20.7	15.9	20.4	29.5	17.2	16.5	18	29.5	0 of 24
BENZO(A)ANTHRACENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BENZO(A)PYRENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24

Table A-11. Deer Island Effluent Loadings (DEC), FY05 (cont.)

Semivolatile Organics (lbs/day)	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
BENZO(B)FLUORANTHENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BENZO(G,H)PERYLENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BENZO(K)FLUORANTHENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BENZOIC ACID	5.19	5.88	5.37	5.82	7.81	8.08	8.3	6.35	8.15	11.8	6.88	6.6	7.19	11.8	0 of 24
BENZYL ALCOHOL	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BIS(2-CHLOROETHOXY)METHANE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BIS(2-CHLOROETHYL)ETHER	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BIS(2-ETHYLHEXYL)PHTHALATE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
BUTYL BENZYL PHTHALATE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
CARBAZOLE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
CHRYSENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
DIBENZO(A,H)ANTHRACENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
DIBENZOFURAN	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
DIETHYL PHTHALATE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
DIMETHYL PHTHALATE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
DI-N-BUTYLPHthalate	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
DI-N-OCTYLPHthalate	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
FLUORANTHENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
FLUORENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
HEXAChlorobenzene	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
HEXAChlorobutadiene	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
HEXAChlorocyclopentadiene	13	14.7	13.4	14.6	19.5	20.2	20.7	15.9	20.4	29.5	17.2	16.5	18	29.5	0 of 24
HEXAChloroethane	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
INDENO(1,2,3-CD)PYRENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
ISOPHORONE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
NAPHTHALENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
N-DECANE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
NITROBENZENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
N-NITROSODIMETHYLAMINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
N-NITROSODI-N-PROPYLAMINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
N-NITROSODIPHENYLAMINE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
N-OCTADECANE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
PENTACHLOROPHENOL	7.79	8.82	8.06	8.74	11.7	12.1	12.4	9.52	12.2	17.7	10.3	9.89	10.8	17.7	0 of 24
PHENANTHRENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24
PHENOL	5.19	5.88	5.37	5.82	7.81	8.08	8.3	6.35	8.15	11.8	6.88	6.6	7.19	11.8	0 of 24
PYRENE	2.6	2.94	2.69	2.91	3.91	4.04	4.15	3.17	4.07	5.9	3.44	3.3	3.59	5.91	0 of 24

Notes

DEC is the now-defunct Detailed Effluent Loadings project, which includes low-detection limit methods not approved by the EPA. DEC sampling is now carried out under the NP-EM project.

-: No data or no samples taken

Results in **bold** indicate one or more detects that month

Yearly averages are calculated from individual results collected during the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Appendix B

- Table B-1 Cottage Farm CSO Facility Operations Summary, Fiscal Year 2005
- Table B-2 Cottage Farm CSO Facility Effluent Characterization, Fiscal Year 2005
- Table B-3 Cottage Farm CSO Facility Effluent Loadings, Fiscal Year 2005

Table B-1. Cottage Farm CSO Facility Operations Summary, FY05

Date	Rainfall	Discharge duration (hrs)	Total volume (MG)	Peak flow (MG)	pH (SU)	BOD (mg/L)	TSS (mg/L)	Effluent Fecal coliform (col/100mL)	Chlorine residual (mg/L)
July									
24	1.20	1.67	4.47	80.10					
August									
21	1.05	3.50	6.49	80.00					
September									
8	1.65	1.66	2.40	243.50	6.2	108.0	157.0	98000	0.03
9	0.22	1.25	1.36	90.00	6.7		82.5	3900	0.03
18	2.87	4.33	11.80	123.70					
28	1.88	4.08	10.08	97.50					
October									
16	0.57	3.33	3.01	100.00					
November									
28	0.80	1.92	2.40	28.30					
December									
23	0.93	3.75	8.70	42.00					
January									
	NA								
February									
	NA								
March									
	NA								
April									
	NA								
May									
	NA								
June									
	NA								
Total		25.49	50.71						
Average		2.83	5.63	98.34		108.0	119.75	19550	0.03
Minimum		1.25	1.36	28.30	6.20	108.0	119.75	19550	0.03
Maximum*		4.33	11.80	243.50	6.70	108.0	119.75	19550	0.03

Number of CSO events 8

NA = No Activation.

* = Per the NPDES permit, maximum chlorine residual is the highest single sample.

Boxed dates indicate a single event spread out over multiple days.

Table B-2. Cottage Farm CSO Facility Effluent Characterization, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	~	1010	~	~	~	NA	NA	NA	NA	NA	NA	1010.00	1010.00	2 of 2
CADMIUM	~	~	0.417	~	~	~	NA	NA	NA	NA	NA	NA	0.42	0.42	2 of 4
CALCIUM	~	~	12165	~	~	~	NA	NA	NA	NA	NA	NA	12165.00	12165.00	2 of 2
CHROMIUM	~	~	7.125	~	~	~	NA	NA	NA	NA	NA	NA	7.13	7.13	2 of 2
COPPER	~	~	62.95	~	~	~	NA	NA	NA	NA	NA	NA	62.95	62.95	2 of 2
LEAD	~	~	36.15	~	~	~	NA	NA	NA	NA	NA	NA	36.15	36.15	2 of 2
MAGNESIUM	~	~	2450	~	~	~	NA	NA	NA	NA	NA	NA	2450.00	2450.00	2 of 2
MERCURY	~	~	0.1215	~	~	~	NA	NA	NA	NA	NA	NA	0.12	0.12	2 of 2
NICKEL	~	~	9.59	~	~	~	NA	NA	NA	NA	NA	NA	9.59	9.59	2 of 2
ZINC	~	~	122.85	~	~	~	NA	NA	NA	NA	NA	NA	122.85	122.85	2 of 2
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	~	1.006	~	~	~	NA	NA	NA	NA	NA	NA	1.01	1.01	2 of 2
TOTAL ORGANIC CARBON	~	~	30.15	~	~	~	NA	NA	NA	NA	NA	NA	30.15	30.15	2 of 2

Table B-3. Cottage Farm CSO Facility Effluent Loadings, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	~	15.88	~	~	~	NA	NA	NA	NA	NA	NA	15.88	15.88	2 of 2
CADMIUM	~	~	0.01	~	~	~	NA	NA	NA	NA	NA	NA	0.01	0.01	2 of 4
CALCIUM	~	~	206.07	~	~	~	NA	NA	NA	NA	NA	NA	206.07	206.07	2 of 2
CHROMIUM	~	~	0.11	~	~	~	NA	NA	NA	NA	NA	NA	0.11	0.11	2 of 2
COPPER	~	~	1.08	~	~	~	NA	NA	NA	NA	NA	NA	1.08	1.08	2 of 2
LEAD	~	~	0.54	~	~	~	NA	NA	NA	NA	NA	NA	0.54	0.54	2 of 2
MAGNESIUM	~	~	40.93	~	~	~	NA	NA	NA	NA	NA	NA	40.93	40.93	2 of 2
MERCURY	~	~	0.0019	~	~	~	NA	NA	NA	NA	NA	NA	0.00	0.00	2 of 2
NICKEL	~	~	0.14	~	~	~	NA	NA	NA	NA	NA	NA	0.14	0.14	2 of 2
ZINC	~	~	2.07	~	~	~	NA	NA	NA	NA	NA	NA	2.07	2.07	2 of 2
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	~	17.96	~	~	~	NA	NA	NA	NA	NA	NA	17.96	17.96	2 of 2
TOTAL ORGANIC CARBON	~	~	540.17	~	~	~	NA	NA	NA	NA	NA	NA	540.17	540.17	2 of 2

NA: No activation

~: Activation that month, but no data or no sample taken

Results in **bold** indicate one or more detects in the month.

Yearly averages are calculated from individual results collected in the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Appendix C

- Table C-1 Prison Point CSO Facility Operations Summary, Fiscal Year 2005
- Table C-2 Prison Point CSO Facility Effluent Characterization, Fiscal Year 2005
- Table C-3 Prison Point CSO Facility Effluent Loadings, Fiscal Year 2005

Table C-1. Prison Point CSO Facility Operations Summary, FY05

Date	Rainfall	Discharge duration (hrs)	Total volume (MG)	Peak flow (MG)	pH (SU)	BOD (mg/L)	Effluent		
							TSS (mg/L)	Fecal coliform (col/100mL)	Chlorine residual (mg/L)
July									
5	0.88	2.5	5.59	156.0	7.5	29.9	202	24000	0.04
24	1.20	5	23.21	400.0	6.6	15.9	78	50	0.03
					6.3		69.5	30	0.03
					6.2		48.5	90	0.03
August									
13	0.80	7.33	27.96	329.0	6.7	20.4	167.0	290	0.03
							115.0	30	0.03
							184.0	1900	0.03
							148.0	140	0.89
							150.0	520	0.76
							106.0	10	0.03
15	1.01	5.33	10.69	119.0	7.1	11.3	54.0	10	5.50
							38.5	10	0.09
							63.0	1100	0.04
							30.0	190	0.03
							42.5	20	0.03
21	1.05	4.92	18.31	191.0					
September									
8	1.65	5.00	12.27	200.0					
9	0.22	3.08	7.05	150.0					
18	2.87	11.16	38.20	195.0					
28	1.88	8.05	29.42	187.0					
29	0.71	7.50	9.06	53.0					
October									
16	0.57	3.92	15.23	191.0					
November									
4	0.77	2.92	5.59	74.6					
25	0.57	3.33	5.45	148.0					
28	0.80	5.34	14.15	201.0					
December									
1	0.51	3.25	2.67	36.7	7.0	30.3	94.0	240	0.03
					6.8		60.0	100	0.03
7	0.99	4.42	7.09	92.0					
11	0.09	2.58	5.55	125.0					
23	0.93	4.03	16.30	277.0					
January									
14	0.44	5.25	6.49	73.0					
February									
10	0.86	4.67	5.89	116.0					
March									
12	0.80	3.83	4.35	70.0					
28	1.30	6.75	11.03	101.0					
29	0.49	4.00	7.97	90.0					
April									
2	0.81	4.42	12.25	146.0					
3	0.44	3.42	6.83	93.0					
23	0.49	1.00	1.76	59.0	6.2	69.2	310.0	14400	0.03
							178.0	60	0.03
24	0.30	0.75	1.00	60.2					
May									
24	0.92	2.95	2.08	59.0					
25	0.74	9.92	12.03	53.0					
26	0.54	5.17	6.05	83.0					
June									
8	0.58	4.83	6.29	63.0					
Total			146.62	337.81					
Average			4.73	10.90			29.5	120.6	172
Minimum			0.75	1.00	36.7	6.2	11.3	45.6	30
Maximum*			11.16	38.20	400.0	7.5	69.2	244.0	1095
Number of CSO events		24							

NA = No Activation.

* = Per the NPDES permit, maximum chlorine residual is the highest single sample.

Boxed dates indicate a single event spread out over multiple days.

Table C-2. Prison Point CSO Facility Effluent Characterization, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	1791.5	~	~	~	~	~	~	~	~	~	~	1791.50	1791.50	2 of 2
CADMIUM	~	0.6545	~	~	~	~	~	~	~	~	~	~	0.65	0.65	3 of 4
CHROMIUM	~	14.74	~	~	~	~	~	~	~	~	~	~	14.74	14.74	2 of 2
COPPER	~	70.3	~	~	~	~	~	~	~	~	~	~	70.30	70.30	2 of 2
LEAD	~	94.95	~	~	~	~	~	~	~	~	~	~	94.95	94.95	2 of 2
MERCURY	~	0.292	~	~	~	~	~	~	~	~	~	~	0.29	0.29	2 of 2
NICKEL	~	6.785	~	~	~	~	~	~	~	~	~	~	6.79	6.79	2 of 3
ZINC	~	178	~	~	~	~	~	~	~	~	~	~	178.00	178.00	2 of 2
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	0.5055	~	~	~	~	~	~	~	~	~	~	0.51	0.51	2 of 2
TOTAL ORGANIC CARBON	~	15.25	~	~	~	~	~	~	~	~	~	~	15.25	15.25	2 of 2

Table C-3. Prison Point CSO Facility Effluent Loadings, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	364.966	~	~	~	~	~	~	~	~	~	~	364.97	364.97	2 of 2
CADMIUM	~	0.117	~	~	~	~	~	~	~	~	~	~	0.12	0.12	3 of 4
CHROMIUM	~	2.848	~	~	~	~	~	~	~	~	~	~	2.85	2.85	2 of 2
COPPER	~	13.541	~	~	~	~	~	~	~	~	~	~	13.54	13.54	2 of 2
LEAD	~	18.115	~	~	~	~	~	~	~	~	~	~	18.12	18.12	2 of 2
MERCURY	~	0.052	~	~	~	~	~	~	~	~	~	~	0.05	0.05	2 of 2
NICKEL	~	1.339	~	~	~	~	~	~	~	~	~	~	1.34	1.34	2 of 3
ZINC	~	34.018	~	~	~	~	~	~	~	~	~	~	34.02	34.02	2 of 2
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	0.092	~	~	~	~	~	~	~	~	~	~	0.09	0.09	2 of 2
TOTAL ORGANIC CARBON	~	2.814	~	~	~	~	~	~	~	~	~	~	2.81	2.81	2 of 2

NA: No activation

~: Activation that month, but no data or no sample taken

Results in **bold** indicate one or more detects in the month.

Yearly averages are calculated from individual results collected in the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Appendix D

Table D-1 Somerville Marginal CSO Facility Operations Summary, Fiscal Year 2005

Table D-2 Somerville Marginal CSO Facility Effluent Characterization, Fiscal Year 2005

Table D-3 Somerville Marginal CSO Facility Effluent Loadings, Fiscal Year 2005

Table D-1. Somerville Marginal CSO Facility Operations Summary, FY05

Date	Rainfall	Discharge duration (hrs)	Total volume (MG)	Peak flow (MG)	pH (SU)	BOD (mg/L)	TSS (mg/L)	Effluent Fecal coliform (col/100mL)	Chlorine residual (mg/L)
July									
24	1.20	0.67	0.43	98					
August									
13	0.80	3.67	5.39	173.00					
15	1.01	2.95	1.96	29.0	6.7	6.5	63.0	30	0.03
							20.0	10	0.03
20	0.11	1.33	1.41	67.0					
21	1.05	4.22	5.81	87.0					
September									
8	1.65	1.80	0.72	46.0					
9	0.22	2.08	2.43	84.0	7.4	2.1	221.0	40	0.36
18	2.87	8.23	5.85	54.0					
28	1.88	3.45	5.79	87.0					
29	0.71	1.81	0.50	23.0					
October									
16	0.57	1.48	2.90	150.0	8.3	6.2	56.0	10	0.03
November									
4	0.77	1.42	0.86	17.7	6.8	42.4	126.0	20	0.03
							38.0	10	
5	0.01	0.52	0.31	17.7					0.03
25	0.57	0.27	0.18	4.3					
28	0.80	2.25	3.77	94.0					
December									
1	0.51	1.00	0.46	44.0					
7	0.99	6.17	1.72	10.6					
10	0.48	1.21	0.86	27.0					
23	0.93	2.75	4.61	106.0					
January									
14	0.44	1.98	0.75	23.1					
February									
10	0.86	1.37	1.41	11.0					
March									
12	0.80	0.92	0.36	41.0					
28	1.30	5.25	2.11	36.0					
29	0.49	2.22	1.20	24.0					
April									
2	0.81	2.00	2.05	68.0					
3	0.44	1.03	0.69	80.0					
24	0.30	0.87	0.36	24.0					
27	0.32	0.33	0.32	44.5					
May									
24	0.92	0.42	0.19	36.3					
25	0.74	0.25	0.26	25.8					
June		NA							
Total		63.92	55.66						
Average		2.13	1.86	54.4	7.3	14.3	100.1	18	0.11
Minimum		0.25	0.18	4.3	6.7	2.1	41.5	10	0.03
Maximum*		8.23	5.85	173.0	8.3	42.4	221.0	40	0.36

Number of CSO events 25

NA = No Activation.

* = Per the NPDES permit, maximum chlorine residual is the highest single sample.

Boxed dates indicate a single event spread out over multiple days.

Table D-2. Somerville Marginal CSO Facility Effluent Characterization, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	609	~	944	1010	~	~	~	~	1200	~	NA	940.75	1200.00	4 of 4
CADMIUM	~	0.164	~	0.374	0.366	~	~	~	~	0.241	~	NA	0.29	0.37	3 of 7
CALCIUM	~	3840	~	2760	4830	~	~	~	~	6550	~	NA	4495.00	6550.00	4 of 4
CHROMIUM	~	4.79	~	3.25	6.18	~	~	~	~	10.4	~	NA	6.16	10.40	4 of 5
COPPER	~	16.2	~	15.4	33.2	~	~	~	~	19.6	~	NA	21.10	33.20	4 of 4
LEAD	~	35.1	~	38.5	34.1	~	~	~	~	41.9	~	NA	37.40	41.90	4 of 4
MAGNESIUM	~	685	~	519	1040	~	~	~	~	2200	~	NA	1111.00	2200.00	4 of 4
MERCURY	~	0.105	~	0.164	0.0582	~	~	~	~	0.161	~	NA	0.12	0.16	4 of 4
NICKEL	~	1.11	~	1.48	2.1	~	~	~	~	4.14	~	NA	2.21	4.14	4 of 7
ZINC	~	58.7	~	49.5	116	~	~	~	~	96	~	NA	80.05	116.00	4 of 4
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	0.346	~	0.282	0.493	~	~	~	~	0.301	~	NA	0.36	0.49	4 of 4
TOTAL ORGANIC CARBON	~	7.79	~	12.45	9.67	~	~	~	~	6.99	~	NA	9.23	12.45	5 of 5

Table D-3. Somerville Marginal CSO Facility Effluent Loadings, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	9.95	~	22.83	7.24	~	~	~	~	6.91	~	NA	11.73	22.83	4 of 4
CADMIUM	~	0.0027	~	0.0090	0.0026	~	~	~	~	0.0014	~	NA	0.00	0.01	3 of 7
CALCIUM	~	62.77	~	66.75	34.64	~	~	~	~	37.69	~	NA	50.46	66.75	4 of 4
CHROMIUM	~	0.08	~	0.08	0.04	~	~	~	~	0.060	~	NA	0.07	0.08	4 of 5
COPPER	~	0.26	~	0.37	0.24	~	~	~	~	0.11	~	NA	0.25	0.37	4 of 4
LEAD	~	0.57	~	0.93	0.24	~	~	~	~	0.24	~	NA	0.50	0.93	4 of 4
MAGNESIUM	~	11.20	~	12.55	7.46	~	~	~	~	12.66	~	NA	10.97	12.66	4 of 4
MERCURY	~	0.0017	~	0.0040	0.0004	~	~	~	~	0.0009	~	NA	0.00	0.00	4 of 4
NICKEL	~	0.018	~	0.036	0.015	~	~	~	~	0.024	~	NA	0.02	0.04	4 of 7
ZINC	~	0.96	~	1.20	0.83	~	~	~	~	0.55	~	NA	0.89	1.20	4 of 4
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	5.66	~	6.82	3.54	~	~	~	~	1.73	~	NA	4.44	6.82	4 of 4
TOTAL ORGANIC CARBON	~	127.34	~	301.12	69.36	~	~	~	~	40.22	~	NA	134.51	301.12	5 of 5

NA: No activation

~: Activation that month, but no data or no sample taken

Results in **bold** indicate one or more detects in the month.

Yearly averages are calculated from individual results collected in the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Appendix E

Table E-1 Fox Point CSO Facility Operations Summary, Fiscal Year 2005

Table E-2 Fox Point CSO Facility Effluent Characterization, Fiscal Year 2005

Table E-3 Fox Point CSO Facility Effluent Loadings, Fiscal Year 2005

Table E-1. Fox Point CSO Facility Operations Summary, FY05

Date	Rainfall	Discharge duration (hrs)	Total volume (MG)	Peak flow (MG)	pH (SU)	BOD (mg/L)	TSS (mg/L)	Effluent	
								Fecal coliform (col/100mL)	Chlorine residual (mg/L)
July									
5	0.88	2.5	2.53	20.1	6.5	13.4	53	6700	0.03
24	1.20	3.05	9.06	133.00			37	10	0.03
August									
13	0.80	2.30	5.23	101.00	7.5	7.0	474.0	10	0.03
15	1.01	3.17	2.81	32.00			116.0	40	
21	1.05	2.80	3.55	41.00	6.6	12.4	115.0	10	0.03
							31.0	10	0.03
September									
8	1.65	1.48	1.54	19.50	6.6		22.0	1100	0.03
9	0.22	0.35	0.43	0.25					
18	2.87	5.10	9.26	92.00					
28	1.88	3.78	11.72	100.00	7.4	50.4	154.0	20	0.03
							158.0	20	0.03
							69.0	100	0.03
							23.0	390	1.47
29	0.71	2.33							
October									
16	0.57	2.38	3.13	66.00					
November									
4	0.77	0.87	0.67	23.00					
24	0.15	1.26	1.25	22.80					
28	0.80	1.22	1.42	58.00					
December									
1	0.51	2.58	1.29	19.00					
7	0.99	2.16	1.41	28.10					
11	0.09	1.93	0.78	19.00					
23	0.93	5.23	3.67	44.30					
January									
14	0.44	2.25	2.28	20.40					
February									
10	0.86	2.85	2.99	27.00					
March									
28	1.30	3.33	2.90	29.00					
29	0.49	2.65	1.92	23.60					
April									
2	0.81	3.00	2.69	37.00					
23	0.49	1.92	0.91	22.00					
24	0.30	1.53	1.13	24.00					
May									
25	0.74	3.90	3.57	45.00					
26	0.54	3.25	2.52	28.00					
June									
	NA								
Total		69.17	80.66						
Average		2.56	3.10		20.8	107.2	81	0.10	
Minimum		0.35	0.43	0.25	6.5	7.0	22.0	10	0.03
Maximum*		5.23	11.72	133.00	7.5	50.4	295.0	1100	1.47

Number of CSO events

23

NA = No Activation.

* = Per the NPDES permit, maximum chlorine residual is the highest single sample.

Boxed dates indicate a single event spread out over multiple days.

Table E-2. Fox Point CSO Facility Effluent Characterization, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	3070	2780	~	~	~	~	~	~	~	~	NA	2925.00	3070.00	2 of 2
CADMIUM	~	2.18	0.347	~	~	~	~	~	~	~	~	NA	1.26	2.18	3 of 4
CHROMIUM	~	6.94	5.61	~	~	~	~	~	~	~	~	NA	6.28	6.94	2 of 2
COPPER	~	24.8	31.1	~	~	~	~	~	~	~	~	NA	27.95	31.10	2 of 2
LEAD	~	93.5	121	~	~	~	~	~	~	~	~	NA	107.25	121.00	2 of 2
MERCURY	~	0.145	0.312	~	~	~	~	~	~	~	~	NA	0.23	0.31	2 of 2
NICKEL	~	3.61	5.57	~	~	~	~	~	~	~	~	NA	4.59	5.57	3 of 3
ZINC	~	90.4	112	~	~	~	~	~	~	~	~	NA	101.20	112.00	2 of 2
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	0.324	0.548	~	~	~	~	~	~	~	~	NA	0.44	0.55	2 of 2
TOTAL ORGANIC CARBON	~	11.5	7.48	~	~	~	~	~	~	~	~	NA	9.49	11.50	2 of 2

Table E-3. Fox Point CSO Facility Effluent Loadings, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	~	133.91	271.73	~	~	~	~	~	~	~	~	NA	202.82	271.73	2 of 2
CADMIUM	~	0.10	0.034	~	~	~	~	~	~	~	~	NA	0.06	0.10	3 of 4
CHROMIUM	~	0.30	0.55	~	~	~	~	~	~	~	~	NA	0.43	0.55	2 of 2
COPPER	~	1.08	3.04	~	~	~	~	~	~	~	~	NA	2.06	3.04	2 of 2
LEAD	~	4.08	11.83	~	~	~	~	~	~	~	~	NA	7.95	11.83	2 of 2
MERCURY	~	0.006	0.030	~	~	~	~	~	~	~	~	NA	0.02	0.03	2 of 2
NICKEL	~	0.16	0.54	~	~	~	~	~	~	~	~	NA	0.35	0.54	3 of 3
ZINC	~	3.94	10.95	~	~	~	~	~	~	~	~	NA	7.45	10.95	2 of 2
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	~	14.13	53.56	~	~	~	~	~	~	~	~	NA	33.85	53.56	2 of 2
TOTAL ORGANIC CARBON	~	501.61	731.13	~	~	~	~	~	~	~	~	NA	616.37	731.13	2 of 2

NA: No activation

~: Activation that month, but no data or no sample taken

Results in **bold** indicate one or more detects in the month.

Yearly averages are calculated from individual results collected in the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Appendix F

- Table F-1 Commercial Point CSO Facility Operations Summary, Fiscal Year 2005
- Table F-2 Commercial Point CSO Facility Effluent Characterization, Fiscal Year 2005
- Table F-3 Commercial Point CSO Facility Effluent Loadings, Fiscal Year 2005

Table F-1. Commercial Point CSO Facility Operations Summary, FY05

Date	Rainfall	Discharge duration (hrs)	Total volume (MG)	Peak flow (MG)	pH (SU)	BOD (mg/L)	TSS (mg/L)	Effluent Fecal coliform (col/100mL)	Chlorine residual (mg/L)
July									
2	0.70	0.95	1.4	80	6.8	32.5	142	117000	0.00
5	0.88	4.33	2.73	83	6.0	18.1	284	10	0.03
							39	33000	0.03
							62	10	0.03
							44	10	0.03
							33	10	0.03
24	1.20	3.25	10.18	240					
August									
13	0.80	4.12	7.46	90.00	6.8	52.3	792.0	850	0.03
15	1.01	2.50	4.71	48.00					
21	1.05	2.77	4.43	100.00					
September									
8	1.65	0.68	1.44	43.00					
9	0.22	0.41	0.42	25.00					
18	2.87	8.85	16.28	158.00					
28	1.88	4.35	12.66	100.0	7.3	10.6	59.0	10	0.03
							365.0	200	0.03
							72.0	10	0.03
							46.0	10	0.07
29	0.71	1.50	2.34	24.00					
October									
16	0.57	1.97	3.66	100.00					
November									
4	0.77	1.63	2.79	53.00		27.3	194.0	20	0.03
25	0.57	1.57	2.00	37.00					
28	0.80	2.38	3.97	100.00					
December									
7	0.99	3.20	1.87	48.00					
23	0.93	3.70	4.72	120.00					
January									
14	0.44	2.63	2.07	20.60					
February									
10	0.86	1.38	1.02	24.00					
March									
28	1.30	2.92	5.01	37.10					
29	0.49	2.75	1.33	21.00					
April									
2	0.81	6.00	3.73	30.00					
23	0.49	2.32	1.78	18.00					
27	0.32	0.58	0.72	15.50					
May									
24	0.92	1.27	0.75	18.00			18000	0.03	
25	0.74	4.00	3.55	19.00	6.8	8.0	28.0	10	0.03
							23.0	10	0.03
							26.0	10	0.03
							26.0	10	9.14
							62.0	740	0.03
							73.0	10	0.03
							53.0	10	0.03
26	0.54	1.83	1.51	22.00			34.0	10	0.03
							53.0	10	0.03
							49.0	10	0.10
							37.0	10	
June									
9	0.45	1.20	0.92	57.00					
Total			75.04	105.45					
Average			2.68	3.77			24.8	173.2	137
Minimum			0.41	0.42	15.50	6.0	8.0	42.2	20
Maximum*			8.85	16.28	240.00	7.3	52.3	433.3	117000
Number of CSO events			23						

NA = No Activation.

* = Per the NPDES permit, maximum chlorine residual is the highest single sample.

Boxed dates indicate a single event spread out over multiple days.

Table F-2. Commercial Point CSO Facility Effluent Characterization, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	871.5	8620	540	~	1950	~	~	~	~	~	~	~	2995.38	8620.00	5 of 5
CADMIUM	0.4735	1.14	0.228	~	0.377	~	~	~	~	~	~	~	0.55	1.14	5 of 10
CHROMIUM	12.5	29.1	2.18	~	10.3	~	~	~	~	~	~	~	13.52	29.10	5 of 6
COPPER	13.575	116	9.71	~	23.1	~	~	~	~	~	~	~	40.60	116.00	6 of 7
LEAD	36.2	421	27.5	~	75.5	~	~	~	~	~	~	~	140.05	421.00	5 of 5
MERCURY	0.0716	0.494	0.0623	~	0.0775	~	~	~	~	~	~	~	0.18	0.49	5 of 5
NICKEL	4.2475	12.8	0.928	~	6.1	~	~	~	~	~	~	~	6.02	12.80	6 of 8
ZINC	88.1	481	51.3	~	97.6	~	~	~	~	~	~	~	179.50	481.00	5 of 5
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	0.616	0.963	0.485	~	0	~	~	~	~	~	~	~	0.52	0.96	4 of 5
TOTAL ORGANIC CARBON	22.6	39.2	9.53	~	9.54	~	~	~	~	~	~	~	20.22	39.20	5 of 5

Table F-3. Commercial Point CSO Facility Effluent Loadings, FY05

	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Average	Maximum	Times Detected
Metals (ug/L)															
ALUMINUM	13.80	536.31	57.02	~	45.37	~	~	~	~	~	~	~	163.12	536.31	5 of 5
CADMIUM	0.008	0.071	0.024	~	0.0088	~	~	~	~	~	~	~	0.03	0.07	5 of 10
CHROMIUM	0.22	1.81	0.23	~	0.24	~	~	~	~	~	~	~	0.63	1.81	5 of 6
COPPER	0.22	7.22	1.03	~	0.54	~	~	~	~	~	~	~	2.25	7.22	6 of 7
LEAD	0.61	26.19	2.90	~	1.76	~	~	~	~	~	~	~	7.87	26.19	5 of 5
MERCURY	0.001	0.031	0.007	~	0.0018	~	~	~	~	~	~	~	0.01	0.03	5 of 5
NICKEL	0.069	0.80	0.10	~	0.14	~	~	~	~	~	~	~	0.28	0.80	6 of 8
ZINC	1.57	29.93	5.42	~	2.27	~	~	~	~	~	~	~	9.80	29.93	5 of 5
Surfactants and Total Organic Carbon (mg/L)															
SURFACTANTS	10.04	59.91	51.21	~	0	~	~	~	~	~	~	~	30.29	59.91	4 of 5
TOTAL ORGANIC CARBON	371.47	2438.88	1006.22	~	221.98	~	~	~	~	~	~	~	1009.64	2438.88	5 of 5

NA: No activation

~: Activation that month, but no data or no sample taken

Results in **bold** indicate one or more detects in the month.

Yearly averages are calculated from individual results collected in the fiscal year.

Non-detected compounds are assumed to equal one half of the detection limit for metals and inorganics and one tenth of the reporting limit for organic compounds.

Appendix G: NPDES Monitoring Requirements

Overview

The Environmental Protection Agency (EPA) mandates that any discharge to a body of water must be permitted through the National Pollutant Discharge Elimination System (NPDES). The EPA and the Massachusetts Department of Environmental Protection (DEP) jointly issued a NPDES permit to MWRA for the Deer Island treatment plant and six CSO treatment facilities: Cottage Farm, Prison Point, Somerville Marginal, Constitution Beach, Fox Point, and Commercial Point.

The limits set in the MWRA NPDES permit are limitations for secondary treatment plants. In March 2001, secondary Battery C underwent start-up at Deer Island, substantially finishing the construction process at the plant. Before the completion of Battery C, though, plant effluent was already largely in compliance with the new permit. Additionally, in September of 2000, Constitution Beach, one of the six permitted CSO facilities, shut down, leaving five permitted and operational CSO facilities.

In addition, MWRA monitors the influent quality of wastewater. Those monitoring results provide the basis for determining the adequacy of existing local limits to protect the treatment plants and Boston Harbor. Local Limits, enforced by MWRA's Toxic Reduction and Control (TRAC) department, allow the discharge of toxic chemicals from industrial sources to be regulated. The MWRA submitted proposed local limits in FY00 reflecting the new secondary treatment requirements. Regulators approved the new local limits and they became effective in June 2003, at the end of FY03. Under the pretreatment program requirements, local limits must be re-evaluated every five years.

MWRA not only monitors to comply with the NPDES effluent requirements, but also has its own monitoring programs, including monitoring at DITP, Boston Harbor, and Massachusetts Bay. These monitoring programs serve to assure appropriate control of discharges to the system, to assure the most cost-effective wastewater treatment while meeting water quality standards, and to assure the quality of life of the organisms and health of the animal communities living in the receiving waters.

G.1 NPDES Permit

Under the NPDES permit, “in compliance with the provisions of the Clean Water Act, as amended, 33 U.S.C. §§ 1251 et seq., and the Massachusetts Clean Water Act, as amended, Mass. Gen. Laws, ch. 21, §§ 26-53, Massachusetts Water Resources Authority is authorized to discharge from MWRA Publicly Owned Treatment Works, Deer Island Treatment Plant, Deer Island, Boston, MA 02152 (Discharge serial number T01), which discharges to receiving waters located in Massachusetts Bay, which is adjacent to Cape Cod Bay, and a part of the Gulf of Maine; and from Combined Sewer Overflow Outfalls, which discharge to the Charles River, Inner Harbor, Mystic River, Boston Harbor, Dorchester Bay, Alewife Brook; in accordance with effluent limitations, monitoring requirements and other conditions set in the permit...”

**G.1.a
Monitoring Requirements and Effluent Limitations**

The NPDES permit establishes monitoring requirements for the new Deer Island outfall tunnel (T01). The permit also regulates CSO treatment facility outfalls at Cottage Farm (MWR201), Prison Point (MWR203), Somerville Marginal (which has two outfalls from a single facility, the primary outfall, MWR205, and the relief outfall, MWR205A), Constitution Beach (MWR207, now closed), Fox Point (MWR209), and Commercial Point (MWR211). The permit also establishes a comprehensive receiving water monitoring plan, the Ambient Monitoring Plan, in Massachusetts Bay.

**G.1.b
Reporting Requirements**

In addition to Deer Island and CSO monitoring requirements, the NPDES permit requires numerous reports on the state of MWRA sewerage and operational systems. These include reports on infiltration/inflow, CSO facilities and collection systems maintenance and inspection, operational upsets, dry weather and sanitary sewer overflows, operational bypasses, monthly Discharge Monitoring Reports (DMRs), and reporting on the effects of discharges through the Ambient Monitoring Plan. In addition, the Contingency Plan mandates a number of additional thresholds and stipulates actions needed if they are exceeded. Table G-1 presents a summary of the permit limits and monitoring requirements for Deer Island and Table G-2 does the same for the CSOs.

Table G-1. Effluent Limitations and Monitoring Requirements for DITP Outfall T01

Effluent Characteristic	Discharge Limitation		
	Average Monthly	Average Weekly	Maximum Daily
Flow	Report*	N/A	Report
Dry Day Flow	436 MGD	N/A	Report
cBOD	25 mg/L	40 mg/L	Report
TSS	30 mg/L	45 mg/L	Report
pH	Not less than 6.0 nor greater than 9.0 at any time.		
Fecal Coliform ^a	N/A	14,000 colonies/100mL	14,000 colonies/100mL
Chlorine, Total Residual	456 µg/L	N/A	631 µg/L
PCBs, Arochlor: 1016, 1221, 1232, 122, 1248, 1254, 1260	0.000045 µg/L	N/A	Report
Settleable Solids	N/A	Report	Report
Chlorides, Influent	N/A	N/A	Report
Mercury	Report	N/A	Report
Chlordane	Report	N/A	Report
4,4-DDT	Report	N/A	Report
Dieldrin	Report	N/A	Report
Heptachlor	Report	N/A	Report
Ammonia-Nitrogen	Report	N/A	N/A
Total Kjeldahl Nitrogen	Report	N/A	N/A
Total Nitrate	Report	N/A	N/A
Total Nitrite	Report	N/A	N/A
Cyanide, Total	Report	N/A	Report
Copper, Total	Report	N/A	Report
Arsenic, Total	Report	N/A	Report
Hexachlorobenzene	Report	N/A	Report
Aldrin	Report	N/A	Report
Heptachlor Epoxide	Report	N/A	Report
PCBs, Total	Report	N/A	Report
Volatile Organic Compounds	Report	N/A	Report
LC50 ^b	Tests involve using mysid shrimp (<i>Mysidopsis bahia</i>) and inland silverside (<i>Menidia beryllina</i>) in 48 hour acute toxicity tests. LC50 must be achieved in a solution that is 50% effluent.		
C-NOEC ^c	C-NOEC tests involve larval inland silverside (<i>Menidia beryllina</i>) and sea urchin (<i>Arbacia punctulata</i>). <i>Menidia</i> tests involve a week's worth of exposure to various effluent concentrations. The <i>Arbacia</i> toxicity test tests fertilization in the test organism. In both cases, no chronic effects must be observed in a solution composed of 1.5% effluent.		

Footnotes *, a, b, and c are listed underneath Table G-2 on the next page.

Table G-2. Effluent Limitations and Monitoring Requirements for CSO Outfalls		
Effluent Characteristic	Discharge Limitation	
	Average Monthly	Average Weekly
Rainfall	Report*	Report
Flow	Report	Report
TSS	Report	Report
BOD	Report	Report
Chlorine, Total Residual	0.1 mg/L	0.25 mg/L max hourly
pH	Not less than 6.5 nor greater than 8.5	
Fecal Coliform	Must meet Massachusetts Water Quality Standards	
LC50 ^b	<p>Since Cottage Farm and Somerville Marginal's relief outfall both discharge in freshwater, acute toxicity tests are required with daphnids (<i>Ceriodaphnia dubia</i>) and fathead minnows (<i>Pimephales promelas</i>). There is no limit to effluent concentration used to determine LC50, but results are reportable.</p> <p>All other CSO facilities discharge to marine waters, so the acute test organisms are mysid shrimp (<i>Mysidopsis bahia</i>) and inland silverside (<i>Menidia beryllina</i>). LC50 results are reportable.</p>	

* No limit, but values reported to EPA and DEP.
^a There are two other fecal coliform limits. The first is that not more than 10% of the individual samples collected in a month can have a count higher than 14,000 colonies/100mL. Typically, given 3 samples a day, this means no more than 9 samples can have a count higher than 14,000 in a given month. The second limit is that no more than 3 consecutive samples can exceed 14,000 colonies/100mL.
^b LC50: the concentration of effluent in a sample that causes mortality in 50% of the test population at a specific time of observation.
^c C-NOEC: Chronic No Observed Effect Concentration is the highest concentration of effluent to which organisms are exposed in a life cycle or partial life cycle test which has no adverse effects (on growth, survival and reproduction).

G.2 Monitoring Programs

In FY05, MWRA conducted several monitoring programs. However, this report presents only the influent and effluent monitoring programs. The receiving water monitoring programs are too complex to cover in a single document. More information on monitoring in Massachusetts Bay and Boston Harbor can be found at:

<http://www.mwra.com/harbor/html/bhrecov.htm>

G.2.a Treatment Plant Monitoring

Monitoring at DITP has two main components: influent monitoring and effluent monitoring.

Influent monitoring characterizes the influent to the Deer Island Treatment Plant. Monitoring for conventional parameters is necessary for some parameters to meet NPDES reporting requirements, but monitoring many other parameters is critical for process control to ensure optimal plant functioning. Influent monitoring data provides influent loading rates and the basis for determining treatment plant efficiency. Influent monitoring for non-conventional parameters is an important part of MWRA's source reduction and Local Limits program run by TRAC.

Effluent monitoring characterizes the quality of the effluent discharged to Massachusetts Bay. With the addition of whole effluent toxicity (WET) testing, the parameters measured in the effluent are similar to those measured in the influent. The NPDES permit requires effluent monitoring and imposes permit limits on both conventional and priority pollutants to ensure the health of the receiving water. Additionally, the permit also requires the reporting of non-priority pollutants such as nutrients, although no limits are set on them.

Table G-3 lists the treatment plant monitoring program parameters, including

sample type, sampling frequency and analytical procedures used.

**G.2.b
Combined
Sewer
Overflow
Facilities
Monitoring
Program**

The CSO Monitoring Program includes influent and effluent monitoring at the five CSO facilities (the sixth, Constitution Beach, was closed in early FY01). Influent and effluent samples are collected and tested for conventional parameters at all five CSO facilities. Selected priority pollutants and metals are also analyzed in the effluent. Table G-4 lists the CSO monitoring program parameters, including sample type, sampling frequency and analytical procedures used.

**G.2.c
Sewer System
Monitoring
Program**

The sewer system monitoring program, which attempts to identify Sanitary Sewer Overflows (SSOs), involves conducting visual inspections of areas in the separate sewer system that have a history of discharging during or shortly after a heavy rainfall event. Because of the hydraulics of the South System, discharges occur in manholes or other low-lying areas, while discharges in the North System are the result of combined sewage overwhelming sewage system capacity.

**G.3
Treatment of
Results**

It can be difficult to interpret laboratory results to ensure that they are representative of the sample, especially when the results are at or below method detection levels. For the conventional parameters measured in these monitoring programs, calculating the average concentration of a particular parameter is straightforward: the arithmetic average is used. However, the concentrations of metals, pesticides and organics are frequently below method detection levels, and data are manipulated. Appendix J gives a brief description of method detection limits and how measurements below detection limits are treated in this report.

Daily loadings (in lbs/day) were calculated using the formula:

$$\text{Loading} = Q \times C \times 8.34$$

Q = flow (mgd)
C = concentration (mg/L)
8.34 = unit conversion factor

To calculate monthly average concentrations for priority pollutants (metals, cyanide, pesticides/PCBs and organic compounds), the loadings of the pollutant during each sampling event for that month were added and then divided by the total flow during those events.

Average annual concentrations were calculated using the same method, taking each individual sampling event into account in the calculation.

It should be kept in mind that with the large flows going through the Deer Island Treatment Plant, taking one small sample might not always be truly representative. It is also important to keep in mind that certain parameters (conventional) were analyzed daily while other parameters (priority pollutants)

were analyzed only two or three times per month.

Table G-3. POTW Monitoring Program				
Parameter	Sample Type ¹	Sampling Frequency		
		Influent	Effluent	Analytical Method ²
Metals				
Aluminum	Composite	2 x month	Weekly	200.7
Antimony	Composite	2 x month	2 x month	200.7
Arsenic	Composite	2 x month	2 x month	200.7, 206.2
Beryllium	Composite	2 x month	2 x month	200.7
Boron	Composite	2 x month	2 x month	200.7
Cadmium	Composite	2 x month	Weekly	200.7, 213.2
Chromium	Composite	2 x month	Weekly	200.7, 218.2
Chromium (Hexavalent)	Composite	2 x month	2 x month	3500-CRD ³
Copper	Composite	2 x month	Weekly	200.7, 200.8, 220.2
Iron	Composite	2 x month	2 x month	200.7
Lead	Composite	2 x month	Weekly	200.7, 239.2
Mercury	Composite	2 x month	Weekly	245.2, 1631
Molybdenum	Composite	2 x month	Weekly	200.7, 246.2
Nickel	Composite	2 x month	Weekly	200.7, 249.2
Selenium	Composite	2 x month	2 x month	200.7, 270.2
Silver	Composite	2 x month	Weekly	200.7, 272.2
Thallium	Composite	2 x month	2 x month	200.7, 279.2
Zinc	Composite	2 x month	Weekly	200.7
Organics and Other Compounds				
Cyanide	Grab	2 x month	4 x month	335.2
Fats, Oils, and Grease	Grab	2 x month	Weekly	1664
MBAS	Composite	2 x month	2 x month	425.1
PAHs	Composite	2 x month	Weekly	
PCBs	Composite	2 x month	Weekly	8080 MOD
Pesticides	Composite	2 x month	Weekly	608
Petroleum Hydrocarbons	Grab	2 x month	Weekly	418.1
Phenol	Composite	2 x month	Weekly	420.2 MO
Semi-volatile Organics	Composite	2 x month	2 x month	625
Sulfate	Composite	2 x month	*	300.0
Total Organic Carbon	Composite	*	2 x month	415.1
Volatile Organics	Grab	2 x month	2 x month	624
Whole Effluent Toxicity	Composite	*	1 x month	WET Test Protocols
Conventional				
Biochemical O ₂ Demand	Composite	Daily	Daily	5210 B ³
Carbonaceous BOD	Composite	Daily	Daily	5210 B ³
Chemical O ₂ Demand	Composite	Daily	Daily	HACH 8000
Chlorides	Composite	Daily	Daily	300.0
<i>Enterococci</i>	Grab	*	Daily	9230 C ³
Fecal Coliform	Grab	*	3 x Daily	9222 D ³
pH	Grab	Daily	Daily	150.1
Settleable Solids	Grab	Daily	Daily	160.5
Temperature	Grab	Daily	Daily	170.1
Total Chlorine Residual	Grab	*	3 x Daily	330.5
Total Coliform	Grab	*	3 x Daily	9222 B ³
Total Suspended Solids	Composite	Daily	Daily	160.2
Nutrients				
Alkalinity	Composite	Weekly	*	310.1
Ammonia	Composite	Weekly	Weekly	350.1
Nitrates	Composite	Weekly	Weekly	353.2
Nitrate/Nitrite	Composite	*	Weekly	353.2
Nitrites	Composite	Weekly	Weekly	353.2
Orthophosphorus	Composite	Weekly	*	365.1
Total Kjeldahl Nitrogen	Composite	Weekly	Weekly	351.2
Total Phosphorus	Composite	Weekly	*	365.1

* No sampling.

¹ Influent and effluent composite samples are 24-hour time composite samples.

² EPA Methods.

³ Standard Methods.

Table G-4. CSO Monitoring Program

Parameter	Sample Type	Sampling Frequency	Analytical Method ¹
Biochemical O ₂ Demand	Grab/Composite ³	4 x year	5210 B ²
Fecal Coliform	Grab ⁴	4 x year	9222 D ²
pH	Grab	4 x year	150.1
Total Chlorine Residual	Grab ³	4 x year	330.5
Total Suspended Solids	Grab ³	4 x year	160.2
Whole Effluent Toxicity	Composite ⁵	2 x year	WET Test Protocols

¹ EPA Methods.
² Standard Methods.
³ A grab sample must be collected within the first 2 hours of activation (30 minutes for Somerville Marginal in the first permit year) and then hourly samples are to be taken for the duration of the overflow, for not longer than 24 hours. All BOD samples are then composited.
⁴ A grab sample must be collected within the first 2 hours of activation (30 minutes for Somerville Marginal in the first permit year) and then hourly samples are to be taken for the duration of the overflow, for not longer than 24 hours. During the first permit year, the first sample is held and subsampled hourly for fecal coliforms.
⁵ Cottage Farm and the Somerville Marginal relief outfall discharge to freshwater so the organisms used for toxicity testing are the daphnid *Ceriodaphnia dubia* and the fathead minnow *Pimephales promelas*. The other facilities discharge to marine waters, so the test organisms are the inland silverside *Menidia beryllina* and the mysid shrimp *Mysidopsis bahia*.

Appendix H: An Overview of the MWRA Sewerage System and Facilities

Overview

The MWRA is responsible for the collection, transport, pumping, treatment, and disposal of sewage in Boston and the greater Boston area. In addition to the Deer Island Treatment Plant, the MWRA operates another treatment plant, serving the town of Clinton and the Lancaster Sewer District, under special arrangements that originated when the Metropolitan District Commission (MDC) acquired land in Clinton for the Wachusett Reservoir. The Clinton Treatment Plant operates under a separate permit from the Boston NPDES permit and is not discussed in this report.

The MWRA serves 43 communities with a total population of about two million people, 5,500 businesses, and 1,400 industries. More than 5,400 miles of town- and city-owned local sewers connect at over 1,800 points to over 230 miles of MWRA interceptor sewers. Also included in the vast sewerage system are twelve pumping stations, five headworks, over 80 combined sewer relief overflows and five CSO treatment facilities. Table H-1 lists the MWRA treatment facilities and relevant information pertaining to each facility.

The Deer Island Treatment Plant in Winthrop serves the 43 communities in the metropolitan Boston sewerage system and is allowed to discharge under the Boston NPDES Permit. The sewerage system is divided into two major regions: the North and the South Systems. Table H-2 lists the sewerage service area population by community.

Table H-1. List of Treatment Facilities and Discharge Locations

Facility	Location	First Year of Operation	Treatment Process	Design Flow (mgd)	Conduit Size In	Conduit Size Out	Outfall Number	Receiving Water
Combined Sewer Overflow (CSO) Facilities								
Cottage Farm	Memorial Dr. near Boston University bridge, Cambridge, MA	1971	Screening Settling Chlorination Dechlorination	233	72" N. Charles Relief 42" S. Charles Relief 54" Brookline	96" outfall	MWR201	Charles River
Prison Point	Near Museum of Science bridge, Cambridge, MA	1980	Screening Settling Chlorination Dechlorination	385	10' diameter	8' diameter	MWR203	Boston Inner Harbor
Somerville Marginal	McGrath Highway under I-93, Somerville, MA	1973†	Screening Chlorination Dechlorination	245	7' x 7.5' 84" diameter	6' x 8'	MWR205	Mystic River
Fox Point	Freeport St., Dorchester, MA	1989	Screening Chlorination Dechlorination	119	10' x 12'	10' x 12'	MWR209	Dorchester Bay, Boston Harbor
Commercial Point	Victory Rd., Dorchester, MA	1991	Screening Chlorination Dechlorination	194	15' x 11'	15' x 11'	MWR211	Dorchester Bay, Boston Harbor

† Rehabilitated in 1988

Table H-2. Sewerage Service Area Population By Community

Town	Total Community	Population ¹ Sewered	MWRA Sewerage System		Population Served By	
			North	South	North System ²	South System ²
Arlington	42,140	42,098	x		42,098	
Ashland	15,392	10,774		x		10,774
Bedford	12,647	11,256	x		11,256	
Belmont	24,045	23,540	x		23,540	
Boston	589,281	588,692	x	x	418,056	136,836
Braintree	33,917	33,883		x		33,883
Brookline	57,032	56,462	x	x	29,381	23,991
Burlington	22,923	22,510	x		22,510	
Cambridge	101,807	101,705	x		101,705	
Canton	21,341	15,579		x		15,579
Chelsea	34,913	34,913	x		34,913	
Dedham	23,378	21,975		x		21,975
Everett	37,772	37,734	x		37,734	
Framingham	66,827	62,817		x		62,817
Hingham	6,782	6,126		x		6,126
Holbrook	10,877	8,484		x		8,484
Lexington	30,663	29,130	x		29,130	
Malden	56,155	56,099	x		56,099	
Medford	55,137	55,082	x		55,082	
Melrose	26,963	26,936	x		26,936	
Milton	26,010	24,449	x	x	1,843	22,279
Natick	32,384	27,332		x		27,332
Needham	29,197	27,854		x		27,854
Newton	83,880	82,202	x	x	42,786	35,390
Norwood	28,844	28,815		x		28,815
Quincy	89,187	89,098		x		89,098
Randolph	31,044	30,858		x		30,858
Reading	23,680	22,330	x		22,330	
Revere	47,496	47,449	x		47,449	
Somerville	76,922	76,845	x		76,845	
Stoneham	22,165	21,700	x		21,700	
Stoughton	27,227	17,698		x		17,698
Wakefield	24,817	23,757	x		23,757	
Walpole	23,199	15,079		x		15,079
Waltham	59,073	58,482	x		58,482	
Watertown	32,857	32,857	x		32,857	
Wellesley	26,671	25,684		x		25,684
Westwood	14,181	13,472		x		13,472
Weymouth	54,754	51,852		x		51,852
Wilmington	21,629	3,699	x		3,699	
Winchester	21,093	21,072	x		21,072	
Winthrop	18,235	18,235	x		18,235	
Woburn	38,003	36,103	x		36,103	
TOTAL	2,122,540	2,042,717			1,295,598	705,876

¹Community population data are from MWRA's I/I program, August 2004 report.

MWRA's

I/I Program; this is the last estimate available (from the FY00 NPDES Compliance Summary Report, ENQUAD 2001-04).

H.1
North System The North System serves a population of about 1.3 million and is located to the north and west of Boston. It covers an area of about 168 square miles. Most of the North System is a separate system – different conduits carry sanitary wastewater and storm water. However, portions of Boston, Cambridge, Somerville, and Chelsea still have combined sewers, where the same conduits carry sanitary and storm water. Combined sewers serve about 20 percent of the North System service area. Community sewer lines tie into the MWRA system through interceptor lines that feed into the four headworks facilities in the North System.

Two deep rock tunnels, the Boston Main Drainage Tunnel (BMDT) and the North Facilities Metropolitan Relief Tunnel (North Metro Relief), connect the three remote headworks to the North Main Pump Station (NMPS) on Deer Island. The seven-mile BMDT originates at the Ward Street Headworks, continues to the Columbus Park Headworks, and runs under Boston Harbor to the NMPS. The four-mile North Metro Relief Tunnel connects the Chelsea Creek Headworks to the NMPS. The two tunnels combined can handle approximately 800 mgd, matching the combined peak flow capacity of 788 mgd from the three remote headworks.

A fourth headworks facility, the Winthrop Terminal, is located on Deer Island and receives flows from the city of Winthrop and the East Boston (Caruso) Pump Station through the North Metro Trunk Sewer. Figure H-1 on the next page shows the North System schematics.


H.1.a
North System
Pump Stations The MWRA North System has four pump stations. The Alewife Brook (64 mgd), Caruso (110 mgd), DeLauri (90 mgd), and Allison Hayes (11 mgd) pump stations convey wastewater to the headworks facilities. The four pump stations receive flow from interceptor lines as follows:

Alewife Brook Pump Station	Lexington Branch Sewer
	Alewife Branch Sewer
	Alewife Branch Conduit
Caruso Pump Station	Revere Branch Sewer
	East Boston Branch Sewer
	North Metro Relief Sewer*
DeLauri Pump Station	Cambridge Branch Sewer
	Charlestown Branch Sewer
	Medford-Somerville Branch Sewer
	Prison Point Pump Station
Allison Hayes Pump Station	Somerville Marginal CSO Overflow**
	Wakefield Branch Sewer

*: When flow to the Chelsea Creek Headworks is held back, wastewater is diverted to the Caruso Pump Station.

**: During low-intensity rainfall when line capacity is not exceeded, the combined wastewater is pumped back to the trunk sewers and ultimately to the DeLauri station.

Figure H-1. North System Pump Stations, Headworks, CSOs and Tunnel Hydraulic Schematic

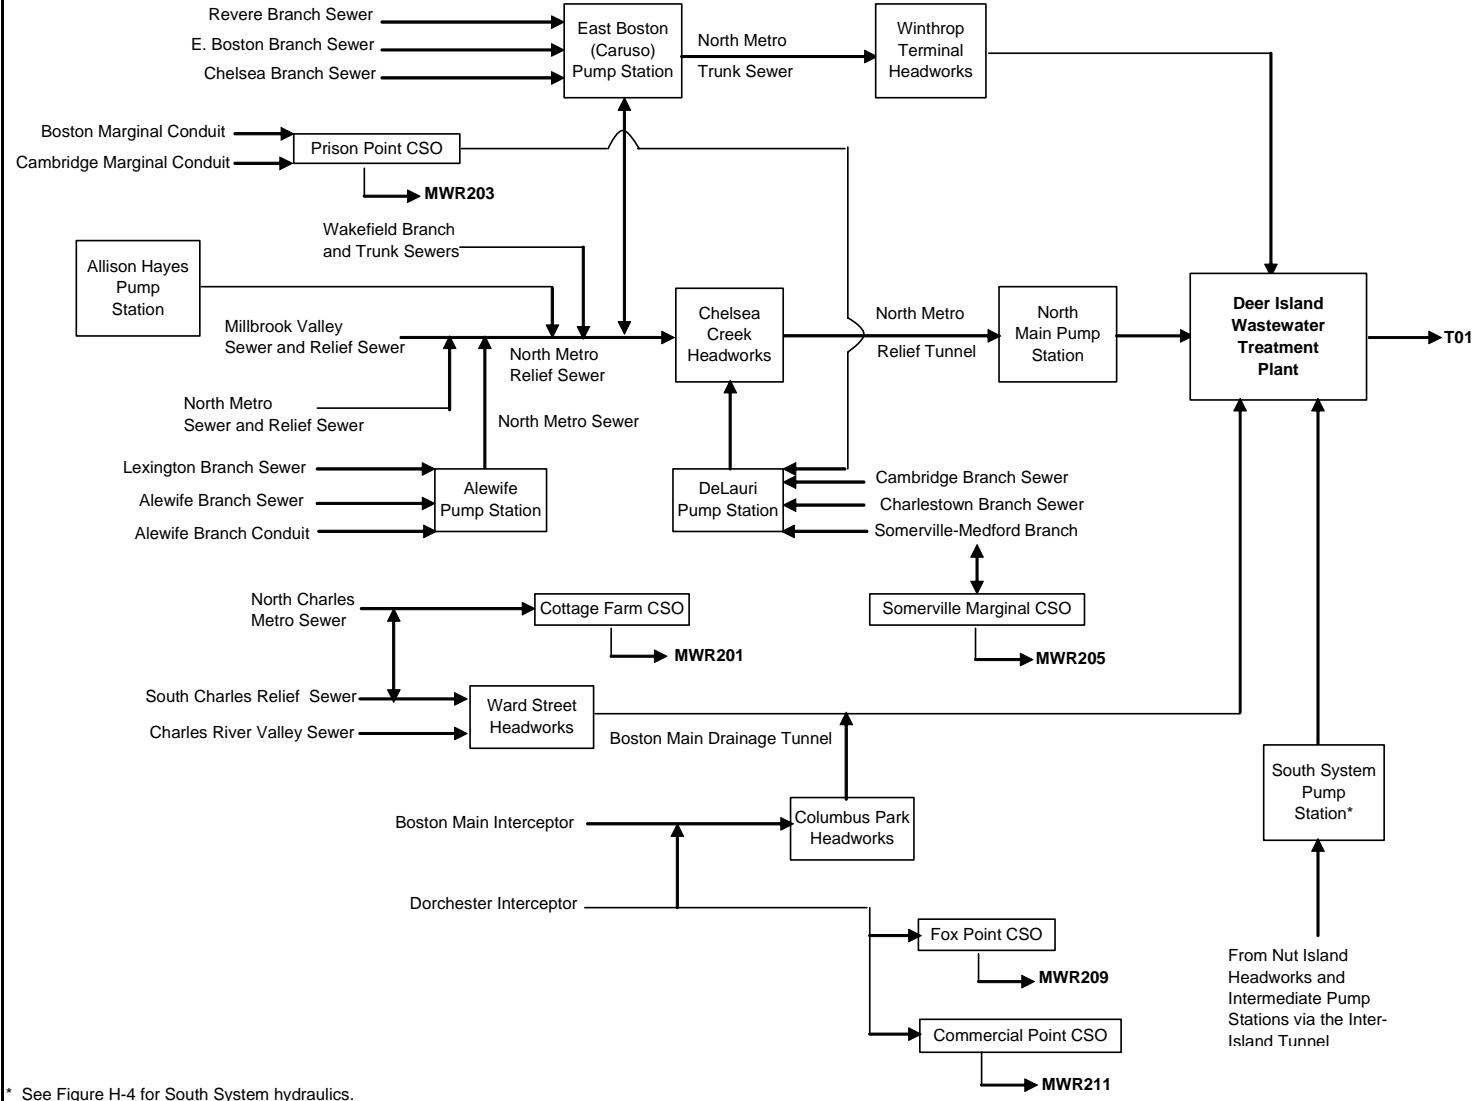

**H.1.b
North System
Headworks**

The Deer Island Treatment Plant receives North System flow from three remote headworks and the Winthrop Terminal headworks. The three remote headworks: Ward Street Headworks (256 mgd) located in Roxbury, Columbus Park Headworks (182 mgd) in South Boston, and Chelsea Creek Headworks (350 mgd) in Chelsea, have a combined pumping capacity of 788 mgd. The Winthrop Terminal Headworks (125 mgd) is located on Deer Island. The four North System headworks receive flows from interceptor lines or pump stations as follows:

Ward Street Headworks	South Charles Relief Sewer Charles River Valley Sewer North Charles Metro Sewer*
Columbus Park Headworks	Boston Main Interceptor Dorchester Interceptor
Chelsea Creek Headworks	Alewife Pump Station North Metro Relief Sewer DeLauri Pump Station Caruso Pump Station Overflow
Winthrop Terminal Headworks	Winthrop Sewer Caruso Pump Station**

*: During low intensity rainfall when line or holding capacity is not exceeded, the combined wastewater is pumped back to the trunk sewers and ultimately to the Ward Street Headworks.

**: Overflow from the Caruso Pump Station.

**H.1.c
Combined
Sewer
Overflow
Facilities**

The conditions for discharge of effluent from six CSO chlorination facilities are also included in MWRA's Boston NPDES permit. One of these facilities, Constitution Beach in East Boston, was closed in September 2000, leaving five active permitted CSO facilities. These five facilities, Cottage Farm and Prison Point in Cambridge, Somerville Marginal in Somerville, and Fox Point and Commercial Point in Dorchester, discharge to the Charles River, the Inner Harbor, the Mystic River, Dorchester Bay and Dorchester Bay, respectively.

Discharge of combined wastewater from a CSO treatment facility outfall to a receiving body of water is defined in this report as a CSO activation.

Discharge of combined wastewater to a non-facility CSO outfall pipe is defined as a CSO overflow. CSO overflows will not be discussed in this report. In general, CSO activations occur as a result of heavy rain, snowmelt, or choking at the headworks.

Choking is the process by which the headworks restrict the flow to Deer Island. During wet weather, when the wastewater volume exceeds the hydraulic capacity of the treatment plant, the headworks “choke” the flow and hold the wastewater in the lines. As a result, the combined wastewater backs up into the system, forcing the combined wastewater to overflow to CSO treatment facilities and non-facility CSO outfall pipes, resulting in potential CSO activations and overflow as well as potential SSOs. In addition to choking in response to hydraulic demand on the system, the headworks may choke so that emergency repairs, system testing, or maintenance work can be performed at the treatment plant. Choking at Ward Street and Columbus Park Headworks influences Cottage Farm activations. Choking at the Columbus Park Headworks can influence activations at Fox Point and Commercial Point CSOs. Backups at the DeLauri Pumping Station brought about by choking at the Chelsea Headworks can activate the Somerville Marginal CSO.

At the CSO facilities, the combined wastewater is screened and chlorinated prior to discharge. Of the five CSO facilities, only Cottage Farm and Prison Point have tank storage capacity. This allows the chlorinated wastewater to be held at these facilities. The facility only discharges when the storage capacity is exceeded; when that happens, the treated wastewater overflows and is discharged to the river. The three other CSO facilities are gravity CSO facilities, which mean that combined wastewater arrives and leaves the CSO facility by gravity. This type of facility provides disinfection and allows the chlorinated combined wastewater to overflow to the receiving water as quickly as the wastewater arrives at the facility.

The five CSO facilities provide treatment for approximately 50% of the CSO volume while the other half overflows in any of 80-plus permitted CSO overflow structures of the sewerage system without the benefit of any type of treatment. Of the more than 80 permitted CSO overflow structures, 53 are located in Boston, 15 in Cambridge, 5 in Chelsea, and 12 in Somerville. These outfalls discharge into Boston Harbor, the Alewife Brook, the Mystic River, the Charles River, and the Neponset River.

Cottage Farm CSO Facility

During dry weather conditions, wastewater arrives at the Ward Street Headworks where it is pumped to the Deer Island Plant. Under storm conditions, wastewater backs up into sewer lines and into the Cottage Farm CSO facility. Cottage Farm detains wastewater up to a volume of 1.3 MG. Any excess flow is screened, settled, chlorinated, and discharged to the Charles River through outfall MWR201. Combined wastewater that is held back is pumped back to the Ward Street Headworks. This facility, on-line since 1971, has a design pumping capacity of 233 mgd. An upgrade completed in FY01 added a dechlorination system for the effluent.

Prison Point CSO Facility

Prison Point is both a dry weather and storm water pumping station. The dry weather phase is a five-mgd capacity sewer pumping station that receives flow from the Boston Marginal Conduit and the Cambridge Marginal Conduit. Prison Point feeds into the DeLauri Pumping Station.

The storm water phase has a maximum pumping capacity of 385 mgd. Treatment includes screening, disinfection, and detention. During wet weather, if the dry pumping capacity is exceeded, the combined flow is screened, chlorinated, and held in detention basins. Once the basins fill, treated flow is discharged downstream below the new Charles River Dam at outfall MWR203. Combined wastewater volume that is held back, up to 1.2 MG, is pumped back to the DeLauri Station. This facility came on-line in 1980 and was upgraded with a dechlorination system in 2001.

Somerville Marginal CSO Facility


Somerville Marginal CSO is an unmanned gravity facility with a design capacity of 245 mgd. It receives wet weather flow from the northeast portion of Somerville and part of Medford. Normally, dry weather flow from these areas arrives at the DeLauri Station via the Somerville-Medford trunk sewers. During wet weather, combined sewer flow backs up to the Somerville CSO facility. Unlike Cottage Farm or Prison Point, this facility does not provide any large-scale detention capacity during storm conditions. Treatment consists of screening and chlorination. Effluent is discharged to the lower Mystic River basin at outfall numbers MWR205. The relief outfall, MWR205A, discharges to freshwater above the dam. MWR205A only activates under specific conditions and the vast majority of discharges are released through MWR205. During low-intensity rainfall when line capacity is not exceeded, the combined wastewater is pumped back from a wet well to the DeLauri Station. This facility came on-line in 1973 and was upgraded in 2001 with a dechlorination system.

Figure H-2 on the following page shows a representative gravity CSO schematic applicable to Somerville Marginal as well as the Fox Point and Commercial Point facilities.

Fox Point CSO Facility

Fox Point is an unmanned gravity facility with a design capacity of 119 mgd. It receives wet weather flows from the Dorchester Interceptor sewer line. Operation of this facility parallels that of the Constitution Beach CSO; treatment includes screening and disinfection. Effluent is discharged to Dorchester Bay through outfall number MWR209. This facility came on-line in 1989, and a dechlorination system was added in 2001.

Figure H-2. Typical Gravity Combined Sewer Overflow Treatment Facility

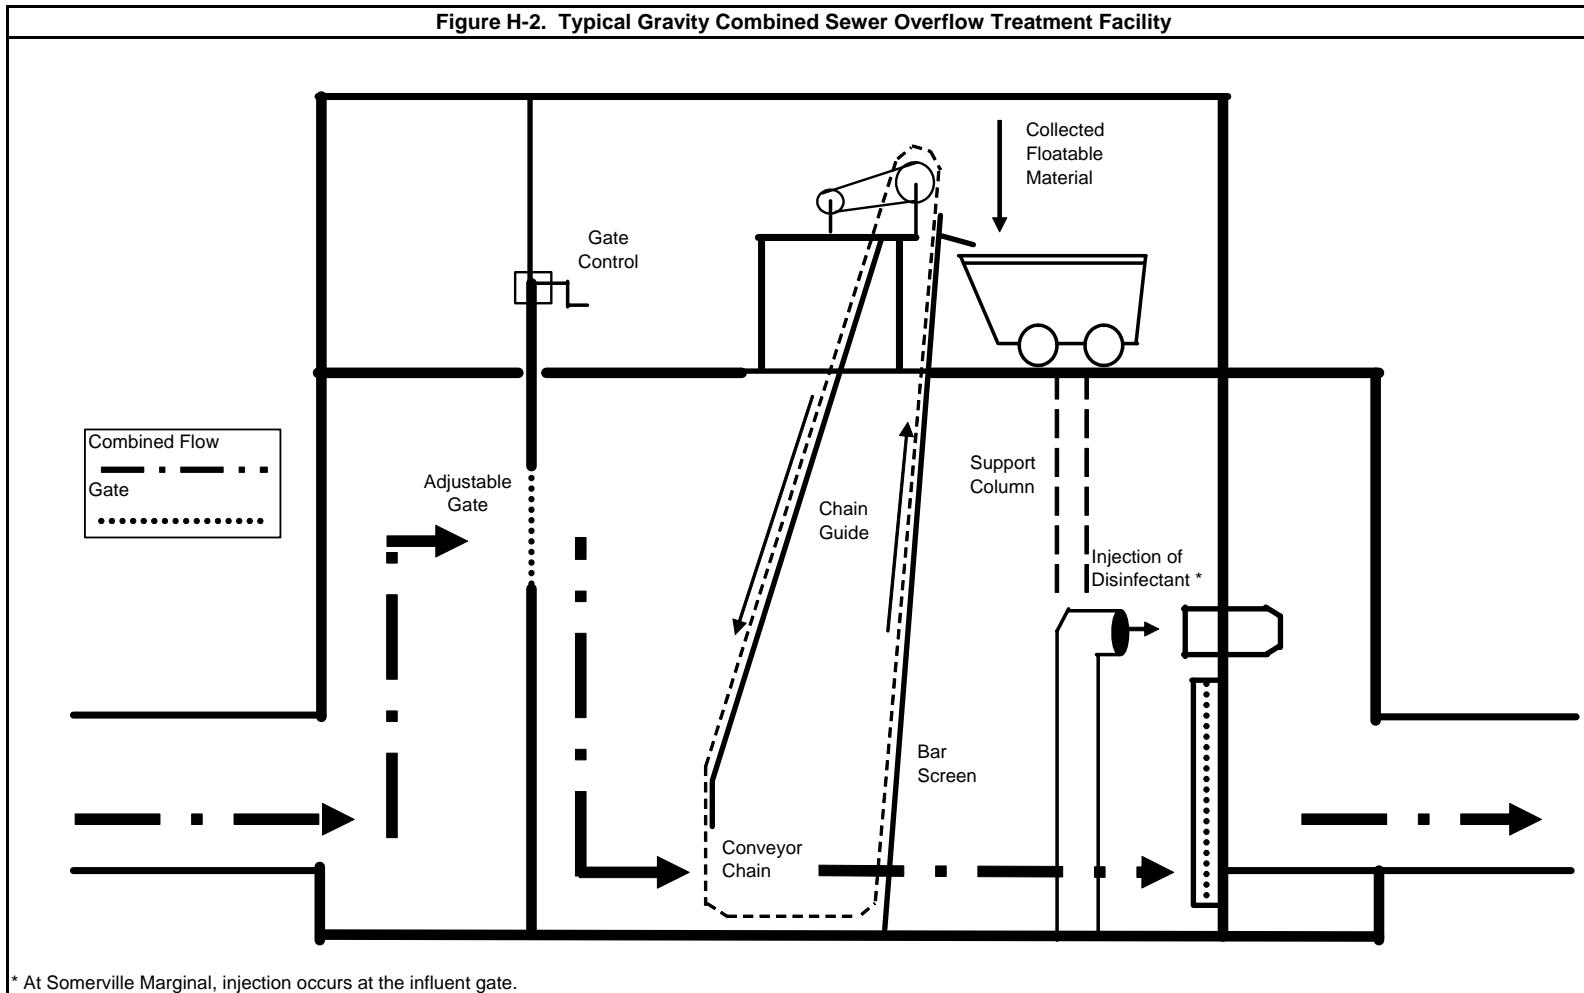

Commercial Point CSO Facility

Commercial Point is an unmanned gravity CSO with a design capacity of 194 mgd. This facility also receives wet weather backups from the Dorchester Interceptor. Treatment includes screening and disinfection. Effluent is discharged to Dorchester Bay through outfall number MWR211. This facility came on-line in 1991 and was upgraded in 2001 with a dechlorination system.

H.2 South System

The South System serves a population of about 700,000 people and is located to the south and southwest of Boston. The South System covers an area of approximately 237 square miles. Figure H-3 on the following page illustrates the South System hydraulic schematic. Community sewer lines tie into the South System through MWRA interceptor lines. The Framingham Extension Sewer, Wellesley Extension Sewer, Upper Neponset Valley Sewer, Wellesley Extension Relief Sewer, Neponset Valley Sewer, Walpole Extension Sewer, Stoughton Extension Sewer, Braintree-Randolph Trunk Sewer, and several other branch sewers discharge to the South System High Level Sewer. The High Level Sewer has a capacity of 360 mgd. Pump stations move the wastewater through the High Level Sewer to the Nut Island Headworks for preliminary treatment and grit removal. The South System flows are then conveyed to the South System Pump Station at Deer Island through the 4.7-mile Inter-Island Tunnel for treatment at the Deer Island Treatment Plant.

In 2004 the MWRA completed the Braintree-Weymouth Intermediate Pump Station (IPS) in North Weymouth. The IPS pumps sewage from the North Weymouth Relief Interceptor directly into the Inter-Island Tunnel, bypassing Nut Island. The IPS also acts as a headworks with bar screens and grit collectors. The IPS was designed to increase South System capacity, helping to alleviate some of the overflows in the South System. Additionally, the IPS will pump by-products between the fertilizer palletizing plant in Quincy and Deer Island. Sewage sludge will flow from Deer Island to Quincy for conversion to fertilizer and centrate from the fertilizer production process will return to Deer Island for treatment through two pipelines associated with the IPS.

Once at Deer Island, two force mains deliver the South System flow to one of two locations. The South System flow is normally discharged to the effluent channel of the Grit Facility, where it is combined with the North System and recycle flows, then split between Primary Clarifier Batteries A through D. The alternate discharge location is directly to the Primary Clarifier Battery D influent channel, which allows the South System flow to be isolated.


H.2.a
South System Pump Stations Eight MWRA pump stations move wastewater from low-lying areas to the High Level Sewer: Hingham Pump Station (16.5 mgd), Braintree-Weymouth Pump Station (60 mgd), Braintree-Weymouth IPS (45 mgd), Squantum Pump Station (12 mgd), Houghs Neck Lift Station (2.8 mgd), Neponset Pump Station (90 mgd), Framingham Pump Station (48 mgd) and Quincy Pump Station (52 mgd).

The seven pumping stations receive flow from interceptor or community lines as follows:

Hingham Pump Station	Weymouth-Hingham Sewer Lines
Braintree-Weymouth Pump Station	Braintree-Randolph Trunk Sewer
	Braintree-Weymouth Extension Sewer
	Holbrook Extension Sewer
	Hingham Pump Station
Braintree-Weymouth IPS	North Weymouth Relief Interceptor
Squantum Pump Station	Quincy Pelletizing Plant (see Chapter 4)
Houghs Neck Lift Station	Squantum Sewers
Neponset Pump Station	Houghs Neck Sewer
Framingham Pump Station	Neponset Valley Sewer
Quincy Pump Station	Framingham Sewers
	Quincy and Upstream Sewers

H.2.b
South System Headworks The Deer Island Treatment Plant receives South System flow from the new Nut Island Headworks. The Nut Island Headworks went on-line on July 7, 1998. It is located in Quincy and has a capacity of 360 mgd. Vortex grit separators similar to those used on Deer Island in the North System Grit Facility provide grit removal for South System flows.

Figure H-3. South System Pump Station, Headworks, and Tunnel Hydraulic Schematic

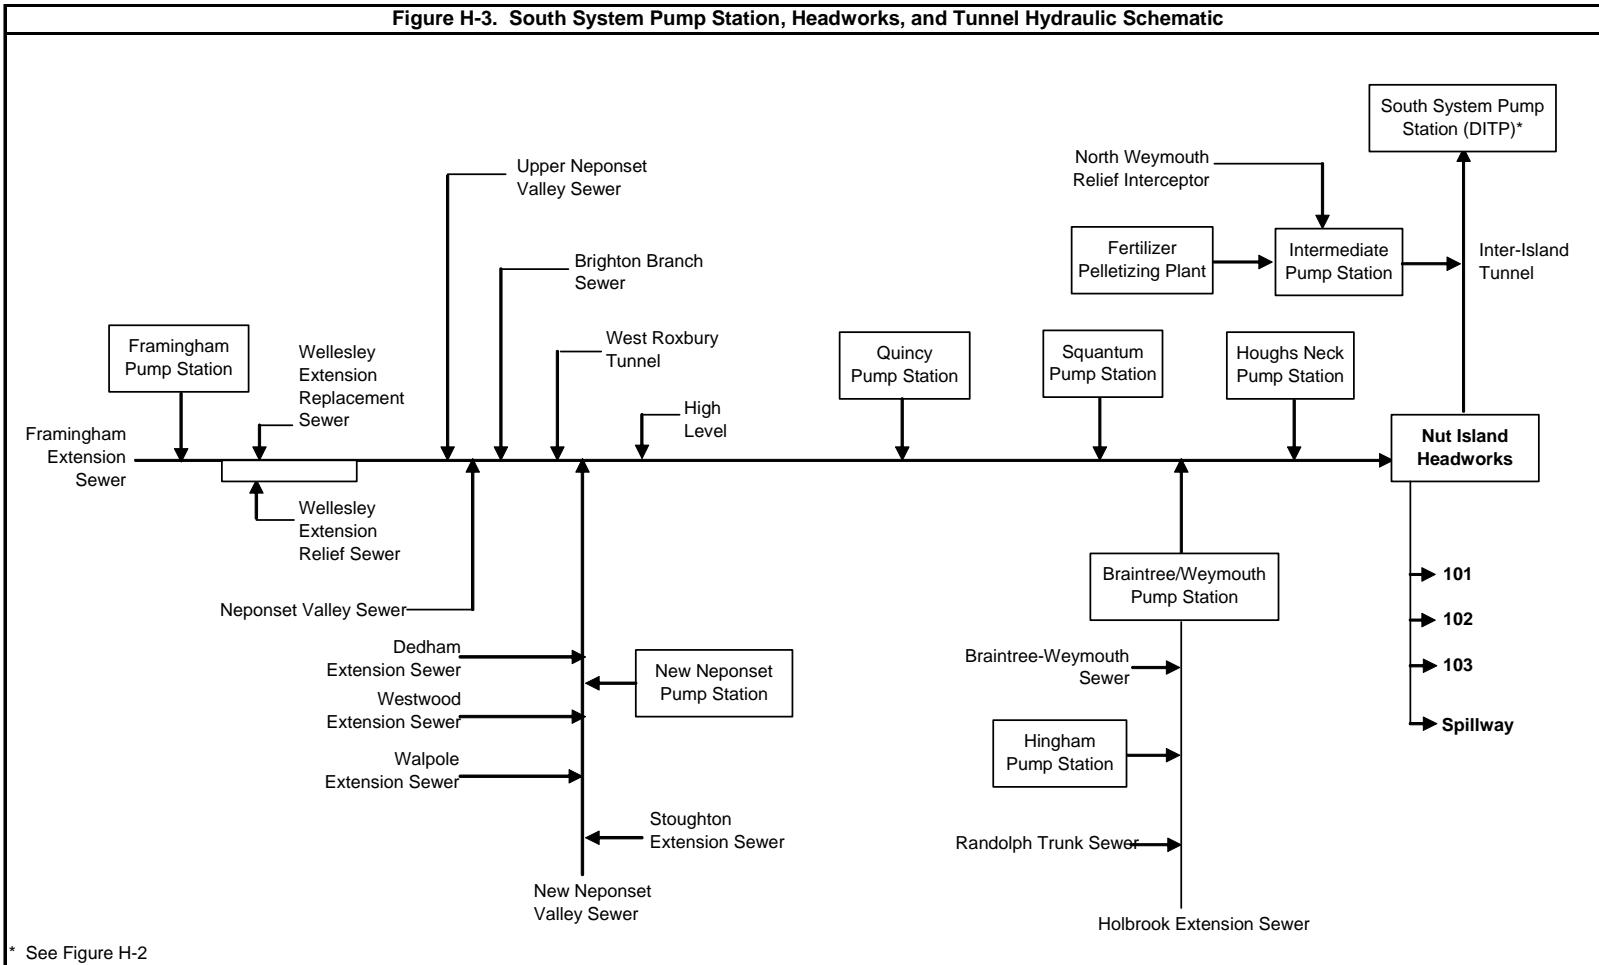

* See Figure H-2

H.3 Deer Island Treatment Plant

Until July 8, 1998, wastewater flows from the North System were treated at the Deer Island Treatment Plant and flows from the South System were treated at the Nut Island Treatment Plant. In July 1998, the Nut Island Treatment Plant was decommissioned and all flows were treated at Deer Island.

Four lines convey sewage to the Deer Island Treatment Plant. North System wastewater is delivered to the plant via the Boston Main Drainage Tunnel (from the Ward Street and Columbus Park Headworks), the North Metropolitan Relief Tunnel (from the Chelsea Creek Headworks), and the North Metropolitan Trunk Sewer. South System wastewater is transferred to the plant from the Nut Island Headworks and Braintree-Weymouth Intermediate Pump Station via the Inter-Island Tunnel.

The Deer Island Treatment Plant receives wastewater at the North Main Pump Station (NMPS), the Winthrop Terminal, and the South System Pump Station (SSPS). The North Metro Relief Tunnel and the Boston Main Drainage Tunnel connect to the NMPS, which consists of ten pumps, each rated at 110 mgd, for a total pumping capacity of 1,100 mgd. The North Metro Trunk Sewer connects to the Winthrop Terminal. The Inter-Island Tunnel connects to the SSPS, which consists of eight pumps, each rated at 66.7 mgd, for a total capacity of 534 mgd.

Grit removal and screening (preliminary treatment), which remove heavy particles and debris, is provided at the remote headworks and on-site at Deer Island. Flow from the South System receives preliminary treatment at the Nut Island Headworks. Grit and screenings are landfilled off-site.

The upgraded primary treatment plant came on-line on January 21, 1995. The first battery of secondary treatment was initiated at Deer Island on August 1, 1997. Battery B came on-line on March 1, 1998, and the third and final secondary treatment battery, Battery C, started up on March 8, 2001.

Wastewater from the North System flows through the grit chambers for additional grit removal. It, along with South System wastewater, then flows to the primary settling tanks where floatables, consisting mainly of oil, grease, and plastics rise to the surface while the sludge of heavy solid particles settles to the bottom. The majority of the primary effluent (the allowable capacity for secondary treatment) is sent to secondary treatment, while any remaining portion from high flow conditions due to rainfall bypasses secondary and is sent directly to the disinfection basins to be treated with sodium hypochlorite. Effluent from secondary treatment is then, if necessary, blended with primary effluent that bypassed secondary, and then sent to the disinfection basins, where it is chlorinated, detained, and then dechlorinated before discharge.

The scum (floatables) is skimmed off the top of the primary and secondary settling tanks while the sludge (settled solids) is scraped from the bottom of the tanks. Primary scum is pumped to the scum concentrator while the primary sludge is pumped to the gravity sludge thickeners. Scum and sludge from the secondary batteries are concentrated using centrifuges. After the scum and sludge are concentrated and thickened, they are conveyed to the anaerobic digesters for further treatment. The digested sludge/scum is barged to the Fore

River Pelletizing Plant, where it is converted into fertilizer (refer to Chapter IV). Methane from the digestion process is stored and used to generate power and heat for DITP.

Figure H-4 on the following page presents the Deer Island plant process flow diagram.

**H.3.a
Deer Island
Treatment
Plant Outfalls**

On September 6, 2000, effluent from Deer Island was diverted to the new 9.5 mile outfall tunnel into Massachusetts Bay. Effluent is discharged through 53 operational risers over the last 1.25 miles of the tunnel. The tunnel has a capacity of 1,270 mgd, slightly greater than the old harbor outfall system. Before the effluent enters the outfall it is used to run a hydroelectric facility linked to the Deer Island power grid. Although sealed and non-operational, the old Deer Island harbor outfalls are subject to periodic inspections and remain available for emergency use. Effluent is channeled through a common conduit to four potential outfall pipes: 001, 002, 004, and 005

**H.3.b
Nut Island
Outfalls**

The former Nut Island Treatment Plant discharged treated wastewater through four outfalls. Although the Nut Island Treatment Plant no longer exists, outfalls 101, 102 and 103 remain operational in case of emergency at the Nut Island Headworks. These outfalls discharge to Boston Harbor; the new emergency spillway built concurrently with the new headworks discharges to Hingham Bay.

**H.4
Collection and
Transport
System**

An issue of concern in both the North System and the South System is the occurrence of Sanitary Sewer Overflows (SSOs). These occur during extreme rainfall events, when inflow and infiltration from heavy rains exceeds the capacity of the pipes, causing certain areas to become inundated. Whenever there is a high amount of rainfall, a crew from the Transport Department investigates a number of critical areas to visually monitor potential overflow sites. While some of these critical areas are the MWRA's responsibility, most of them are the responsibility of the local communities. A list of these areas belonging to the MWRA is included in Table H-4 on page H-15. Not all of these areas are checked during every rainfall, and some are monitored by the MWRA only during extreme storm events. Table H-5 shows areas identified by MWRA staff as having the potential to overflow under certain conditions. SSOs have not, as of yet, occurred in these areas.

Figure H-4. Deer Island Treatment Plant Process Flow

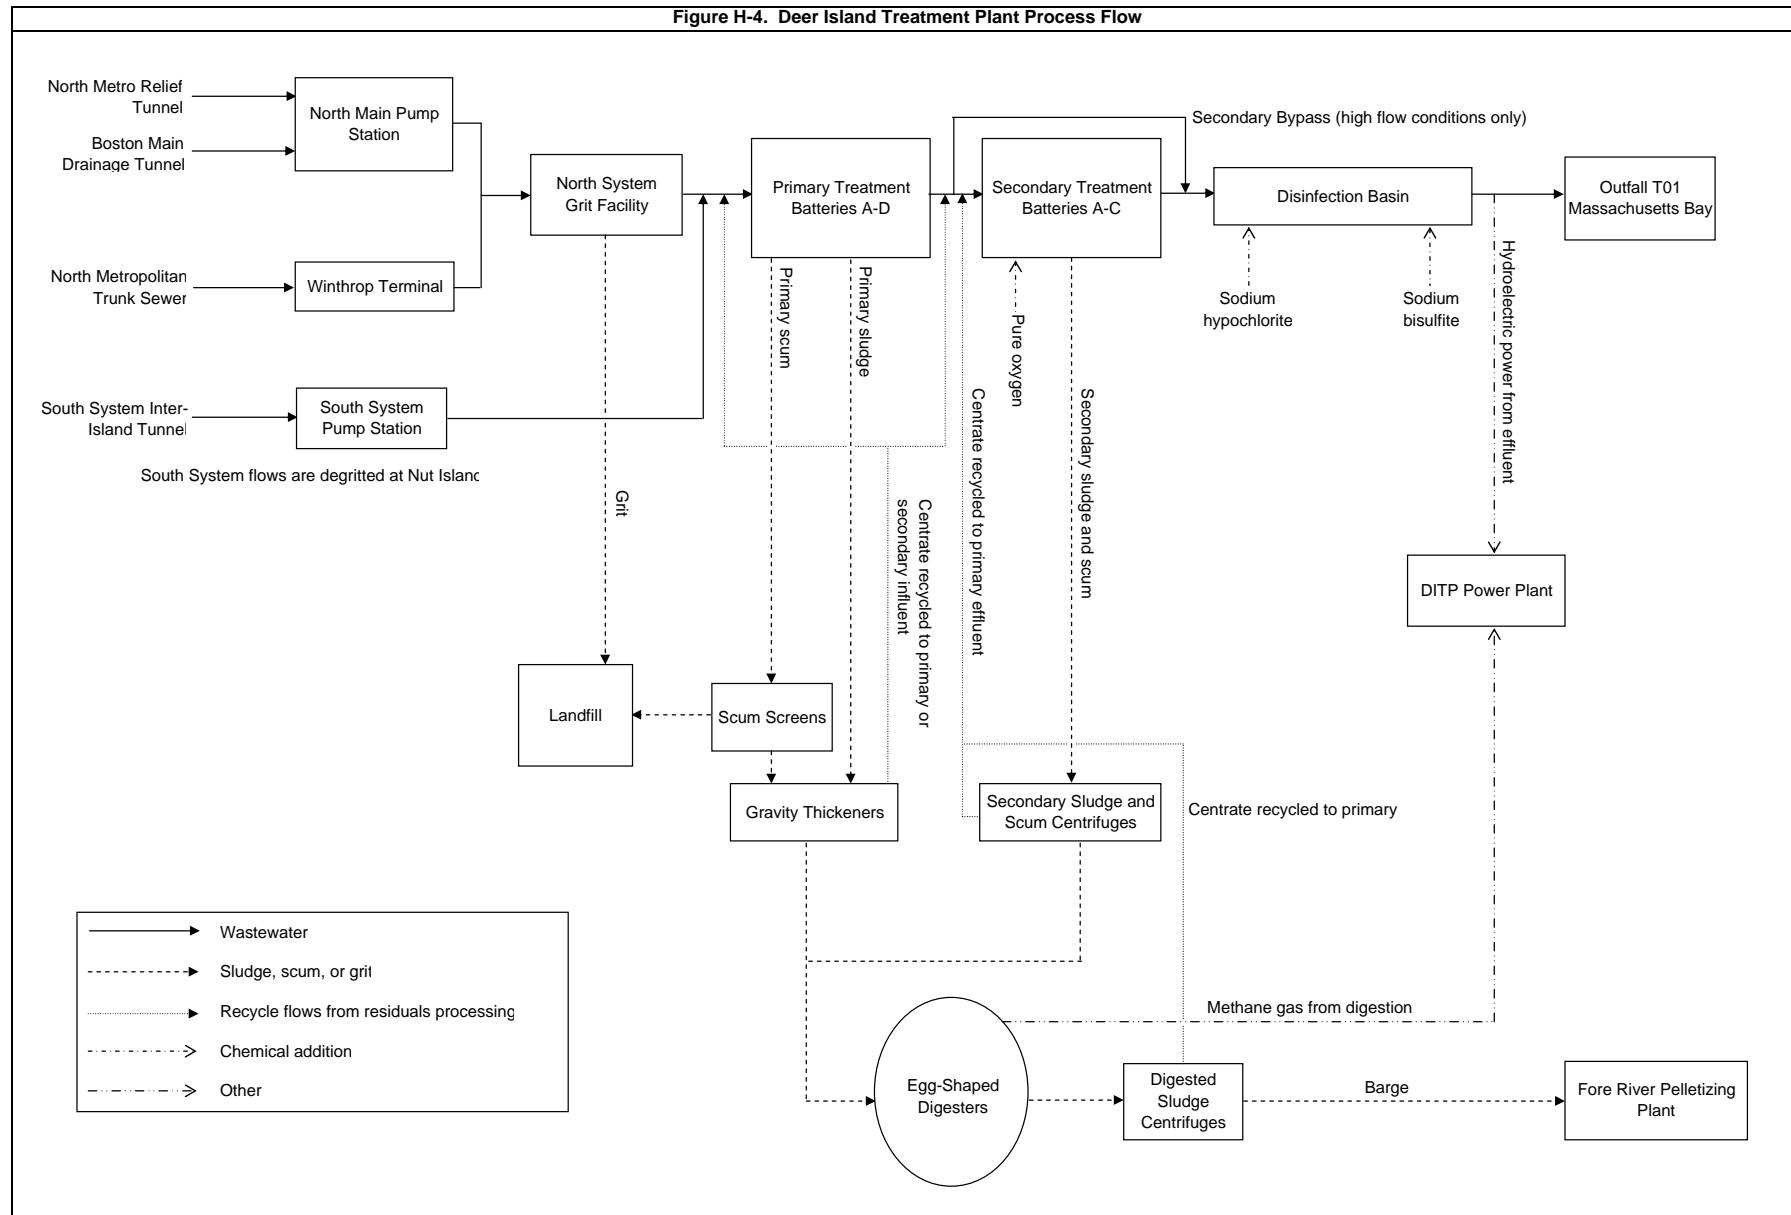


Table H-4. Known MWRA Sanitary Sewer Overflow Locations*		
System	Location	Description
North	Arlington, Section 80	Dudley St., Brattle Ct. manual plugs
	Arlington/Medford, Section 91B	Headhouse, manholes, siphon
	Cambridge, Section B	Near MBTA garage
	Cambridge, Section 43/B	Alewife Brook Pump Station, influent yard manhole
	Framingham, Section 133B	Framingham Extension Sewer
	Malden, Section 41	
	Malden, Section 95	
	Medford, Section C	Auburn St./Rt. 16 overflow relief point
	Medford, Section 20	Pearl St.
	Medford, Section 107	Rt. 16 on-ramp, overflow weir
	Melrose, Section 50	Tremont St.
	Melrose, Section 51	Brunswick Park
	Wakefield, Section 204	Allison Hayes Pump Station influent
	Waltham, Section 212 (old 4A)	
	Watertown	Pleasant St.
	Winchester, Section 47	Cummingsville Branch at Wedge Pond
	Winchester, Section 113	Ginn Field, Wedgemere siphons
	Winchester, Section 114	
	Boston, Section 519	Neponset Valley Sewer, Business St.
South	Boston, Section 571	High Level Sewer, Arboretum
	Braintree, Section 628	Pearl St. siphon
	Braintree/Weymouth, Section 626	Smelt Brook siphon headhouses
	Canton, Section 616	New Neponset Valley Relief Sewer, siphon near Bell Mouth
	Dedham, Section 526	Neponset Valley Sewer, Rt. 1
	Holbrook, Section 628B	Holbrook Extension Sewer
	Milton, Section 561	Brook Rd. at Pine Tree Brook
	Newton, Section 529	Upper Neponset Valley Sewer, VFW Parkway
	Newton, Section 530	Upper Neponset Valley Sewer, Vine St. area
	Norwood, Section 616	Walpole Extension Sewer, Overlook Dr.
	Norwood, Section 617	Walpole Extension Sewer, Meadow Brook siphon
	Randolph, Section 628A	Randolph siphon
	Roslindale, Section 570	High Level Sewer, manholes overland onto street
	Roslindale, Section 570	High Level Sewer, Roslindale emergency gates
	Westwood, Section 636	Westwood Extension Sewer, siphon or lowest point
	Westwood, Section 636	Westwood Extension Sewer, siphon or lowest point

* Known SSOs occurring in MWRA lines from January 1, 1996 onwards.

Table H-5. Potential MWRA Sanitary Sewer Overflow Locations		
System	Boston, Section 564	High Level Sewer, Neponset River at Monponset St.
South	Canton, Section 614	New Neponset Valley Relief Sewer Pump Station
	Hingham, Section 562	Hingham Pump Station
	Quincy, Section 543	Nut Island emergency outfall
	Quincy, Section 543	Nut Island emergency spillway
	Quincy, Section 551B	Quincy Pump Station
	Quincy, Section 621	Brantree-Weymouth Pump Station influent
	Squannum, Section 550B	Squannum Pump Station
	West Roxbury, Section 637A	West Roxbury Tunnel and High Level Sewer junction
	West Roxbury, Section 637A	West Roxbury Tunnel and High Level Sewer junction

Appendix I: Instrument Detection Limits, Method Detection Limits, and Quantitation Limits

Overview

An understanding of the detection limits of analysis is essential to reviewing the data from chemical analyses. There are three different types of detection limits that are most often encountered:

- Instrument Detection Limits
- Method Detection Limits
- Quantitation Limits, also known as Reporting Limits.

I.1 Instrument Detection Limits

Instrument detection limits (IDL) reflect the capability of the instrument. This limit will be the lowest of the three detection limits. The IDL will not take into account the losses of the pollutant associated with the matrix (soil or wastewater) and extraction procedure. This discrepancy is known as matrix interference.

I.2 Method Detection Limits

Method detection limits (MDL) are the smallest amount of a substance that can be detected above background noise using a particular method. The MDL is statistically determined by running a series of analyses using various low concentrations of a pollutant. Using a Student's "T" test, the smallest concentration that has a 99% probability of being detected above the background is designated the MDL for that pollutant. The EPA, using several private laboratories, has determined what the MDLs are for most priority pollutants using their approved methods. These are published in the 40 CFR.

I.3 Quantitation Limits

In general, if a plot is made of pollutant concentration versus instrument response, it will show a linear relationship. As the pollutant concentration approaches zero, the linearity of the relationship is lost. At the point where the linearity is lost is called the Quantitation Limit (QL) or sometimes the Reporting Limit. In other words, the smallest concentration where the linear relationship holds is the smallest concentration that can be quantified. Generally, the QL is about five times the MDL. Quantitative limits are relevant to GC/MS analyses, that is, methods 608 (for pesticides), 624 (for volatile organics), and 625 (for semi-volatile organics). Specific limits are highly matrix-dependent.

I.4 Detection Limits, Non- Detects, and Reporting

In short, the IDL is the lowest concentration that a particular instrument can detect. The MDL is the lowest concentration that can be detected using a particular method. The QL is the smallest concentration that can be confidently considered to be accurate.

Reported concentrations that are between the MDL and the QL indicate that a pollutant is present, but at a concentration too low to be accurately quantified. For example, using EPA method 624, chloroform has an MDL of 1.6 µg/L and a QL of 10 µg/L. If the concentration from an analysis is reported as 5 µg/L then it can be inferred that although the actual chloroform concentration in the

wastewater is uncertain, 5 µg/L is a best guess. The EPA requires that these intermediate values be flagged with a “J” on any reports submitted to them. Therefore, these are sometimes simply called “J-values.”

For non-detects in analyses of metals, cyanide, petroleum hydrocarbons, etc., it is customary for “less than the MDL” to be listed as a result. For a non-detect in the 608, 624, and 625 analyses, “less than the QL” is typically listed.

Often it becomes necessary to estimate a concentration for below detection limit values, specifically when calculating the average yearly concentration of a pollutant. A well-established method is to assume the actual concentration of a non-detected pollutant is simply one half of the MDL. While no scientific theory supports this assumption, it is more reasonable than assuming that the concentration is zero, or the MDL itself. The EPA and DEP also accept it as a standard practice that can be applied to any series of tests.

This technique is utilized in this report. For the organic compounds – methods 608, 624, and 625 – one tenth of the QL, or half the MDL, was assumed for all non-detects (i.e. values below QL). For all metals, cyanide, petroleum hydrocarbons, etc., half the MDL was assumed for all non-detects (i.e. values below MDL).

In Table I-1 is a list of the parameters regularly tested for in MWRA effluent. The required EPA method number, and the MDLs and reporting limits attained by the MWRA’s Central Laboratory are included.

Table I-1. List of Parameters Tested			
Parameter	EPA Method Number	MWRA MDL (µg/L)	MWRA QL (µg/L)
Metals			
Aluminum	200.7	90	<90
Antimony	200.7	0.8	<0.9
Arsenic	206.2	0.8	<0.8
	200.7	43.8	<45
Beryllium	200.7	0.3	<0.5
Boron	200.7	9.5	<250
Cadmium	200.7	1.1	<2
	213.2	.03	<0.03
Chromium	200.7	4.0	<4
	218.2	0.7	<0.7
Copper	200.7	10.5	<10
	220.2	0.6	<1
	200.8	1	1
Hexavalent Chromium	SM 3500-CR D ²	1.8	<5
Iron	200.7	3	<30
Lead	200.7	12.0	<15
	239.2	2.4	<2.4
Mercury	245.2	0.01	<0.01
	1631	1	1
Molybdenum	200.7	3.4	<5
	246.2	1.2	<1
Nickel	200.7	3.0	<3
	249.2	0.7	<0.7
Selenium	200.7	48.2	<50
	270.2	0.9	<0.9
Silver	200.7	1.4	<2
	272.2	0.09	<0.09
Thallium	200.7	58.3	<60
	279.2	1.0	<1
Zinc	200.7	5.7	<6
Other Inorganic Chemicals⁴			
Cyanide	335.2	0.004	<0.01
Fats, Oil, and Grease (mg/L)	1664A	2.0	<7
Petroleum hydrocarbons (mg/L)		1	1
Phenol (mg/L)	420.2 MO	0.003	<0.01
Sulfate (mg/L)	300.0	0.2	<1
Total Organic Carbon (mg/L)	415.1	0.06	<0.3
Surfactants (mg/L)	425.1	0.03	<0.03
Pesticides (ng/L)			
4,4'-DDD	608	6.8	<20
4-4'-DDE	608	8.8	<20
4-4'-DDT	608	15.8	<20
Aldrin	608	3.5	<20
alpha-BHC	608	6.3	<20
alpha-Chlordane	608	3.6	<20
beta-BHC	608	6.3	<20
Chlordane (Technical)	608	1	1
delta-BHC	608	6.7	<20
Dieldrin	608	5.5	<20
Endosulfan I	608	5.3	<20
Endosulfan II	608	4.0	<20
Endosulfan sulfate	608	16.7	<20
Endrin	608	13.7	<20
Endrin aldehyde	608	9.1	<20
Endrin ketone	608	5.4	<20
gamma-BHC (Lindane)	608	4.2	<20
Heptachlor	608	9.7	<20
Heptachlor epoxide	608	8.8	<20
Hexachlorobenzene	612	1	1
Methoxychlor	608	52.0	<200
Toxaphene	608	1	1

Table I-1. List of Parameters Tested (cont.)

PCBs (all in ng/L)			
Arochlor-1016	608	31.0	<500
Arochlor-1221	608	21.0	<1000
Arochlor-1232	608	14.0	<500
Arochlor-1242	608	1	1
Arochlor-1248	608	1	1
Arochlor-1254	608	10.0	<500
Arochlor-1260	608	32.0	<500
Volatile Organics			
1,1,1-trichloroethane	624	1.0	<5
1,1,2,2-tetrachloroethane	624	1.3	<5
1,1,2-trichloroethane	624	0.6	<5
1,1-dichloroethane	624	0.8	<5
1,1-dichloroethene	624	1.3	<5
1,2-dichlorobenzene	624	0.4	<5
1,2-dichloroethane	624	0.6	<5
1,2-dichloropropane	624	0.4	<5
1,3-dichlorobenzene	624	0.5	<5
1,4-dichlorobenzene	624	0.4	<5
2-butanone	624	1.8	<5
2-chloroethylvinylether	624	0.8	<5
2-hexanone	624	1.5	<5
4-methyl-2-pentanone	624	1.3	<5
Acetone	624	16	<5
Acrolein	624	5.4	<5
Acrylonitrile	624	4.2	<5
Benzene	624	0.5	<5
Bromodichloromethane	624	0.4	<5
Bromoform	624	0.4	<5
Bromomethane	624	1.1	<5
Carbon disulfide	624	1.4	<5
Carbon tetrachloride	624	1.0	<5
Chlorobenzene	624	0.4	<5
Chloroethane	624	1.0	<5
Chloroform	624	0.5	<5
Chloromethane	624	0.7	<5
cis-1,2-dichloroethene	624	0.5	<5
cis-1,3-dichloropropane	624	0.3	<5
Dibromochloromethane	624	0.6	<5
Ethylbenzene	624	0.5	<5
m,p-xylene	624	1.4	<5
Methylene chloride	624	0.6	<5
o-xylene	624	0.5	<5
Styrene	624	0.4	<5
Tetrachloroethene	624	0.8	<5
Toluene	624	0.5	<5
trans-1,2-dichloroethene	624	1.1	<5
trans-1,3-dichloropropene	624	0.3	<5
Trichloroethene	624	1.0	<5
Trichlorofluoromethane	624	0.8	<5
Vinyl acetate	624	0.8	<5
Vinyl chloride	624	1.0	<5
Semi-Volatiles			
1,2,4-trichlorobenzene	625	6.1	<10
1,2-dichlorobenzene	625	3.7	<10
1,2-diphenylhydrazine	625	8.7	<10
1,3-dichlorobenzene	625	2.9	<10
1,4-dichlorobenzene	625	3.2	<10
2,2'-oxybis(1-chloropropane)	625	3.9	<10
2,4,5-trichlorophenol	625	8.4	<10
2,4,6-trichlorophenol	625	9.6	<10
2,4-dichlorophenol	625	9.0	<10
2,4-dimethylphenol	625	8.1	<10
2,4-dinitrophenol	625	12.4	<20

Table I-1. List of Parameters Tested (cont.)

Semi-Volatiles (cont.)			
2,4-dinitrotoluene	625	7.6	<10
2,6-dinitrotoluene	625	10.0	<10
2-chloronaphthalene	625	9.2	<10
2-chlorophenol	625	4.2	<10
2-methyl-4,6-dinitrophenol	625	7.9	<100
2-methylnaphthalene	625	4.5	<10
2-methylphenol	625	7.5	<10
2-nitroaniline	625	6.9	<10
2-nitrophenol	625	6.2	<10
3,3'-dichlorobenzidine	625	8.4	<20
3-nitroaniline	625	8.6	<10
4-bromophenyl phenyl ether	625	7.8	<10
4-chloro-3-methylphenol	625	7.4	<10
4-chloroaniline	625	8.2	<10
4-chlorophenyl phenyl ether	625	9.0	<10
4-methylohenol (includes 3-methylphenol)	625	7.2	<10
4-nitroaniline	625	8.0	<10
4-nitrophenol	625	6.3	<20
Acenaphthene	625	6.8	<10
Acenaphthylene	625	7.2	<10
Aniline	625	6.6	<10
Anthracene	625	5.8	<10
Benzindine	625	0.5	<10
Benzo(a)anthracene	625	5.4	<10
Benzo(a)pyrene	625	5.4	<10
Benzo(b)fluoranthene	625	7.8	<10
Benzo(ghi)perylene	625	5.2	<10
Benzo(k)fluoranthene	625	4.1	<10
Benzoic acid	625	7.2	<20
Benzyl alcohol	625	5.8	<10
bis(2-chloroethoxy) methane	625	6.7	<10
bis(2-chloroethyl) ether	625	4.1	<10
bis(2-ethylhexyl) phthalate	625	4.9	<10
Butyl benzyl phthalate	625	6.6	<10
Chrysene	625	6.2	<10
di-n-butylphthalate	625	5.4	<10
di-n-octylphthalate	625	4.6	<10
Dibenzo(a,h)anthracene	625	5.2	<10
Dibenzofuran	625	6.8	<10
Diethyl phthalate	625	9.1	<10
Dimethyl phthalate	625	9.9	<10
Fluoranthene	625	5.1	<10
Fluorene	625	8.1	<10
Hexachlorobenzene	625	8.8	<10
Hexachlorobutadiene	625	6.2	<10
Hexachlorocyclopentadiene	625	10.7	<50
Hexachloroethane	625	3.5	<10
Indeno(1,2,3-cd) pyrene	625	6.4	<10
Isophrone	625	7.5	<10
n-nitroso-di-n-propylamine	625	3.1	<10
n-nitrosodimethylamine	625	4.3	<10
n-nitrosodiphenylamine	625	7.9	<10
Naphthalene	625	5.7	<10
Nitrobenzene	625	6.3	<10
Pentachlorophenol	625	6.9	<30
Phenanthrene	625	5.8	<1
Phenol	625	2.2	<20
Pyrene	625	6.0	<10

¹ Data unavailable.² Standard Methods.³ Native concentration too high for MDL determination.⁴ Some expressed in mg/L as noted.

Appendix J: Priority Pollutants List and Other Parameters

Table J-1. EPA List of 126 Priority Pollutants		
Chlorinated Benzenes Chlorobenzene 1,2-dichlorobenzene 1,3-dichlorobenzene 1,4-dichlorobenzene 1,2,4-trichlorobenzene Hexachlorobenzene	Chlorinated Ethanes Chloroethane 1,1-dichloroethane 1,2-dichloroethane 1,1,1-trichloroethane 1,1,2,2-tetrachloroethane Hexachloroethane	Chlorinated Phenols 2-chlorophenol 2,4-dichlorophenol 2,4,6-trichlorophenol Parametachlorocresol (4-chloro-3-methyl phenol)
DDT and Metabolites 4,4-DDT 4,4-DDE (p,p-DDX) 4,4-DDD (p,p-DDE)	Haloethers 4-chlorophenyl phenyl ether 2-bromophenyl phenyl ether Bis(2-chloroisopropyl) ether	Halomethanes Methylene chloride (dichloromethane) Methyl chloride (chloromethane) Methyl bromide (bromomethane) Bromoform (tribromomethane) Dichlorobromomethane Chlorodibromomethane
Inorganics Antimony Arsenic Asbestos Beryllium Cadmium Chromium (III) Chromium (VI) Copper Cyanide, total Lead Mercury Nickel Selenium Silver Thallium Zinc	Nitroamines N-nitrosodimethylamine N-nitrosodiphenylamine N-nitrosodi-n-propylamine	Pesticides and Metabolites Aldrin Dieldrin Chlordane (technical mixture and metabolites) Alpha-endosulfan Beta-endosulfan Endosulfan sulfate Endrin Endrin aldehyde Heptachlor Heptachlor epoxide (BHC-hexachlorocyclohexane) Alpha-BHC Beta-BHC Gamma-BHC (Lindane) Delta-BHC Toxaphene
Phenols (other than chlorinated) 2-nitrophenol 4-nitrophenol 2,4-dinitrophenol 4,6-dinitro-o-cresol (4,6-dinitro-2-methylphenol) Pentachlorophenol Phenol 2,4-dimethylphenol	Phthalate Esters Bis(2-ethylhexyl)phthalate Butyl benzyl phthalate Di-n-butyl phthalate Di-n-octyl phthalate Diethyl phthalate Dimethyl phthalate	Polychlorinated Biphenyls (PCBs) PCB-1242 (Aroclor 1242) PCB-1254 (Aroclor 1254) PCB-1221 (Aroclor 1221) PCB-1232 (Aroclor 1232) PCB-1248 (Aroclor 1248) PCB-1260 (Aroclor 1260) PCB-1016 (Aroclor 1016)
Polynuclear Aromatic Hydrocarbons (PAHs) Acenaphthene 1,2-benzanthracene (benzo(a)anthracene) Benzo(a)pyrene (3,4-benzo-pyrene) 3,4-benzofluoranthene (benzo(b)fluoranthene) 11,12-benzofluoranthene (benzo(k)fluoranthene) Chrysene Acenaphthylene Anthracene 1,12-benzoperylene (benzo(ghi)perylene) Fluorene Fluoranthene Phenanthrene 1,2,5,6-dibenzanthracene (dibenzo(a,h)anthracene) Indeno (1,2,3-cd) pyrene (2,3-o-phenylene pyrene) Pyrene	Other Chlorinated Organics Chloroform (trichloromethane) Carbon tetrachloride (tetrachloromethane) Bis(2-chloroethoxy)methane Bis(2-chloroethyl)ether 2-chloroethyl vinyl ether (mixed) 2-chloronaphthalene 3,3'-dichlorobenzidine 1,1-dichlorethylene 1,2-trans-dichloroethylene 1,2-dichloropropane 1,2-dichloropropylene (1,3-dichloropropene) Tetrachloroethylene Trichloroethylene Vinyl chloride (chloroethylene) Hexachlorobutadiene Hexachlorocyclopentadiene 2,3,7,8-tetrachloro-dibenzo-p-dioxin (TCDD)	Other Organics Acrolein Acrylonitrile Benzene Benzidine 2,4-dinitrotoluene 2,6-dinitrotoluene Ethylbenzene Isophrone Naphthalene Nitrobenzene Toluene

Table J-2. NPDES Permit Application Testing Requirements
40 CFR 122, Appendix D, Tables II and III

<u>Volatile Organics</u>	<u>Organic Pesticides</u>	<u>Organic Base/Neutrals</u>
acrolein acrylonitrile benzene bromoform carbon tetrachloride chlorobenzene chlorodibromomethane chloroethane 2-chloroethylvinyl ether chloroform dichlorobromomethane 1,1-dichloroethane 1,2-dichloroethane 1,1-dichloroethylene 1,2-dichloropropane 1,3-dichloropropylene ethyl benzene methyl bromide methyl chloride methylene chloride 1,1,2,2-tetrachloroethane tetrachloroethylene toluene 1,2-trans-dichloroethylene 1,1,1-trichloroethane 1,1,2-trichloroethane trichloroethylene vinyl chloride	aldrin alpha-BHC beta-BHC gamma-BHC delta-BHC chlordan 4,4'-DDT 4,4'-DDE 4,4'-DDD dieldrin alpha-endosulfan beta-endosulfan endosulfan sulfate endrin endrin aldehyde heptachlor heptachlor epoxide PCB-1242 PCB-1254 PCB-1221 PCB-1232 PCB-1248 PCB-1260 PCB-1016 toxaphene	acenaphthene acenaphthylene anthracene benzidine benzo(a)anthracene benzo(a)pyrene 3,4-benzofluoranthracene benzo(ghi)perylene benzo(k)fluoranthene bis(2-chloroethoxy)methane bis(2-chloroethyl)ether bis(2-ethylhexyl)phthalate 4-bromophenyl phenyl ether butylbenzyl phthalate 2-chloronaphthalene 4-chlorophenyl phenyl ether chrysene dibenzo(a,h)anthracene 1,2-dichlorobenzene 1,3-dichlorobenzene 1,4-dichlorobenzene 3,3'-dichlorobenzidine diethyl phthalate dimethyl phthalate di-n-butyl phthalate 2,4-dinitrotoluene 2,6-dinitrotoluene di-n-octyl phthalate 1,2-diphenylhydrazine fluoranthene fluorene hexachlorobenzene hexachlorobutadiene hexachlorocyclopentadiene hexachloroethane indeno(1,2,3-cd)pyrene isophorone naphthalene nitrobenzene N-nitrosodimethylamine N-nitrosodi-n-propylamine N-nitrosodiphenylamine phenanthrene pyrene 1,2,4-trichlorobenzene
<u>Organic Acids</u> 2-chlorophenol 2,4-dichlorophenol 2,4-dimethylphenol 4,6-dinitro-o-cresol (2-methyl-4,6-dinitrophenol) 2,4-dinitrophenol 2-nitrophenol 4-nitrophenol p-chloro-m-cresol (4-chloro-m-cresol) pentachlorophenol phenol 2,4,6-trichlorophenol	<u>Metals</u> antimony, total arsenic, total beryllium, total cadmium, total chromium, total copper, total lead, total mercury, total nickel, total selenium, total silver, total thallium, total zinc, total cyanide, total phenols, total	<u>Cyanide and Phenols</u> cyanide, total phenol, total

Appendix K: Glossary, Abbreviations/Acronyms, and Units

K.1 Glossary

- 40 CFR Part 122** - Code of Federal Regulations: Protection of the Environment. Part 122 is Administered Permit Programs: The National Pollutant Discharge Elimination System. (Appendix D of 40 CFR 122 lists the Permit Application Requirements.)
- Acid Base Neutrals (ABNs)** - A category of organic chemical pollutants also called semi-volatile organics. See Appendix K.
- Acute** - A stimulus severe enough to rapidly induce an effect; in aquatic toxicity tests, an effect observed in 96 hours or less is typically considered acute. When referring to aquatic toxicology or human health, an acute effect is not always measured in terms of lethality.
- Acute Criteria**- The maximum concentration of a constituent in water that an organism may be exposed to for a total of one hour, once over three years, without dying.
- Acute Static Toxicity Test** - Test designed to measure water quality effect on mortality. It measures the effect of the whole effluent sample on an organism. Animals are put in a vial with effluent, and the fatal effects are monitored. To calculate water quality standards, the test is run on sensitive animals. The concentration that shows a 95% mortality rate is then multiplied by two.
- Activation** - An event when the wastewater flow exceeds the holding capacity of the sewer lines and the hydraulic capacity of the treatment plant, causing a diversion of flow to the CSO facilities.
- Aeration** - The process of adding air to a liquid (e.g. wastewater).
- Aliquot** - A measured portion of a sample.
- Anaerobic Digester** - The structure where organic material is broken down by organisms in the absence of oxygen.
- Anoxia** - The absence of oxygen.
- Average Monthly Discharge Limitation** - The highest allowable average of “daily discharge” over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured.
- Average Weekly Discharge Limitation** - The highest allowable average of “daily discharge” over a calendar week, calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.
- Bar Screen** - A screen made of bars designed to catch large debris (e.g. rags, wood, shoes) in waterways.
- Below Detection Limit/Level (BDL)** - Values below the Reporting or Quantitation Limit. For further explanation see Appendix K.
- Bioaccumulation** - The process in which industrial waste, toxic chemicals, and other pollutants gradually build up in living tissues and organs.
- Biochemical** - Having to do with a chemical change resulting from the metabolic activities of living organisms.

Biochemical Oxygen Demand (BOD) - The amount of oxygen needed to oxidize inorganic materials and to degrade organic materials by *biochemical reactions* in a certain time at a certain temperature. BOD is used as a measure of organic pollution.

Biomagnification - The process by which the concentration of a compound increases in species occupying successive trophic levels.

BDL - See Below Detection Limit

Bloom - A large mass of algae (microscopic and or macroscopic) in water.

BOD - See Biochemical Oxygen Demand.

Buffering Capacity - Measures the ability of certain water bodies to resist changes in pH from addition of acidic or caustic substances.

CFR - See Code of Federal Regulations

Chemical Oxygen Demand (COD) - The amount of oxygen needed for the *chemical oxidation* of chemicals in water. COD is used to measure the suitability of water for organisms that require oxygen.

Chlorination - The addition of chlorine or chlorine compounds to wastewater. Chlorination is most often done for disinfection purposes.

Choking - A process by which flows that cannot be handled by existing pumps are "choked back" into the sewer system, frequently leading to local overflows.

Chronic - A stimulus that lingers or continues for a relatively long period of time, often one-tenth of the life span or more. Chronic should be considered a relative term depending on the life span of an organism. The measurement of a chronic effect can be reduced growth, reduced reproduction, etc., in addition to lethality.

Chronic Criteria - The maximum concentration of a constituent in water that an organism may be exposed to for a total of four days over three years without showing long term, harmful effects, short of mortality. Chronic criteria involve sublethal effects on, among other things, the growth, reproductivity, and fertility of organisms.

Chronic Reproduction Test - A test designed to measure the chronic effects of wastewater on reproduction and fertility.

Chronic Survival and Growth Test - Test designed to see if any mortality occurs after the chronic criteria have been passed. After the organisms have survived, the size of the animals are measured after seven days and statistically compared to controls.

Clean Water Act (CWA) - Formally referred to as the Federal Water Pollution Control Act or Federal Water Pollution Control Act Amendments of 1972. Pub. L. 92-500, as amended by Pub. L. 95-576, Pub. L. 96-483, and Pub. L. 97-117: 33 U.S.C. 1251 *et seq.*

COD - See Chemical Oxygen Demand

Code of Federal Regulations (CFR) - Codification of the general and permanent rules of the federal government. CFR 40 covers environmental protection.

Combined Sewer - A sewer receiving both sanitary wastewater and stormwater runoff.

Combined Sewer Overflow Facility - A place where overflow from combined sewers is screened, settled, and chlorinated before being discharged.

Combined Sewer Overflow Pipe - A pipe that discharges overflow from combined sewers in order to prevent back-ups in the sewerage system.

Composite Sample - A sample consisting of a minimum of eight grab samples collected at equal intervals during a 24-hour period (or lesser period if specified) and combined proportional to flow, or a sample continuously collected proportionally to flow over that same time period.

Conventional Parameters/Pollutants - Those pollutants and constituents that are removed from wastewater by conventional treatment. Generally these constituents are settleable solids, biochemical oxygen demand, total suspended solids, oil and grease, total coliform, fecal coliform, residual chlorine, and chlorides.

Conventional Treatment - Well-known or well-established water or wastewater treatment methods, usually consisting of primary and secondary processes and may include advanced or tertiary treatment.

Criteria - The numerical and or narrative elements of water quality standards.

Critical Dilution - Dilution of the effluent required to meet Water Quality Standards.

CWA - See Clean Water Act.

Daily Discharge - The discharge of a pollutant measured during a calendar day or any 24-hours period that reasonably represents the calendar day for purposes of sampling. For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurements, the daily discharge is calculated as the average measurement of the pollutant over the day.

Designated Use - Specified use of a body of water included in state water quality standards.

Digester - A place where organic matter is broken down either with oxygen (aerobically) or without oxygen (anaerobically).

Disinfection - The destruction of pathogens (e.g. fecal coliform bacteria) in a water source or wastewater.

Effluent - The wastewater or other water coming out of a treatment facility or process.

Effluent Limitation - Any restriction imposed by the Director (the person authorized to sign NPDES permits by EPA and/or the State) on quantities, discharge rates, and concentrations of "pollutants" which are "discharged" from "point sources" into "waters of the United States," the waters of the "contiguous zone," or the ocean.

Eutrophication - The natural process by which a body of water ages. Nutrients stimulate plant growth and lakes, estuaries, and bays evolve into bogs or marshes. Effluents high in nutrients cause excessive plant growth that accelerates eutrophication.

Fecal Coliform - Bacteria found in the wastes of warm-blooded animals. Fecal coliform is used as an indicator that disease causing bacteria and viruses are present. It is a component of Total Coliform.

Floatables - Constituents of wastewater that rise to the surface in the settling process, consisting mainly of oil, grease, and plastics.

Grab Sample - An individual sample collected in a period of less than 15 minutes.

Gravity Facility - A combined sewer overflow facility that receives flows by gravity (descending gradients from source to outfall) and requires no pumping.

Grit - Heavy suspended mineral matter in wastewater like sand and gravel.

Grit Chamber - A detention tank where grit is separated by sedimentation (grit settles to the bottom). The settling is controlled by the velocity of the water.

Headworks - A structure where wastewater are screened out and grit and other solids are trapped before the wastewater is pumped to a treatment facility.

Human Health Criteria - Estimated concentrations or quantities of chemicals that can be expected to occur in the environment in water, sediment, or food and that are not likely to pose a significant risk to the exposed human population. Human health criteria are published under section 304(a) of the CWA and are based on the latest scientific information. This information is updated and issued to the states to serve as guidance for the development of criteria.

Hydrocarbons - Chemical compounds only containing hydrogen and carbon.

Hypochlorite - The chemical used for chlorine disinfection of wastewater (either calcium, sodium, or lithium hypochlorite).

Hypoxia - The state of very low oxygen concentration.

IDL - See Instrument Detection Limit.

I/I - Infiltration and Inflow. See separate entries for each.

Infiltration - Groundwater that enters sewer pipes through cracks.

Inflow - Water that enters sewer pipes through illegal connections and storm water runoff.

Inorganic - Not containing carbon.

Influent - Wastewater or other water going into treatment facility or process.

Instrument Detection Limit (IDL) - The smallest amount of a substance a particular instrument is capable of detecting. See Appendix K for further explanation.

Interceptor - A large sewerage line collecting water from smaller sewerage pipes.

J values - Values between the Method Detection Limit and the Quantitation (or Reporting) Limit. See Appendix J for further explanation.

Lethal Concentration 50% (LC50) - The concentration of effluent in a sample that causes mortality to 50% of the test population at a specific time of observation.

Limiting Nutrient - In a given ecosystem, the limiting nutritional factor that controls the growth of plants or animals. Usually the limiting nutrient for plant growth is nitrogen in the marine environment and phosphorus in the fresh water environment. The limiting nutrient can also be thought of as the specific nutrient that will have the most impact on a receiving body of water (for example, the accelerated eutrophication of fresh water bodies caused by phosphorus in wastewater effluent).

Local Limits - The development of specific limits as part of MWRA's General Pretreatment Program: "The permittee shall develop and enforce specific effluent limits for industrial users, and all other users, as appropriate, pursuant to 40 CFR 403.5."

Lowest Observed Effect Concentration (LOEC) - The lowest concentration of effluent to which organisms are exposed in a life cycle or partial life cycle test which contains an adverse effect (on survival, growth, and reproduction).

Maximum Acceptable Toxicant Concentration (MATC) - The effluent concentration that may be present in a receiving water body without causing significant harm to productivity or other uses. The MATC is determined by the results of chronic tests of either a partial life cycle with sensitive life stages

or a full life cycle of the test organism. The MATC is the geometric mean of the No Observed Effect Concentration and the Lowest Observed Effect Concentration.

Maximum Daily Discharge Limitation - The highest allowable daily discharge.

MBAS - See Methylene Blue Anion Surfactant

MDL - See Method Detection Limit

Metals - A group of priority pollutants. See Appendix K for a complete list.

Method Detection Limit (MDL) - The smallest amount of a substance that can be detected above background noise by following a particular method of analysis. See Appendix K for further explanation.

Methylene Blue Anion Surfactant - A specific type of surfactant. See surfactant.

Mixing Zone - Area where discharged effluent is first diluted. The area is extended to cover the secondary mixing in the ambient water body. A mixing zone is an allocated impact zone where water quality criteria can be exceeded as long as toxic conditions are prevented.

National Pollutant Discharge Elimination System (NPDES) - The national program for issuing, modifying, revoking and reissuing, terminating, monitoring, and enforcing permits, and imposing and enforcing pretreatment requirements, under sections 307, 402, and 405 of the Clean Water Act (CWA). The term includes an “approved program.”

Nine Minimum Controls - Part of the EPA’s CSO Policy. The Nine Minimum Controls are:

- 1) Proper operation and regular maintenance (O&M) programs for the sewer system and combined sewer overflow points
- 2) Maximum use of the collection system for storage
- 3) Review and modification of the pretreatment programs to assure CSO impacts are minimized
- 4) Maximization of flow to the POTW for treatment
- 5) Prohibition of CSO discharges during dry weather
- 6) Control of solid and floatable materials in CSO discharges
- 7) Pollution prevention programs that focus on contaminant reduction activities
- 8) Public notification to ensure that the public receives adequate notification of CSO occurrences and CSO impacts
- 9) Monitoring to effectively characterize CSO impacts and the efficacy of CSO controls.

Nitrification - The conversion of ammonia and nitrite to nitrate.

No Observed Acute Level (NOAL) - The highest concentration of effluent to which organisms are exposed in a short-term test in which at least 90% of the test organisms survive.

No Observed Effect Concentration (NOEC) - The highest concentration of effluent to which organisms are exposed in a life cycle or partial life cycle test which contains no adverse effects (on growth, survival, and reproduction).

NPDES - See National Pollutant Discharge Elimination System

Nutrient - Any element or compound essential as raw material for organism growth and development. Examples: phosphorus and nitrogen.

Oil and Grease - Fats, oils, and grease from animal and plant derivation. Also called FOGs.

Organic Compounds - Volatiles, Acid Compounds, Base/Neutral, and Pesticides. Organics are listed in 40 CFR Ch. 1 Appendix D under CWA Section 307(a). See Appendix K for a complete list.

Orthophosphorus - A form of phosphorus, included in nutrients.

Outfall - the site of initial discharge

PAH - See Polynuclear Aromatic Hydrocarbon

Pesticides/PCBs - Subdivision of priority pollutants. See Appendix K for a complete list.

Petroleum Hydrocarbon (PHC) - Oil and grease from petroleum derivation.

pH - The negative log of the hydrogen ion concentration used to express acidity (<7) and alkalinity (>7).

PHC - See Petroleum Hydrocarbon.

Pollutant - Dredged soil, solid waste, incinerator residue, filter backwash, sewage, garbage, sewage sludge, munitions, chemicals wastes, biological materials, radioactive materials, (except those regulated under the Atomic Energy Act of 1954, as amended (42 U.S.C. 2011 *et seq.*)), heat, wrecked or discarded equipment, rock, sand, cellar dirt and industrial, municipal, and agricultural waste discharged into water.

It does not mean: (a) Sewage from vessels; or (b) Water, gas, or other material which is injected into a well to facilitate production of oil or gas, or water derived in association with oil and gas production and disposed or in a well, if the well used either to facilitate production or for disposal purposes is approved by authority of the State in which the well is located, and if the State in which the well is located, and if the State determines that the injection or disposal will not result in the degradation of ground or surface water resources.

Polynuclear Aromatic Hydrocarbon (PAH) - A type of semi-volatile organic. Also known as polycyclic aromatic hydrocarbons.

POTW - See Publicly Owned Treatment Work.

Preaeration - The process by which air is added to primary influent to help in the removal of gases, floatation of grease, addition of oxygen, and in the settling or coagulation of wastewater.

Prechlorination - The addition of chlorine to primary influent at or near the beginning of the treatment facility/process.

Primary Settling - The detention of wastewater as part of primary treatment to settle out solids (sludge) and collect floatables (scum).

Primary Treatment - Screening and settling of wastewater.

Priority Pollutants - Refers to some of the chemicals listed in 40 CFR Ch. 1 Appendix D under Section 307(a) of the CWA. There are 65 compounds and families of compounds that are among the most persistent, prevalent, and toxic of chemicals known to man. These 65 compounds or families of compounds have been translated into 126 individual pollutants. See Appendix K, Table K-2 for the complete list.

Priority Pollutant Scan - A series of chemical analyses to identify the presence of priority pollutants.

Publicly Owned Treatment Work (POTW) - Any facility or system used in the treatment (including recycling and reclamation) of municipal sewage or industrial wastes of liquid nature that is owned by a "State" or a "municipality." This definition includes sewers, pipes, or other conveyances only if they convey wastewater to a POTW providing treatment.

Pumping Station - Structures where wastewater from low-lying areas is

pumped.

Quantitation Limit - See Reporting Limit.

Removal Rate - or Percent Removal. Defined as the influent concentration minus the effluent concentration, divided by the influent concentration.

Reporting Limit - The smallest concentration that can be quantified. On a graph of pollutant concentration versus instrument response, the reporting limit is the smallest concentration where the linear relationship holds before starting to curve as the pollutant concentration goes to zero. Also called the Quantitation Limit. See Appendix J for further explanation.

Residuals - Matter left over by treatment processes including screenings, scum, and sludge.

Screening - The process by which sewage from interceptors first goes through headworks where grit and large objects like leaves, sticks, and hygiene products (like tampon applicators and condoms) are screened out.

Screenings - The objects that are collected by the process of screening.

Scum - Solids that float to the top of wastewater.

Secondary Treatment - The treatment of wastewater beyond solids and grit removal. The process decreases the organic load.

Sedimentation - The process by which solids are allowed to settle by gravity.

Sedimentation Tank - Tanks used to detain wastewater while the solids settle out.

Semi-Volatile Organics - Also known as Acid Base Neutrals (ABNs). A subcategory of organic pollutants. See Appendix K for a complete list.

Separate Sewer - A sewerage system divided into a storm sewer and a sanitary sewer.

Settleable Solids - The estimated amount of sludge that will settle by sedimentation. It is a fraction of the suspended-solids.

Settled Solids - Sludge. (See sludge.)

Sewage - Any wastes, including wastes from humans, households, commercial establishments, industries, and storm water runoff, that are discharged to or otherwise enter a POTW.

Sludge - Solids, residues, and precipitate separated from or created in sewage by the unit processes of a POTW.

SOP - See System Optimization Plan or Standard Operating Procedures

Stratification - The separation of water into layers characterized by thermal differences.

Standard Operating Procedures (SOP) - Documented protocols for plant operation, laboratory procedures, etc.

Surcharging - When the capacity of the sewer is insufficient and sewage escapes through a manhole.

Surfactant - Surface-active agent. Large organic molecules that cause foaming. They are usually found in detergents.

System Optimization Plan (SOP) - Hydraulic improvements that, in conjunction with ongoing programs of municipal sewerage agencies, might promote a balanced hydraulic system. The SOP may include optimization of the collector/interceptor system upstream of regulators, to ensure that the storage and transport capacity of the system is maximized within constraints unalterable except for major structural modifications.

Thickener - The structure where sludge is sent to be thickened by removing water.

TKN - See Total Kjeldahl Nitrogen.

Total Coliform - Bacteria found in decaying matter, feces, and soil. It used as an indicator of pathogens that are present in wastewater.

Total Kjeldahl Nitrogen (TKN) - The total organic and ammonia nitrogen.

Total Phosphorus - A measure of all the forms of phosphorus, a nutrient, found in water (orthophosphates, polyphosphates, and organic phosphates).

Total Suspended Solids (TSS) - The sum of insoluble solids that either float on the surface of, or are in suspension in water, wastewater, or other liquids.

Toxic Pollutant - Any pollutant listed as toxic in Appendix D of 40 CFR Part 122, under Section 307(a)(1) of CWA.

Toxics - Pollutants that have a toxic effect on living organisms. The “priority pollutants” of CWA Section 307(a) are a subset of this group of pollutants.

Toxicity Test - A procedure to determine the toxicity of a chemical or an effluent using living organisms. A toxicity test measures the degree of effect on exposed test organisms of a specific chemical or effluent.

TSS - See Total Suspended Solids.

Twelve Month Running Average - The monthly average computed using the specific month and the previous 11 months.

Unregulated Community - Dischargers not required to have Permits to discharge into MWRA sewerage system. They are not regulated or required to meet Local Limits, nor are they regulated under the Local Limits Discharge Program.

Vertical Mixing - The vertical movement of the water column caused by wind, and/or density and/or temperature differences.

Volatile Organic Acid (VOA) - Same as Volatile Organic Compound.

Volatile Organic Compound (VOC) - Same as Volatile Organic Acid.

Volatile Solids - Those solids of a suspended solid sample that are burned off in a muffle oven at 550 ± 50 °C.

Water Quality - The chemical, biological, and physical conditions of a body of water.

Water Quality Criteria - Specific levels of pollutants that would make a body of water unsuitable for its designated use (i.e. harmful if used for drinking, swimming, farming, fishing, or industrial processes).

Water Quality Standard - A law or regulation that consists of: the beneficial designated use or uses of a water body; the numeric and narrative water quality criteria that are necessary to protect the use or uses of that particular water body; and an antidegradation statement.

Whole Effluent Toxicity (WET) - The total toxic effect of effluent, not chemical specific but rather the cumulative effect, whether it be synergistic or antagonistic, of the chemicals found in the effluent.

**K.2
Abbreviations
and Acronyms**

ABNs - Acids Bases Neutrals

BDL - Below Detection Limit

BOD - Biochemical Oxygen Demand

BWSC - Boston Water and Sewer Commission

CFR - Code of Federal Regulations

CSO - Combined Sewer Overflow

CWA - Clean Water Act

DEP - Massachusetts Department of Environmental Protection

DITP - Deer Island Treatment Plant
ENQUAD - Environmental Quality Department
EPA - United States Environmental Protection Agency
FY - Fiscal Year
IDL - Instrument Detection Level
I/I - Infiltration and Inflow
LC50 - Median Lethal Concentration
LD50 - Median Lethal Dose
LOAEL - Lowest Observed Adverse Effect Level
LOEC - Lowest Observed Effect Concentration
MATC - Maximum Acceptable Toxicant Concentration
MDC - Metropolitan District Commission
MDL - Method Detection Limit
MPN - Most Probable Number
MWRA - Massachusetts Water Resources Authority
NITP - Nut Island Treatment Plant
NOAL - No Observed Acute Level
NOEC - No Observed Effect Concentration
NPDES - National Pollutant Discharge Elimination System
PAH - Polycyclic (or Polynuclear) Aromatic Hydrocarbon
PCB - Polychlorinated Biphenyl
PHC - Petroleum Hydrocarbon
POTW - Publicly Owned Treatment Work
SD - Standard Deviation
SOP - Standard Operating Procedures or System Optimization Plan
SSO - Sanitary Sewer Overflow
TKN - Total Kjeldahl Nitrogen
TRAC - Toxic Reduction and Control Department
TSS - Total Suspended Solids
VOA - Volatile Organic Acid
VOC - Volatile Organic Compound
WET - Whole Effluent Toxicity [test]

**K.3
Units**

in/yr - inches per year
L - liter
lbs - pounds
lbs/day - pounds per day
mL/L - milliliters per liter
MG - million gallons
mgd - million gallons per day
mg/L - milligrams per liter
µg/L (or ug/L) - micrograms per liter